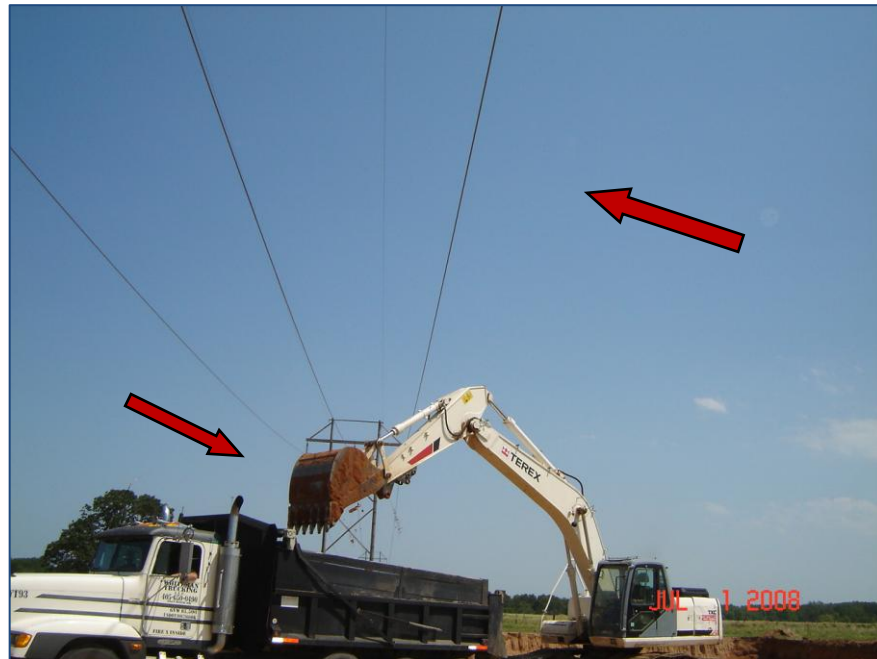

Safety-Gram

Title 45, Chapter 11

August 2011

Volume 12, Number 8

OVERHEAD POWER LINES



Section 915.39 – Equipment with booms or masts which are not properly protected shall not be operated where the booms or masts can come within (10) feet of an energized overhead power line.

LOOK UP AND LIVE!