

July 22, 2022

Sent Via E-Mail

Oklahoma Corporation Commission
P.O. Box 52000
Oklahoma City, OK 73105
pudenergy@occ.ok.gov

Attn: Public Utility Division Director

NOTICE OF INTENT TO CONSTRUCT A WIND ENERGY FACILITY

Pursuant to the notice requirements contained at Section 160.21 of the Oklahoma Wind Energy Development Act, 17 O.S. §§ 160.11–160.22 (the “Act”) and the notice requirements contained at OAC 165:35-45-4 of the Oklahoma Corporation Commission’s (“OCC’s”) Wind Energy rules, Chilocco Wind Farm, LLC (“the Company”) hereby submits to the Corporation Commission this Notice of Intent to Construct a wind energy facility located in Kay County, Oklahoma (“the Project”). The Project has been under active development for several years on tribal trust lands. A previous Notice of Intent to Construct was submitted to OCC for the Project on September 7, 2018, and this notice may be considered supplemental to the notice filed in 2018. Simultaneous to this submission, a notice is being sent to the Kay County Board of Commissioners, as evidenced by the “cc” information at the bottom of this page. Information concerning the Federal Aviation Administration (“FAA”) 7460-1 forms for the Project is attached as Exhibit “A.” A map depicting the Project’s boundary is attached hereto as Exhibit “B.” The Company hereby attests compliance with the setback provisions of 17 O.S. § 160.20(A).








Please do not hesitate to contact us with any questions regarding this submission.

Sincerely,
























Karl Dahlstrom
President
Chilocco Wind Farm, LLC
karl.dahlstrom@pne-ag.com

Cc:
Kay County Board of Commissioners













Structure	City, State	Lat/Long	Map	Actions	7460-2 Received	Latest Letter
WTG 01 Determined 2017-WTW-8762-OE	New Kirk, OK	36° 59' 47.64" N 97° 6' 35.13" W	 Show Map	Clone Upload a PDF Add 7460-2		 DNE
WTG 02 Determined 2017-WTW-8763-OE	New Kirk, OK	36° 59' 21.95" N 97° 6' 34.45" W	 Show Map	Clone Upload a PDF Add 7460-2		 DNE
WTG 03 Determined 2017-WTW-8764-OE	New Kirk, OK	36° 59' 1.77" N 97° 6' 34.66" W	 Show Map	Clone Upload a PDF Add 7460-2		 DNE
WTG 04 Determined 2017-WTW-8765-OE	New Kirk, OK	36° 58' 41.37" N 97° 6' 35.09" W	 Show Map	Clone Upload a PDF Add 7460-2		 DNE
WTG 05 Determined 2017-WTW-8766-OE	New Kirk, OK	36° 58' 24.24" N 97° 6' 33.69" W	 Show Map	Clone Upload a PDF Add 7460-2		 DNE
WTG 06 Determined 2017-WTW-8767-OE	New Kirk, OK	36° 58' 7.28" N 97° 6' 34.00" W	 Show Map	Clone Upload a PDF Add 7460-2		 DNE
WTG 07 Determined 2017-WTW-8768-OE	New Kirk, OK	36° 57' 36.24" N 97° 6' 29.49" W	 Show Map	Clone Upload a PDF Add 7460-2		 DNE
WTG 08 Determined 2017-WTW-8769-OE	New Kirk, OK	36° 59' 31.99" N 97° 6' 23.36" W	 Show Map	Clone Upload a PDF Add 7460-2		 DNE
WTG 10 Determined 2017-WTW-8770-OE	New Kirk, OK	36° 58' 59.94" N 97° 6' 19.70" W	 Show Map	Clone Upload a PDF Add 7460-2		 DNE
WTG 11 Determined 2017-WTW-8771-OE	New Kirk, OK	36° 58' 25.01" N 97° 6' 18.83" W	 Show Map	Clone Upload a PDF Add 7460-2		 DNE
WTG 12 Determined 2017-WTW-8772-OE	New Kirk, OK	36° 58' 42.78" N 97° 6' 17.90" W	 Show Map	Clone Upload a PDF Add 7460-2		 DNE
WTG 13 Determined 2017-WTW-8773-OE	New Kirk, OK	36° 59' 16.43" N 97° 6' 13.67" W	 Show Map	Clone Upload a PDF Add 7460-2		 DNE
WTG 15 Determined 2017-WTW-8774-OE	New Kirk, OK	36° 57' 41.39" N 97° 6' 15.62" W	 Show Map	Clone Upload a PDF Add 7460-2		 DNE
WTG 16 Determined 2017-WTW-8775-OE	New Kirk, OK	36° 58' 19.36" N 97° 5' 58.27" W	 Show Map	Clone Upload a PDF Add 7460-2		 DNE
WTG 17 Determined 2017-WTW-8776-OE	New Kirk, OK	36° 59' 24.83" N 97° 6' 1.41" W	 Show Map	Clone Upload a PDF Add 7460-2		 DNE
WTG 18 Determined 2017-WTW-8777-OE	New Kirk, OK	36° 59' 1.72" N 97° 6' 1.21" W	 Show Map	Clone Upload a PDF Add 7460-2		 DNE
WTG 19 Determined 2017-WTW-8778-OE	New Kirk, OK	36° 57' 46.02" N 97° 6' 0.21" W	 Show Map	Clone Upload a PDF Add 7460-2		 DNE
WTG 20 Determined 2017-WTW-8779-OE	New Kirk, OK	36° 58' 42.94" N 97° 5' 57.23" W	 Show Map	Clone Upload a PDF Add 7460-2		 DNE
WTG 21 Determined 2017-WTW-8780-OE	New Kirk, OK	36° 59' 41.71" N 97° 5' 55.29" W	 Show Map	Clone Upload a PDF Add 7460-2		 DNE
WTG 22 Determined 2017-WTW-8781-OE	New Kirk, OK	36° 57' 28.83" N 97° 5' 53.46" W	 Show Map	Clone Upload a PDF Add 7460-2		 DNE
WTG 24 Determined 2017-WTW-8782-OE	New Kirk, OK	36° 59' 11.82" N 97° 5' 49.72" W	 Show Map	Clone Upload a PDF Add 7460-2		 DNE

Structure	City, State	Lat/Long	Map	Actions	7460-2 Received	Latest Letter
WTG 25 Determined 2017-WTW-8783-OE	New Kirk, OK	36° 58' 14.61" N 97° 5' 45.20" W	Show Map	Clone Upload a PDF Add 7460-2		DNE
WTG 26 Determined 2017-WTW-8784-OE	New Kirk, OK	36° 57' 42.06" N 97° 5' 44.96" W	Show Map	Clone Upload a PDF Add 7460-2		DNE
WTG 27 Determined 2017-WTW-8785-OE	New Kirk, OK	36° 59' 49.53" N 97° 5' 41.70" W	Show Map	Clone Upload a PDF Add 7460-2		DNE
WTG 28 Determined 2017-WTW-8786-OE	New Kirk, OK	36° 59' 29.76" N 97° 5' 41.59" W	Show Map	Clone Upload a PDF Add 7460-2		DNE
WTG 29 Determined 2017-WTW-8787-OE	New Kirk, OK	36° 58' 49.64" N 97° 5' 34.68" W	Show Map	Clone Upload a PDF Add 7460-2		DNE
WTG 30 Determined 2017-WTW-8788-OE	New Kirk, OK	36° 57' 57.88" N 97° 5' 37.65" W	Show Map	Clone Upload a PDF Add 7460-2		DNE
WTG 31 Determined 2017-WTW-8789-OE	New Kirk, OK	36° 59' 13.44" N 97° 5' 37.59" W	Show Map	Clone Upload a PDF Add 7460-2		DNE
WTG 32 Determined 2017-WTW-8790-OE	New Kirk, OK	36° 57' 28.65" N 97° 5' 34.25" W	Show Map	Clone Upload a PDF Add 7460-2		DNE
WTG 33 Determined 2017-WTW-8791-OE	New Kirk, OK	36° 58' 25.04" N 97° 5' 32.08" W	Show Map	Clone Upload a PDF Add 7460-2		DNE
WTG 36 Determined 2017-WTW-8792-OE	New Kirk, OK	36° 57' 56.31" N 97° 5' 22.97" W	Show Map	Clone Upload a PDF Add 7460-2		DNE
WTG 37 Determined 2017-WTW-8793-OE	New Kirk, OK	36° 58' 50.18" N 97° 5' 21.30" W	Show Map	Clone Upload a PDF Add 7460-2		DNE
WTG 38 Determined 2017-WTW-8794-OE	New Kirk, OK	36° 57' 28.60" N 97° 5' 20.71" W	Show Map	Clone Upload a PDF Add 7460-2		DNE
WTG 39 Determined 2017-WTW-8795-OE	New Kirk, OK	36° 58' 30.32" N 97° 5' 15.04" W	Show Map	Clone Upload a PDF Add 7460-2		DNE
WTG 40 Determined 2017-WTW-8796-OE	New Kirk, OK	36° 58' 10.88" N 97° 5' 14.96" W	Show Map	Clone Upload a PDF Add 7460-2		DNE
WTG 42 Determined 2017-WTW-8797-OE	New Kirk, OK	36° 57' 42.46" N 97° 5' 13.29" W	Show Map	Clone Upload a PDF Add 7460-2		DNE
WTG 44 Determined 2017-WTW-8798-OE	New Kirk, OK	36° 57' 56.46" N 97° 5' 6.18" W	Show Map	Clone Upload a PDF Add 7460-2		DNE
WTG 45 Determined 2017-WTW-8799-OE	New Kirk, OK	36° 57' 28.61" N 97° 5' 3.16" W	Show Map	Clone Upload a PDF Add 7460-2		DNE
WTG 47 Determined 2017-WTW-8800-OE	New Kirk, OK	36° 58' 27.92" N 97° 4' 58.93" W	Show Map	Clone Upload a PDF Add 7460-2		DNE
WTG 50 Determined 2017-WTW-8801-OE	New Kirk, OK	36° 57' 45.29" N 97° 4' 55.67" W	Show Map	Clone Upload a PDF Add 7460-2		DNE
WTG 51 Determined 2017-WTW-8802-OE	New Kirk, OK	36° 58' 46.04" N 97° 5' 1.75" W	Show Map	Clone Upload a PDF Add 7460-2		DNE

Structure	City, State	Lat/Long	Map	Actions	7460-2 Received	Latest Letter
WTG 53 Determined 2017-WTW-8803-OE	New Kirk, OK	36° 57' 32.68" N 97° 4' 44.02" W	 Show Map	Clone Upload a PDF Add 7460-2	 DNE	
WTG 54 Determined 2017-WTW-8804-OE	New Kirk, OK	36° 57' 50.73" N 97° 4' 42.72" W	 Show Map	Clone Upload a PDF Add 7460-2	 DNE	
WTG 55 Determined 2017-WTW-8805-OE	New Kirk, OK	36° 58' 8.70" N 97° 4' 40.48" W	 Show Map	Clone Upload a PDF Add 7460-2	 DNE	
WTG 58 Determined 2017-WTW-8806-OE	New Kirk, OK	36° 57' 51.64" N 97° 4' 28.78" W	 Show Map	Clone Upload a PDF Add 7460-2	 DNE	
WTG 60 Determined 2017-WTW-8807-OE	New Kirk, OK	36° 58' 44.30" N 97° 4' 38.19" W	 Show Map	Clone Upload a PDF Add 7460-2	 DNE	
WTG 61 Determined 2017-WTW-8808-OE	New Kirk, OK	36° 57' 34.29" N 97° 4' 19.27" W	 Show Map	Clone Upload a PDF Add 7460-2	 DNE	
WTG 64 Determined 2017-WTW-8809-OE	New Kirk, OK	36° 57' 52.63" N 97° 4' 14.08" W	 Show Map	Clone Upload a PDF Add 7460-2	 DNE	
WTG 66 Determined 2017-WTW-8810-OE	New Kirk, OK	36° 58' 6.49" N 97° 4' 4.31" W	 Show Map	Clone Upload a PDF Add 7460-2	 DNE	
WTG 67 Determined 2017-WTW-8811-OE	New Kirk, OK	36° 57' 30.78" N 97° 4' 3.19" W	 Show Map	Clone Upload a PDF Add 7460-2	 DNE	
WTG 68 Determined 2017-WTW-8812-OE	New Kirk, OK	36° 59' 40.59" N 97° 3' 55.80" W	 Show Map	Clone Upload a PDF Add 7460-2	 DNE	
WTG 74 Determined 2017-WTW-8813-OE	New Kirk, OK	36° 59' 25.53" N 97° 3' 42.04" W	 Show Map	Clone Upload a PDF Add 7460-2	 DNE	
WTG 75 Determined 2017-WTW-8814-OE	New Kirk, OK	36° 58' 58.19" N 97° 3' 30.28" W	 Show Map	Clone Upload a PDF Add 7460-2	 DNE	
WTG 78 Determined 2017-WTW-8815-OE	New Kirk, OK	36° 59' 49.30" N 97° 3' 31.37" W	 Show Map	Clone Upload a PDF Add 7460-2	 DNE	
WTG 80 Determined 2017-WTW-8816-OE	New Kirk, OK	36° 59' 31.11" N 97° 3' 28.51" W	 Show Map	Clone Upload a PDF Add 7460-2	 DNE	
WTG 84 Determined 2017-WTW-8817-OE	New Kirk, OK	36° 59' 44.78" N 97° 3' 14.82" W	 Show Map	Clone Upload a PDF Add 7460-2	 DNE	
WTG 85 Determined 2017-WTW-8818-OE	New Kirk, OK	36° 58' 57.64" N 97° 3' 11.73" W	 Show Map	Clone Upload a PDF Add 7460-2	 DNE	
WTG 86 Determined 2017-WTW-8819-OE	New Kirk, OK	36° 59' 18.03" N 97° 3' 6.40" W	 Show Map	Clone Upload a PDF Add 7460-2	 DNE	
WTG 87 Determined 2017-WTW-8820-OE	New Kirk, OK	36° 59' 41.63" N 97° 2' 59.00" W	 Show Map	Clone Upload a PDF Add 7460-2	 DNE	
WTG 88 Determined 2017-WTW-8821-OE	New Kirk, OK	36° 58' 59.92" N 97° 2' 57.84" W	 Show Map	Clone Upload a PDF Add 7460-2	 DNE	
WTG 89 Determined 2017-WTW-8822-OE	New Kirk, OK	36° 59' 17.51" N 97° 2' 50.27" W	 Show Map	Clone Upload a PDF Add 7460-2	 DNE	

Structure	City, State	Lat/Long	Map	Actions	7460-2 Received	Latest Letter
WTG 91 Determined 2017-WTW-8823-OE	New Kirk, OK	36° 59' 46.65" N 97° 2' 32.00" W	Show Map	Clone Upload a PDF Add 7460-2		DNE
WTG 92 Determined 2017-WTW-8824-OE	New Kirk, OK	36° 59' 37.74" N 97° 2' 15.90" W	Show Map	Clone Upload a PDF Add 7460-2		DNE
WTG 93 Determined 2017-WTW-8825-OE	New Kirk, OK	36° 59' 40.15" N 97° 1' 56.04" W	Show Map	Clone Upload a PDF Add 7460-2		DNE
WTG 94 Determined 2017-WTW-8826-OE	New Kirk, OK	36° 59' 19.66" N 97° 2' 17.45" W	Show Map	Clone Upload a PDF Add 7460-2		DNE
WTG 95 Determined 2017-WTW-8827-OE	New Kirk, OK	36° 59' 24.21" N 97° 1' 56.20" W	Show Map	Clone Upload a PDF Add 7460-2		DNE
WTG 96 Determined 2017-WTW-8828-OE	New Kirk, OK	36° 59' 0.58" N 97° 2' 17.70" W	Show Map	Clone Upload a PDF Add 7460-2		DNE
WTG 97 Determined 2017-WTW-8829-OE	New Kirk, OK	36° 59' 0.31" N 97° 1' 56.43" W	Show Map	Clone Upload a PDF Add 7460-2		DNE
WTG 99 Determined 2017-WTW-8830-OE	New Kirk, OK	36° 58' 45.50" N 97° 1' 57.60" W	Show Map	Clone Upload a PDF Add 7460-2		DNE
WTG 100 Determined 2017-WTW-8831-OE	New Kirk, OK	36° 58' 34.41" N 97° 2' 24.46" W	Show Map	Clone Upload a PDF Add 7460-2		DNE
WTG 101 Determined 2017-WTW-8832-OE	New Kirk, OK	36° 58' 26.09" N 97° 2' 11.39" W	Show Map	Clone Upload a PDF Add 7460-2		DNE
WTG 104 Determined 2017-WTW-8833-OE	New Kirk, OK	36° 58' 6.13" N 97° 2' 17.24" W	Show Map	Clone Upload a PDF Add 7460-2		DNE
WTG 105 Determined 2017-WTW-8834-OE	New Kirk, OK	36° 58' 5.78" N 97° 1' 59.82" W	Show Map	Clone Upload a PDF Add 7460-2		DNE
WTG 106 Determined 2017-WTW-8835-OE	New Kirk, OK	36° 57' 48.28" N 97° 2' 40.46" W	Show Map	Clone Upload a PDF Add 7460-2		DNE
WTG 107 Determined 2017-WTW-8836-OE	New Kirk, OK	36° 57' 48.56" N 97° 2' 24.36" W	Show Map	Clone Upload a PDF Add 7460-2		DNE
WTG 108 Determined 2017-WTW-8837-OE	New Kirk, OK	36° 57' 46.10" N 97° 1' 59.15" W	Show Map	Clone Upload a PDF Add 7460-2		DNE
WTG 109 Determined 2017-WTW-8838-OE	New Kirk, OK	36° 57' 29.54" N 97° 2' 47.37" W	Show Map	Clone Upload a PDF Add 7460-2		DNE
WTG 110 Determined 2017-WTW-8839-OE	New Kirk, OK	36° 57' 25.73" N 97° 2' 30.85" W	Show Map	Clone Upload a PDF Add 7460-2		DNE
WTG 111 Determined 2017-WTW-8840-OE	New Kirk, OK	36° 57' 35.41" N 97° 2' 11.52" W	Show Map	Clone Upload a PDF Add 7460-2		DNE
WTG 112 Determined 2017-WTW-8841-OE	New Kirk, OK	36° 57' 26.04" N 97° 1' 56.64" W	Show Map	Clone Upload a PDF Add 7460-2		DNE

ALTERNATE

Structure	City, State	Lat/Long	Map	Actions	7460-2 Received	Latest Letter
5 Accepted 2018-WTW-12816-OE	New Kirk, OK	36° 58' 6.80" N 97° 6' 34.65" W	 Show Map	Clone Upload a PDF Add 7460-2		None
19 Accepted 2018-WTW-12817-OE	New Kirk, OK	36° 58' 18.63" N 97° 5' 45.12" W	 Show Map	Clone Upload a PDF Add 7460-2		None
30 Accepted 2018-WTW-12818-OE	New Kirk, OK	36° 58' 9.96" N 97° 5' 14.99" W	 Show Map	Clone Upload a PDF Add 7460-2		None
35 Accepted 2018-WTW-12819-OE	New Kirk, OK	36° 58' 50.00" N 97° 4' 59.84" W	 Show Map	Clone Upload a PDF Add 7460-2		None
47 Accepted 2018-WTW-12820-OE	New Kirk, OK	36° 59' 0.57" N 97° 3' 27.13" W	 Show Map	Clone Upload a PDF Add 7460-2		None
51 Accepted 2018-WTW-12821-OE	New Kirk, OK	36° 59' 1.15" N 97° 3' 10.58" W	 Show Map	Clone Upload a PDF Add 7460-2		None
54 Accepted 2018-WTW-12822-OE	New Kirk, OK	36° 59' 1.21" N 97° 2' 55.99" W	 Show Map	Clone Upload a PDF Add 7460-2		None
60 Accepted 2018-WTW-12823-OE	New Kirk, OK	36° 59' 26.22" N 97° 1' 57.07" W	 Show Map	Clone Upload a PDF Add 7460-2		None
65 Accepted 2018-WTW-12824-OE	New Kirk, OK	36° 58' 26.83" N 97° 2' 11.35" W	 Show Map	Clone Upload a PDF Add 7460-2		None
78 Accepted 2018-WTW-12825-OE	New Kirk, OK	36° 58' 28.16" N 97° 4' 53.14" W	 Show Map	Clone Upload a PDF Add 7460-2		None
79 Accepted 2018-WTW-12826-OE	New Kirk, OK	36° 58' 35.09" N 97° 5' 15.03" W	 Show Map	Clone Upload a PDF Add 7460-2		None
80 Accepted 2018-WTW-12827-OE	New Kirk, OK	36° 58' 29.83" N 97° 5' 32.06" W	 Show Map	Clone Upload a PDF Add 7460-2		None



Notice of Proposed Construction or Alteration - Off Airport

[Add a New Case \(Off Airport\) - Desk Reference Guide V_2018.2.1](#)

[Add a New Case \(Off Airport\) for Wind Turbines - Met Towers \(with WT Farm\) - WT-Barge Crane - Desk Reference Guide V_2018.2.1](#)

Project Name: PNEWI-000610354-19

Sponsor: PNE USA

Details for Case : 1

[Show Project Summary](#)

Case Status		Date Accepted:				
ASN:	2019-WTW-4403-OE	04/22/2019				
Status:	Determined	Date Determined:	08/18/2019			
7460-2 Forms:	01/13/2021 7460-2 (PART 1) required at least 10 days prior to start of construction. Add Supplemental Notice (7460-2)	Letters:	03/24/2021 EXT 08/18/2019 DNH 07/08/2019 CIR 06/24/2019 NPH 04/23/2019 ADD			
Public Comments:	None	Documents:	None Project Documents: 04/22/2019 Chilocco - FAA Fi... 04/22/2019 Chilocco - FAA F... 04/18/2019 Chilocco - FAA Fi...			
Construction / Alteration Information		Structure Summary				
Notice Of:	Construction	Structure Type:	Wind Turbine *legacy*			
Duration:	Permanent	Structure Type:	WIND_TURBINE Wind Turbine			
<i>if Temporary</i> :	Months: Days:	Structure Name:	1			
Work Schedule - Start:	01/01/2020	FDC NOTAM:				
Work Schedule - End:	01/01/2021	NOTAM Number:				
*For temporary cranes-Does the permanent structure require separate notice to the FAA? To find out, use the Notice Criteria Tool. If separate notice is required, please ensure it is filed. If it is not filed, please state the reason in the Description of Proposal.		FCC Number:				
State Filing:		Prior ASN:				
Structure Details		Proposed Frequency Bands				
Latitude:	36° 59' 47.62" N	Low Freq	High Freq	Freq Unit	ERP	ERP Unit
Longitude:	97° 6' 35.14" W					
Horizontal Datum:	NAD83					
Site Elevation (SE):	1161 (nearest foot) PASSED					
Structure Height (AGL):	599 (nearest foot)					
Current Height (AGL):	(nearest foot)					
* For notice of alteration or existing provide the current AGL height of the existing structure. Include details in the Description of Proposal						
Minimum Operating Height (AGL):	(nearest foot)					
* For aeronautical study of a crane or construction equipment the maximum height should be listed above as the Structure Height (AGL). Additionally, provide the minimum operating height to avoid delays if impacts are identified that require negotiation to a reduced height. If the Structure Height and minimum operating height are the same enter the same value in both fields.						
Requested Marking/Lighting:	Red lights and paint					
	Other :					
Recommended Marking/Lighting:	White Paint/Synchronized Red Lights					
Current Marking/Lighting:	N/A Proposed Structure					
	Other : <input type="text"/>					
Nearest City:	New Kirk					
Nearest State:	Oklahoma					
Description of Location:	14 Miles North of New Kirk					
On the Project Summary page upload any certified survey.						
Description of Proposal:	80 WTG Project for electric production					





Notice of Proposed Construction or Alteration - Off Airport

[Add a New Case \(Off Airport\) - Desk Reference Guide V_2018.2.1](#)

[Add a New Case \(Off Airport\) for Wind Turbines - Met Towers \(with WT Farm\) - WT-Barge Crane - Desk Reference Guide V_2018.2.1](#)

Project Name: PNEWI-000610354-19

Sponsor: PNE USA

Details for Case : 2

[Show Project Summary](#)

Case Status					
ASN:	2019-WTW-4404-OE				
Status:	Determined				
7460-2 Forms:	<p>01/13/2021</p> <p>7460-2 (PART 1) required at least 10 days prior to start of construction.</p> <p>Add Supplemental Notice (7460-2)</p>				
Public Comments:	None				
Date Accepted:	04/22/2019				
Date Determined:	08/18/2019				
Letters:	<p>03/24/2021 EXT</p> <p>08/18/2019 DNH</p> <p>06/24/2019 NPH</p>				
Documents:	<p>None</p> <p>Project Documents:</p> <p>04/22/2019 Chilocco - FAA Fi...</p> <p>04/22/2019 Chilocco - FAA F...</p> <p>04/18/2019 Chilocco - FAA Fi...</p>				
Construction / Alteration Information					
Notice Of:					
Duration:	Permanent				
if Temporary :	Months: Days:				
Work Schedule - Start:	01/01/2020				
Work Schedule - End:	01/01/2021				
<p><i>*For temporary cranes-Does the permanent structure require separate notice to the FAA? To find out, use the Notice Criteria Tool. If separate notice is required, please ensure it is filed. If it is not filed, please state the reason in the Description of Proposal.</i></p> <p>State Filing:</p>					
Structure Details					
Latitude:	36° 59' 21.95" N				
Longitude:	97° 6' 34.44" W				
Horizontal Datum:	NAD83				
Site Elevation (SE):	1186 (nearest foot) PASSED				
Structure Height (AGL):	599 (nearest foot)				
Current Height (AGL):	(nearest foot)				
<p><i>* For notice of alteration or existing provide the current AGL height of the existing structure. Include details in the Description of Proposal</i></p>					
Minimum Operating Height (AGL):	(nearest foot)				
<p><i>* For aeronautical study of a crane or construction equipment the maximum height should be listed above as the Structure Height (AGL). Additionally, provide the minimum operating height to avoid delays if impacts are identified that require negotiation to a reduced height. If the Structure Height and minimum operating height are the same enter the same value in both fields.</i></p>					
Requested Marking/Lighting:	Red lights and paint				
Recommended Marking/Lighting:	White Paint/Synchronized Red Lights				
Current Marking/Lighting:	N/A Proposed Structure				
Other :	<input type="text"/>				
Nearest City:	New Kirk				
Nearest State:	Oklahoma				
Description of Location:	14 Miles North of New Kirk				
Description of Proposal:	80 WTG Project for electric production				
Structure Summary					
Structure Type:	Wind Turbine *legacy*				
Structure Type:	<input type="text" value="WIND_TURBINE"/> Wind Turbine				
Structure Name:	2				
FDC NOTAM:					
NOTAM Number:					
FCC Number:					
Prior ASN:					
Proposed Frequency Bands					
	Low Freq	High Freq	Freq Unit	ERP	ERP Unit





Notice of Proposed Construction or Alteration - Off Airport

[Add a New Case \(Off Airport\) - Desk Reference Guide V_2018.2.1](#)

[Add a New Case \(Off Airport\) for Wind Turbines - Met Towers \(with WT Farm\) - WT-Barge Crane - Desk Reference Guide V_2018.2.1](#)

Project Name: PNEWI-000610354-19

Sponsor: PNE USA

Details for Case : 3

[Show Project Summary](#)

Case Status	
ASN:	2019-WTW-4405-OE
Status:	Determined
7460-2 Forms:	<p>01/13/2021</p> <p>7460-2 (PART 1) required at least 10 days prior to start of construction.</p> <p>Add Supplemental Notice (7460-2)</p>
Public Comments:	None
Date Accepted:	04/22/2019
Date Determined:	08/18/2019
Letters:	<p>03/24/2021 EXT</p> <p>08/18/2019 DNH</p> <p>06/24/2019 NPH</p>
Documents:	<p>None</p> <p>Project Documents:</p> <p>04/22/2019 Chilocco - FAA Fi...</p> <p>04/22/2019 Chilocco - FAA F...</p> <p>04/18/2019 Chilocco - FAA Fi...</p>

Construction / Alteration Information	
Notice Of:	
Duration:	Permanent
if Temporary :	Months: Days:
Work Schedule - Start:	01/01/2020
Work Schedule - End:	01/01/2021
<p><i>*For temporary cranes-Does the permanent structure require separate notice to the FAA? To find out, use the Notice Criteria Tool. If separate notice is required, please ensure it is filed. If it is not filed, please state the reason in the Description of Proposal.</i></p> <p>State Filing:</p>	

Structure Summary	
Structure Type:	Wind Turbine *legacy*
Structure Type:	<input type="text" value="WIND_TURBINE"/> Wind Turbine
Structure Name:	3
FDC NOTAM:	
NOTAM Number:	
FCC Number:	
Prior ASN:	

Structure Details	
Latitude:	36° 59' 1.77" N
Longitude:	97° 6' 34.66" W
Horizontal Datum:	NAD83
Site Elevation (SE):	1200 (nearest foot) PASSED
Structure Height (AGL):	599 (nearest foot)
Current Height (AGL):	(nearest foot)
<p><i>* For notice of alteration or existing provide the current AGL height of the existing structure. Include details in the Description of Proposal</i></p>	
Minimum Operating Height (AGL):	(nearest foot)
<p><i>* For aeronautical study of a crane or construction equipment the maximum height should be listed above as the Structure Height (AGL). Additionally, provide the minimum operating height to avoid delays if impacts are identified that require negotiation to a reduced height. If the Structure Height and minimum operating height are the same enter the same value in both fields.</i></p>	
Requested Marking/Lighting:	Red lights and paint
Recommended Marking/Lighting:	White Paint/Synchronized Red Lights
Current Marking/Lighting:	N/A Proposed Structure
Other :	<input type="text"/>
Nearest City:	New Kirk
Nearest State:	Oklahoma
Description of Location:	14 Miles North of New Kirk
Description of Proposal:	80 WTG Project for electric production

Proposed Frequency Bands				
Low Freq	High Freq	Freq Unit	ERP	ERP Unit





Notice of Proposed Construction or Alteration - Off Airport

[Add a New Case \(Off Airport\) - Desk Reference Guide V_2018.2.1](#)

[Add a New Case \(Off Airport\) for Wind Turbines - Met Towers \(with WT Farm\) - WT-Barge Crane - Desk Reference Guide V_2018.2.1](#)

Project Name: PNEWI-000610354-19

Sponsor: PNE USA

Details for Case : 4

[Show Project Summary](#)

Case Status					
ASN:	2019-WTW-4406-OE				
Status:	Determined				
7460-2 Forms:	<p>01/13/2021</p> <p>7460-2 (PART 1) required at least 10 days prior to start of construction.</p> <p>Add Supplemental Notice (7460-2)</p>				
Public Comments:	None				
Date Accepted:	04/22/2019				
Date Determined:	08/18/2019				
Letters:	<p>03/24/2021 EXT</p> <p>08/18/2019 DNH</p> <p>06/24/2019 NPH</p>				
Documents:	<p>None</p> <p>Project Documents:</p> <p>04/22/2019 Chilocco - FAA Fi...</p> <p>04/22/2019 Chilocco - FAA F...</p> <p>04/18/2019 Chilocco - FAA Fi...</p>				
Construction / Alteration Information					
Notice Of:					
Duration:	Permanent				
if Temporary :	Months: Days:				
Work Schedule - Start:	01/01/2020				
Work Schedule - End:	01/01/2021				
<p><i>*For temporary cranes-Does the permanent structure require separate notice to the FAA? To find out, use the Notice Criteria Tool. If separate notice is required, please ensure it is filed. If it is not filed, please state the reason in the Description of Proposal.</i></p> <p>State Filing:</p>					
Structure Details					
Latitude:	36° 58' 24.24" N				
Longitude:	97° 6' 33.69" W				
Horizontal Datum:	NAD83				
Site Elevation (SE):	1192 (nearest foot) PASSED				
Structure Height (AGL):	599 (nearest foot)				
Current Height (AGL):	(nearest foot)				
<p><i>* For notice of alteration or existing provide the current AGL height of the existing structure. Include details in the Description of Proposal</i></p>					
Minimum Operating Height (AGL):	(nearest foot)				
<p><i>* For aeronautical study of a crane or construction equipment the maximum height should be listed above as the Structure Height (AGL). Additionally, provide the minimum operating height to avoid delays if impacts are identified that require negotiation to a reduced height. If the Structure Height and minimum operating height are the same enter the same value in both fields.</i></p>					
Requested Marking/Lighting:	Red lights and paint				
Recommended Marking/Lighting:	White Paint/Synchronized Red Lights				
Current Marking/Lighting:	N/A Proposed Structure				
Other :	<input type="text"/>				
Nearest City:	New Kirk				
Nearest State:	Oklahoma				
Description of Location:	14 Miles North of New Kirk				
Description of Proposal:	80 WTG Project for electric production				
Structure Summary					
Structure Type:	Wind Turbine *legacy*				
Structure Type:	<input type="text" value="WIND_TURBINE"/> Wind Turbine				
Structure Name:	4				
FDC NOTAM:					
NOTAM Number:					
FCC Number:					
Prior ASN:					
Proposed Frequency Bands					
	Low Freq	High Freq	Freq Unit	ERP	ERP Unit





Notice of Proposed Construction or Alteration - Off Airport

[Add a New Case \(Off Airport\) - Desk Reference Guide V_2018.2.1](#)

[Add a New Case \(Off Airport\) for Wind Turbines - Met Towers \(with WT Farm\) - WT-Barge Crane - Desk Reference Guide V_2018.2.1](#)

Project Name: PNEWI-000610354-19

Sponsor: PNE USA

Details for Case : 5

[Show Project Summary](#)

Case Status											
ASN:	2019-WTW-4407-OE										
Status:	Determined										
7460-2 Forms:	<p>01/13/2021</p> <p>7460-2 (PART 1) required at least 10 days prior to start of construction.</p> <p>Add Supplemental Notice (7460-2)</p>										
Public Comments:	None										
Date Accepted:	04/22/2019										
Date Determined:	08/18/2019										
Letters:	<p>03/24/2021 EXT</p> <p>08/18/2019 DNH</p> <p>06/24/2019 NPH</p>										
Documents:	<p>None</p> <p>Project Documents:</p> <p>04/22/2019 Chilocco - FAA Fi...</p> <p>04/22/2019 Chilocco - FAA F...</p> <p>04/18/2019 Chilocco - FAA Fi...</p>										
Construction / Alteration Information											
Notice Of:											
Duration:	Permanent										
if Temporary :	Months: Days:										
Work Schedule - Start:	01/01/2020										
Work Schedule - End:	01/01/2021										
<p><i>*For temporary cranes-Does the permanent structure require separate notice to the FAA? To find out, use the Notice Criteria Tool. If separate notice is required, please ensure it is filed. If it is not filed, please state the reason in the Description of Proposal.</i></p> <p>State Filing:</p>											
Structure Details											
Latitude:	36° 58' 6.80" N										
Longitude:	97° 6' 34.65" W										
Horizontal Datum:	NAD83										
Site Elevation (SE):	1189 (nearest foot) PASSED										
Structure Height (AGL):	599 (nearest foot)										
Current Height (AGL):	(nearest foot)										
<p><i>* For notice of alteration or existing provide the current AGL height of the existing structure. Include details in the Description of Proposal</i></p>											
Minimum Operating Height (AGL):	(nearest foot)										
<p><i>* For aeronautical study of a crane or construction equipment the maximum height should be listed above as the Structure Height (AGL). Additionally, provide the minimum operating height to avoid delays if impacts are identified that require negotiation to a reduced height. If the Structure Height and minimum operating height are the same enter the same value in both fields.</i></p>											
Requested Marking/Lighting:	Red lights and paint										
Recommended Marking/Lighting:	White Paint/Synchronized Red Lights										
Current Marking/Lighting:	N/A Proposed Structure										
Other :	<input type="text"/>										
Nearest City:	New Kirk										
Nearest State:	Oklahoma										
Description of Location:	14 Miles North of New Kirk										
Description of Proposal:	80 WTG Project for electric production										
Structure Summary											
Structure Type:	Wind Turbine *legacy*										
Structure Type:	<input type="text" value="WIND_TURBINE"/> Wind Turbine										
Structure Name:	5										
FDC NOTAM:											
NOTAM Number:											
FCC Number:											
Prior ASN:											
Proposed Frequency Bands											
	<table border="1"> <thead> <tr> <th>Low Freq</th> <th>High Freq</th> <th>Freq Unit</th> <th>ERP</th> <th>ERP Unit</th> </tr> </thead> <tbody> <tr> <td></td> <td></td> <td></td> <td></td> <td></td> </tr> </tbody> </table>	Low Freq	High Freq	Freq Unit	ERP	ERP Unit					
Low Freq	High Freq	Freq Unit	ERP	ERP Unit							





Notice of Proposed Construction or Alteration - Off Airport

[Add a New Case \(Off Airport\) - Desk Reference Guide V_2018.2.1](#)

[Add a New Case \(Off Airport\) for Wind Turbines - Met Towers \(with WT Farm\) - WT-Barge Crane - Desk Reference Guide V_2018.2.1](#)

Project Name: PNEWI-000610354-19

Sponsor: PNE USA

Details for Case : 6

[Show Project Summary](#)

Case Status	
ASN:	2019-WTW-4408-OE
Status:	Determined
7460-2 Forms:	<p>01/13/2021</p> <p>7460-2 (PART 1) required at least 10 days prior to start of construction.</p> <p>Add Supplemental Notice (7460-2)</p>
Public Comments:	None
Date Accepted:	04/22/2019
Date Determined:	08/18/2019
Letters:	<p>03/24/2021 EXT</p> <p>08/18/2019 DNH</p> <p>06/24/2019 NPH</p>
Documents:	<p>None</p> <p>Project Documents:</p> <p>04/22/2019 Chilocco - FAA Fi...</p> <p>04/22/2019 Chilocco - FAA F...</p> <p>04/18/2019 Chilocco - FAA Fi...</p>

Construction / Alteration Information	
Notice Of:	
Duration:	Permanent
if Temporary :	Months: Days:
Work Schedule - Start:	01/01/2020
Work Schedule - End:	01/01/2021
<p><i>*For temporary cranes-Does the permanent structure require separate notice to the FAA? To find out, use the Notice Criteria Tool. If separate notice is required, please ensure it is filed. If it is not filed, please state the reason in the Description of Proposal.</i></p> <p>State Filing:</p>	

Structure Summary	
Structure Type:	Wind Turbine *legacy*
Structure Type:	<input type="text" value="WIND_TURBINE"/> Wind Turbine
Structure Name:	6
FDC NOTAM:	
NOTAM Number:	
FCC Number:	
Prior ASN:	

Structure Details	
Latitude:	36° 57' 36.25" N
Longitude:	97° 6' 29.50" W
Horizontal Datum:	NAD83
Site Elevation (SE):	1184 (nearest foot) PASSED
Structure Height (AGL):	599 (nearest foot)
Current Height (AGL):	(nearest foot)
<p><i>* For notice of alteration or existing provide the current AGL height of the existing structure. Include details in the Description of Proposal</i></p>	
Minimum Operating Height (AGL):	(nearest foot)
<p><i>* For aeronautical study of a crane or construction equipment the maximum height should be listed above as the Structure Height (AGL). Additionally, provide the minimum operating height to avoid delays if impacts are identified that require negotiation to a reduced height. If the Structure Height and minimum operating height are the same enter the same value in both fields.</i></p>	
Requested Marking/Lighting:	Red lights and paint
Recommended Marking/Lighting:	White Paint/Synchronized Red Lights
Current Marking/Lighting:	N/A Proposed Structure
Other :	<input type="text"/>
Nearest City:	New Kirk
Nearest State:	Oklahoma
Description of Location:	14 Miles North of New Kirk
Description of Proposal:	80 WTG Project for electric production

Proposed Frequency Bands				
Low Freq	High Freq	Freq Unit	ERP	ERP Unit





Notice of Proposed Construction or Alteration - Off Airport

[Add a New Case \(Off Airport\) - Desk Reference Guide V_2018.2.1](#)

[Add a New Case \(Off Airport\) for Wind Turbines - Met Towers \(with WT Farm\) - WT-Barge Crane - Desk Reference Guide V_2018.2.1](#)

Project Name: PNEWI-000610354-19

Sponsor: PNE USA

Details for Case : 7

[Show Project Summary](#)

Case Status	
ASN:	2019-WTW-4409-OE
Status:	Determined
7460-2 Forms:	<p>01/13/2021</p> <p>7460-2 (PART 1) required at least 10 days prior to start of construction.</p> <p>Add Supplemental Notice (7460-2)</p>
Public Comments:	None
Date Accepted:	04/22/2019
Date Determined:	08/18/2019
Letters:	<p>03/24/2021 EXT</p> <p>08/18/2019 DNH</p> <p>06/24/2019 NPH</p>
Documents:	<p>None</p> <p>Project Documents:</p> <p>04/22/2019 Chilocco - FAA Fi...</p> <p>04/22/2019 Chilocco - FAA F...</p> <p>04/18/2019 Chilocco - FAA Fi...</p>

Construction / Alteration Information	
Notice Of:	
Duration:	Permanent
if Temporary:	Months: Days:
Work Schedule - Start:	01/01/2020
Work Schedule - End:	01/01/2021
<p><i>*For temporary cranes-Does the permanent structure require separate notice to the FAA? To find out, use the Notice Criteria Tool. If separate notice is required, please ensure it is filed. If it is not filed, please state the reason in the Description of Proposal.</i></p> <p>State Filing:</p>	

Structure Summary	
Structure Type:	Wind Turbine *legacy*
Structure Type:	<input type="text" value="WIND_TURBINE"/> Wind Turbine
Structure Name:	7
FDC NOTAM:	
NOTAM Number:	
FCC Number:	
Prior ASN:	

Structure Details	
Latitude:	36° 59' 31.99" N
Longitude:	97° 6' 23.36" W
Horizontal Datum:	NAD83
Site Elevation (SE):	1182 (nearest foot) PASSED
Structure Height (AGL):	599 (nearest foot)
Current Height (AGL):	(nearest foot)
<p><i>* For notice of alteration or existing provide the current AGL height of the existing structure. Include details in the Description of Proposal</i></p>	
Minimum Operating Height (AGL):	(nearest foot)
<p><i>* For aeronautical study of a crane or construction equipment the maximum height should be listed above as the Structure Height (AGL). Additionally, provide the minimum operating height to avoid delays if impacts are identified that require negotiation to a reduced height. If the Structure Height and minimum operating height are the same enter the same value in both fields.</i></p>	
Requested Marking/Lighting:	Red lights and paint
Recommended Marking/Lighting:	White Paint/Synchronized Red Lights
Current Marking/Lighting:	N/A Proposed Structure
Other:	<input type="text"/>
Nearest City:	New Kirk
Nearest State:	Oklahoma
Description of Location:	14 Miles North of New Kirk
Description of Proposal:	80 WTG Project for electric production

Proposed Frequency Bands				
Low Freq	High Freq	Freq Unit	ERP	ERP Unit





Notice of Proposed Construction or Alteration - Off Airport

[Add a New Case \(Off Airport\) - Desk Reference Guide V_2018.2.1](#)

[Add a New Case \(Off Airport\) for Wind Turbines - Met Towers \(with WT Farm\) - WT-Barge Crane - Desk Reference Guide V_2018.2.1](#)

Project Name: PNEWI-000610354-19

Sponsor: PNE USA

Details for Case : 8

[Show Project Summary](#)

Case Status	
ASN:	2019-WTW-4410-OE
Status:	Determined
7460-2 Forms:	<p>01/13/2021</p> <p>7460-2 (PART 1) required at least 10 days prior to start of construction.</p> <p>Add Supplemental Notice (7460-2)</p>
Public Comments:	None
Date Accepted:	04/22/2019
Date Determined:	08/18/2019
Letters:	<p>03/24/2021 EXT</p> <p>08/18/2019 DNH</p> <p>06/24/2019 NPH</p>
Documents:	<p>None</p> <p>Project Documents:</p> <p>04/22/2019 Chilocco - FAA Fi...</p> <p>04/22/2019 Chilocco - FAA F...</p> <p>04/18/2019 Chilocco - FAA Fi...</p>

Construction / Alteration Information	
Notice Of:	
Duration:	Permanent
if Temporary :	Months: Days:
Work Schedule - Start:	01/01/2020
Work Schedule - End:	01/01/2021
<p><i>*For temporary cranes-Does the permanent structure require separate notice to the FAA? To find out, use the Notice Criteria Tool. If separate notice is required, please ensure it is filed. If it is not filed, please state the reason in the Description of Proposal.</i></p> <p>State Filing:</p>	

Structure Summary	
Structure Type:	Wind Turbine *legacy*
Structure Type:	<input type="text" value="WIND_TURBINE"/> Wind Turbine
Structure Name:	8
FDC NOTAM:	
NOTAM Number:	
FCC Number:	
Prior ASN:	

Structure Details	
Latitude:	36° 58' 59.94" N
Longitude:	97° 6' 19.70" W
Horizontal Datum:	NAD83
Site Elevation (SE):	1181 (nearest foot) PASSED
Structure Height (AGL):	599 (nearest foot)
Current Height (AGL):	(nearest foot)
<p><i>* For notice of alteration or existing provide the current AGL height of the existing structure. Include details in the Description of Proposal</i></p>	
Minimum Operating Height (AGL):	(nearest foot)
<p><i>* For aeronautical study of a crane or construction equipment the maximum height should be listed above as the Structure Height (AGL). Additionally, provide the minimum operating height to avoid delays if impacts are identified that require negotiation to a reduced height. If the Structure Height and minimum operating height are the same enter the same value in both fields.</i></p>	
Requested Marking/Lighting:	Red lights and paint
Recommended Marking/Lighting:	White Paint/Synchronized Red Lights
Current Marking/Lighting:	N/A Proposed Structure
Other :	<input type="text"/>
Nearest City:	New Kirk
Nearest State:	Oklahoma
Description of Location:	14 Miles North of New Kirk
Description of Proposal:	80 WTG Project for electric production

Proposed Frequency Bands				
Low Freq	High Freq	Freq Unit	ERP	ERP Unit





Notice of Proposed Construction or Alteration - Off Airport

[Add a New Case \(Off Airport\) - Desk Reference Guide V_2018.2.1](#)

[Add a New Case \(Off Airport\) for Wind Turbines - Met Towers \(with WT Farm\) - WT-Barge Crane - Desk Reference Guide V_2018.2.1](#)

Project Name: PNEWI-000610354-19

Sponsor: PNE USA

Details for Case : 9

[Show Project Summary](#)

Case Status					
ASN:	2019-WTW-4411-OE				
Status:	Determined				
7460-2 Forms:	<p>01/13/2021</p> <p>7460-2 (PART 1) required at least 10 days prior to start of construction.</p> <p>Add Supplemental Notice (7460-2)</p>				
Public Comments:	None				
Date Accepted:	04/22/2019				
Date Determined:	08/18/2019				
Letters:	<p>03/24/2021 EXT</p> <p>08/18/2019 DNH</p> <p>06/24/2019 NPH</p>				
Documents:	<p>None</p> <p>Project Documents:</p> <p>04/22/2019 Chilocco - FAA Fi...</p> <p>04/22/2019 Chilocco - FAA F...</p> <p>04/18/2019 Chilocco - FAA Fi...</p>				
Construction / Alteration Information					
Notice Of:					
Duration:	Permanent				
if Temporary :	Months: Days:				
Work Schedule - Start:	01/01/2020				
Work Schedule - End:	01/01/2021				
<p><i>*For temporary cranes-Does the permanent structure require separate notice to the FAA? To find out, use the Notice Criteria Tool. If separate notice is required, please ensure it is filed. If it is not filed, please state the reason in the Description of Proposal.</i></p> <p>State Filing:</p>					
Structure Details					
Latitude:	36° 58' 25.01" N				
Longitude:	97° 6' 18.83" W				
Horizontal Datum:	NAD83				
Site Elevation (SE):	1181 (nearest foot) PASSED				
Structure Height (AGL):	599 (nearest foot)				
Current Height (AGL):	(nearest foot)				
<p><i>* For notice of alteration or existing provide the current AGL height of the existing structure. Include details in the Description of Proposal</i></p>					
Minimum Operating Height (AGL):	(nearest foot)				
<p><i>* For aeronautical study of a crane or construction equipment the maximum height should be listed above as the Structure Height (AGL). Additionally, provide the minimum operating height to avoid delays if impacts are identified that require negotiation to a reduced height. If the Structure Height and minimum operating height are the same enter the same value in both fields.</i></p>					
Requested Marking/Lighting:	Red lights and paint				
Recommended Marking/Lighting:	White Paint/Synchronized Red Lights				
Current Marking/Lighting:	N/A Proposed Structure				
Other :	<input type="text"/>				
Nearest City:	New Kirk				
Nearest State:	Oklahoma				
Description of Location:	14 Miles North of New Kirk				
Description of Proposal:	80 WTG Project for electric production				
Structure Summary					
Structure Type:	Wind Turbine *legacy*				
Structure Type:	<input type="text" value="WIND_TURBINE"/> Wind Turbine				
Structure Name:	9				
FDC NOTAM:					
NOTAM Number:					
FCC Number:					
Prior ASN:					
Proposed Frequency Bands					
	Low Freq	High Freq	Freq Unit	ERP	ERP Unit





Notice of Proposed Construction or Alteration - Off Airport

[Add a New Case \(Off Airport\) - Desk Reference Guide V_2018.2.1](#)

[Add a New Case \(Off Airport\) for Wind Turbines - Met Towers \(with WT Farm\) - WT-Barge Crane - Desk Reference Guide V_2018.2.1](#)

Project Name: PNEWI-000610354-19

Sponsor: PNE USA

Details for Case : 10

[Show Project Summary](#)

Case Status	
ASN:	2019-WTW-4412-OE
Status:	Determined
7460-2 Forms:	<p>01/13/2021</p> <p>7460-2 (PART 1) required at least 10 days prior to start of construction.</p> <p>Add Supplemental Notice (7460-2)</p>
Public Comments:	None
Date Accepted:	04/22/2019
Date Determined:	08/18/2019
Letters:	<p>03/24/2021 EXT</p> <p>08/18/2019 DNH</p> <p>06/24/2019 NPH</p>
Documents:	<p>None</p> <p>Project Documents:</p> <p>04/22/2019 Chilocco - FAA Fi...</p> <p>04/22/2019 Chilocco - FAA F...</p> <p>04/18/2019 Chilocco - FAA Fi...</p>

Construction / Alteration Information	
Notice Of:	
Duration:	Permanent
if Temporary :	Months: Days:
Work Schedule - Start:	01/01/2020
Work Schedule - End:	01/01/2021
<p><i>*For temporary cranes-Does the permanent structure require separate notice to the FAA? To find out, use the Notice Criteria Tool. If separate notice is required, please ensure it is filed. If it is not filed, please state the reason in the Description of Proposal.</i></p> <p>State Filing:</p>	

Structure Summary	
Structure Type:	Wind Turbine *legacy*
Structure Type:	<input type="text" value="WIND_TURBINE"/> Wind Turbine
Structure Name:	10
FDC NOTAM:	
NOTAM Number:	
FCC Number:	
Prior ASN:	

Structure Details	
Latitude:	36° 59' 16.42" N
Longitude:	97° 6' 13.67" W
Horizontal Datum:	NAD83
Site Elevation (SE):	1182 (nearest foot) PASSED
Structure Height (AGL):	599 (nearest foot)
Current Height (AGL):	(nearest foot)
<p><i>* For notice of alteration or existing provide the current AGL height of the existing structure. Include details in the Description of Proposal</i></p>	
Minimum Operating Height (AGL):	(nearest foot)
<p><i>* For aeronautical study of a crane or construction equipment the maximum height should be listed above as the Structure Height (AGL). Additionally, provide the minimum operating height to avoid delays if impacts are identified that require negotiation to a reduced height. If the Structure Height and minimum operating height are the same enter the same value in both fields.</i></p>	
Requested Marking/Lighting:	Red lights and paint
Recommended Marking/Lighting:	White Paint/Synchronized Red Lights
Current Marking/Lighting:	N/A Proposed Structure
Other :	<input type="text"/>
Nearest City:	New Kirk
Nearest State:	Oklahoma
Description of Location:	14 Miles North of New Kirk
Description of Proposal:	80 WTG Project for electric production

Proposed Frequency Bands				
Low Freq	High Freq	Freq Unit	ERP	ERP Unit





Notice of Proposed Construction or Alteration - Off Airport

[Add a New Case \(Off Airport\) - Desk Reference Guide V_2018.2.1](#)

[Add a New Case \(Off Airport\) for Wind Turbines - Met Towers \(with WT Farm\) - WT-Barge Crane - Desk Reference Guide V_2018.2.1](#)

Project Name: PNEWI-000610354-19

Sponsor: PNE USA

Details for Case : 11

[Show Project Summary](#)

Case Status	
ASN:	2019-WTW-4413-OE
Status:	Determined
7460-2 Forms:	<p>01/13/2021</p> <p>7460-2 (PART 1) required at least 10 days prior to start of construction.</p> <p>Add Supplemental Notice (7460-2)</p>
Public Comments:	None
Date Accepted:	04/22/2019
Date Determined:	08/18/2019
Letters:	<p>03/24/2021 EXT</p> <p>08/18/2019 DNH</p> <p>06/24/2019 NPH</p>
Documents:	<p>None</p> <p>Project Documents:</p> <p>04/22/2019 Chilocco - FAA Fi...</p> <p>04/22/2019 Chilocco - FAA F...</p> <p>04/18/2019 Chilocco - FAA Fi...</p>

Construction / Alteration Information	
Notice Of:	
Duration:	Permanent
if Temporary :	Months: Days:
Work Schedule - Start:	01/01/2020
Work Schedule - End:	01/01/2021
<p><i>*For temporary cranes-Does the permanent structure require separate notice to the FAA? To find out, use the Notice Criteria Tool. If separate notice is required, please ensure it is filed. If it is not filed, please state the reason in the Description of Proposal.</i></p> <p>State Filing:</p>	

Structure Summary	
Structure Type:	Wind Turbine *legacy*
Structure Type:	<input type="text" value="WIND_TURBINE"/> Wind Turbine
Structure Name:	11
FDC NOTAM:	
NOTAM Number:	
FCC Number:	
Prior ASN:	

Structure Details	
Latitude:	36° 57' 41.39" N
Longitude:	97° 6' 15.62" W
Horizontal Datum:	NAD83
Site Elevation (SE):	1177 (nearest foot) PASSED
Structure Height (AGL):	599 (nearest foot)
Current Height (AGL):	(nearest foot)
<p><i>* For notice of alteration or existing provide the current AGL height of the existing structure. Include details in the Description of Proposal</i></p>	
Minimum Operating Height (AGL):	(nearest foot)
<p><i>* For aeronautical study of a crane or construction equipment the maximum height should be listed above as the Structure Height (AGL). Additionally, provide the minimum operating height to avoid delays if impacts are identified that require negotiation to a reduced height. If the Structure Height and minimum operating height are the same enter the same value in both fields.</i></p>	
Requested Marking/Lighting:	Red lights and paint
Recommended Marking/Lighting:	White Paint/Synchronized Red Lights
Current Marking/Lighting:	N/A Proposed Structure
Other :	<input type="text"/>
Nearest City:	New Kirk
Nearest State:	Oklahoma
Description of Location:	14 Miles North of New Kirk
Description of Proposal:	80 WTG Project for electric production

Proposed Frequency Bands				
Low Freq	High Freq	Freq Unit	ERP	ERP Unit





Notice of Proposed Construction or Alteration - Off Airport

[Add a New Case \(Off Airport\) - Desk Reference Guide V_2018.2.1](#)

[Add a New Case \(Off Airport\) for Wind Turbines - Met Towers \(with WT Farm\) - WT-Barge Crane - Desk Reference Guide V_2018.2.1](#)

Project Name: PNEWI-000610354-19

Sponsor: PNE USA

Details for Case : 12

[Show Project Summary](#)

Case Status											
ASN:	2019-WTW-4414-OE										
Status:	Determined										
7460-2 Forms:	<p>01/13/2021</p> <p>7460-2 (PART 1) required at least 10 days prior to start of construction.</p> <p>Add Supplemental Notice (7460-2)</p>										
Public Comments:	None										
Date Accepted:	04/22/2019										
Date Determined:	08/18/2019										
Letters:	<p>03/24/2021 EXT</p> <p>08/18/2019 DNH</p> <p>06/24/2019 NPH</p>										
Documents:	<p>None</p> <p>Project Documents:</p> <p>04/22/2019 Chilocco - FAA Fi...</p> <p>04/22/2019 Chilocco - FAA F...</p> <p>04/18/2019 Chilocco - FAA Fi...</p>										
Construction / Alteration Information											
Notice Of:											
Duration:	Permanent										
if Temporary :	Months: Days:										
Work Schedule - Start:	01/01/2020										
Work Schedule - End:	01/01/2021										
<p><i>*For temporary cranes-Does the permanent structure require separate notice to the FAA? To find out, use the Notice Criteria Tool. If separate notice is required, please ensure it is filed. If it is not filed, please state the reason in the Description of Proposal.</i></p> <p>State Filing:</p>											
Structure Details											
Latitude:	36° 58' 19.36" N										
Longitude:	97° 5' 58.27" W										
Horizontal Datum:	NAD83										
Site Elevation (SE):	1173 (nearest foot) PASSED										
Structure Height (AGL):	599 (nearest foot)										
Current Height (AGL):	(nearest foot)										
<p><i>* For notice of alteration or existing provide the current AGL height of the existing structure. Include details in the Description of Proposal</i></p>											
Minimum Operating Height (AGL):	(nearest foot)										
<p><i>* For aeronautical study of a crane or construction equipment the maximum height should be listed above as the Structure Height (AGL). Additionally, provide the minimum operating height to avoid delays if impacts are identified that require negotiation to a reduced height. If the Structure Height and minimum operating height are the same enter the same value in both fields.</i></p>											
Requested Marking/Lighting:	Red lights and paint										
Recommended Marking/Lighting:	White Paint/Synchronized Red Lights										
Current Marking/Lighting:	N/A Proposed Structure										
Other :	<input type="text"/>										
Nearest City:	New Kirk										
Nearest State:	Oklahoma										
Description of Location:	14 Miles North of New Kirk										
Description of Proposal:	80 WTG Project for electric production										
Structure Summary											
Structure Type:	Wind Turbine *legacy*										
Structure Type:	<input type="text" value="WIND_TURBINE"/> Wind Turbine										
Structure Name:	12										
FDC NOTAM:											
NOTAM Number:											
FCC Number:											
Prior ASN:											
Proposed Frequency Bands											
	<table border="1"> <thead> <tr> <th>Low Freq</th> <th>High Freq</th> <th>Freq Unit</th> <th>ERP</th> <th>ERP Unit</th> </tr> </thead> <tbody> <tr> <td></td> <td></td> <td></td> <td></td> <td></td> </tr> </tbody> </table>	Low Freq	High Freq	Freq Unit	ERP	ERP Unit					
Low Freq	High Freq	Freq Unit	ERP	ERP Unit							





Notice of Proposed Construction or Alteration - Off Airport

[Add a New Case \(Off Airport\) - Desk Reference Guide V_2018.2.1](#)

[Add a New Case \(Off Airport\) for Wind Turbines - Met Towers \(with WT Farm\) - WT-Barge Crane - Desk Reference Guide V_2018.2.1](#)

Project Name: PNEWI-000610354-19

Sponsor: PNE USA

Details for Case : 13

[Show Project Summary](#)

Case Status	
ASN:	2019-WTW-4415-OE
Status:	Determined
7460-2 Forms:	<p>01/13/2021</p> <p>7460-2 (PART 1) required at least 10 days prior to start of construction.</p> <p>Add Supplemental Notice (7460-2)</p>
Public Comments:	None
Date Accepted:	04/22/2019
Date Determined:	08/18/2019
Letters:	<p>03/24/2021 EXT</p> <p>08/18/2019 DNH</p> <p>06/24/2019 NPH</p>
Documents:	<p>None</p> <p>Project Documents:</p> <p>04/22/2019 Chilocco - FAA Fi...</p> <p>04/22/2019 Chilocco - FAA F...</p> <p>04/18/2019 Chilocco - FAA Fi...</p>

Construction / Alteration Information	
Notice Of:	
Duration:	Permanent
if Temporary :	Months: Days:
Work Schedule - Start:	01/01/2020
Work Schedule - End:	01/01/2021
<p><i>*For temporary cranes-Does the permanent structure require separate notice to the FAA? To find out, use the Notice Criteria Tool. If separate notice is required, please ensure it is filed. If it is not filed, please state the reason in the Description of Proposal.</i></p> <p>State Filing:</p>	

Structure Summary	
Structure Type:	Wind Turbine *legacy*
Structure Type:	<input type="text" value="WIND_TURBINE"/> Wind Turbine
Structure Name:	13
FDC NOTAM:	
NOTAM Number:	
FCC Number:	
Prior ASN:	

Structure Details	
Latitude:	36° 59' 24.83" N
Longitude:	97° 6' 1.41" W
Horizontal Datum:	NAD83
Site Elevation (SE):	1173 (nearest foot) PASSED
Structure Height (AGL):	599 (nearest foot)
Current Height (AGL):	(nearest foot)
<p><i>* For notice of alteration or existing provide the current AGL height of the existing structure. Include details in the Description of Proposal</i></p>	
Minimum Operating Height (AGL):	(nearest foot)
<p><i>* For aeronautical study of a crane or construction equipment the maximum height should be listed above as the Structure Height (AGL). Additionally, provide the minimum operating height to avoid delays if impacts are identified that require negotiation to a reduced height. If the Structure Height and minimum operating height are the same enter the same value in both fields.</i></p>	
Requested Marking/Lighting:	Red lights and paint
Recommended Marking/Lighting:	White Paint/Synchronized Red Lights
Current Marking/Lighting:	N/A Proposed Structure
Other :	<input type="text"/>
Nearest City:	New Kirk
Nearest State:	Oklahoma
Description of Location:	14 Miles North of New Kirk
Description of Proposal:	80 WTG Project for electric production

Proposed Frequency Bands				
Low Freq	High Freq	Freq Unit	ERP	ERP Unit





Notice of Proposed Construction or Alteration - Off Airport

[Add a New Case \(Off Airport\) - Desk Reference Guide V_2018.2.1](#)

[Add a New Case \(Off Airport\) for Wind Turbines - Met Towers \(with WT Farm\) - WT-Barge Crane - Desk Reference Guide V_2018.2.1](#)

Project Name: PNEWI-000610354-19

Sponsor: PNE USA

Details for Case : 14

[Show Project Summary](#)

Case Status	
ASN:	2019-WTW-4416-OE
Status:	Determined
7460-2 Forms:	<p>01/13/2021</p> <p>7460-2 (PART 1) required at least 10 days prior to start of construction.</p> <p>Add Supplemental Notice (7460-2)</p>
Public Comments:	None
Date Accepted:	04/22/2019
Date Determined:	08/18/2019
Letters:	<p>03/24/2021 EXT</p> <p>08/18/2019 DNH</p> <p>06/24/2019 NPH</p>
Documents:	<p>None</p> <p>Project Documents:</p> <p>04/22/2019 Chilocco - FAA Fi...</p> <p>04/22/2019 Chilocco - FAA F...</p> <p>04/18/2019 Chilocco - FAA Fi...</p>

Construction / Alteration Information	
Notice Of:	
Duration:	Permanent
if Temporary :	Months: Days:
Work Schedule - Start:	01/01/2020
Work Schedule - End:	01/01/2021
<p><i>*For temporary cranes-Does the permanent structure require separate notice to the FAA? To find out, use the Notice Criteria Tool. If separate notice is required, please ensure it is filed. If it is not filed, please state the reason in the Description of Proposal.</i></p> <p>State Filing:</p>	

Structure Summary	
Structure Type:	Wind Turbine *legacy*
Structure Type:	<input type="text" value="WIND_TURBINE"/> Wind Turbine
Structure Name:	14
FDC NOTAM:	
NOTAM Number:	
FCC Number:	
Prior ASN:	

Structure Details	
Latitude:	36° 59' 1.72" N
Longitude:	97° 6' 1.21" W
Horizontal Datum:	NAD83
Site Elevation (SE):	1182 (nearest foot) PASSED
Structure Height (AGL):	599 (nearest foot)
Current Height (AGL):	(nearest foot)
<p><i>* For notice of alteration or existing provide the current AGL height of the existing structure. Include details in the Description of Proposal</i></p>	
Minimum Operating Height (AGL):	(nearest foot)
<p><i>* For aeronautical study of a crane or construction equipment the maximum height should be listed above as the Structure Height (AGL). Additionally, provide the minimum operating height to avoid delays if impacts are identified that require negotiation to a reduced height. If the Structure Height and minimum operating height are the same enter the same value in both fields.</i></p>	
Requested Marking/Lighting:	Red lights and paint
Recommended Marking/Lighting:	White Paint/Synchronized Red Lights
Current Marking/Lighting:	N/A Proposed Structure
Other :	<input type="text"/>
Nearest City:	New Kirk
Nearest State:	Oklahoma
Description of Location:	14 Miles North of New Kirk
Description of Proposal:	80 WTG Project for electric production

Proposed Frequency Bands				
Low Freq	High Freq	Freq Unit	ERP	ERP Unit





Notice of Proposed Construction or Alteration - Off Airport

[Add a New Case \(Off Airport\) - Desk Reference Guide V_2018.2.1](#)

[Add a New Case \(Off Airport\) for Wind Turbines - Met Towers \(with WT Farm\) - WT-Barge Crane - Desk Reference Guide V_2018.2.1](#)

Project Name: PNEWI-000610354-19

Sponsor: PNE USA

Details for Case : 15

[Show Project Summary](#)

Case Status	
ASN:	2019-WTW-4417-OE
Status:	Determined
7460-2 Forms:	<p>01/13/2021</p> <p>7460-2 (PART 1) required at least 10 days prior to start of construction.</p> <p>Add Supplemental Notice (7460-2)</p>
Public Comments:	None
Date Accepted:	04/22/2019
Date Determined:	08/18/2019
Letters:	<p>03/24/2021 EXT</p> <p>08/18/2019 DNH</p> <p>06/24/2019 NPH</p>
Documents:	<p>None</p> <p>Project Documents:</p> <p>04/22/2019 Chilocco - FAA Fi...</p> <p>04/22/2019 Chilocco - FAA F...</p> <p>04/18/2019 Chilocco - FAA Fi...</p>

Construction / Alteration Information	
Notice Of:	
Duration:	Permanent
if Temporary :	Months: Days:
Work Schedule - Start:	01/01/2020
Work Schedule - End:	01/01/2021
<p><i>*For temporary cranes-Does the permanent structure require separate notice to the FAA? To find out, use the Notice Criteria Tool. If separate notice is required, please ensure it is filed. If it is not filed, please state the reason in the Description of Proposal.</i></p> <p>State Filing:</p>	

Structure Summary	
Structure Type:	Wind Turbine *legacy*
Structure Type:	<input type="text" value="WIND_TURBINE"/> Wind Turbine
Structure Name:	15
FDC NOTAM:	
NOTAM Number:	
FCC Number:	
Prior ASN:	

Structure Details	
Latitude:	36° 57' 46.04" N
Longitude:	97° 6' 0.22" W
Horizontal Datum:	NAD83
Site Elevation (SE):	1172 (nearest foot) PASSED
Structure Height (AGL):	599 (nearest foot)
Current Height (AGL):	(nearest foot)
<p><i>* For notice of alteration or existing provide the current AGL height of the existing structure. Include details in the Description of Proposal</i></p>	
Minimum Operating Height (AGL):	(nearest foot)
<p><i>* For aeronautical study of a crane or construction equipment the maximum height should be listed above as the Structure Height (AGL). Additionally, provide the minimum operating height to avoid delays if impacts are identified that require negotiation to a reduced height. If the Structure Height and minimum operating height are the same enter the same value in both fields.</i></p>	
Requested Marking/Lighting:	Red lights and paint
Recommended Marking/Lighting:	White Paint/Synchronized Red Lights
Current Marking/Lighting:	N/A Proposed Structure
Other :	<input type="text"/>
Nearest City:	New Kirk
Nearest State:	Oklahoma
Description of Location:	14 Miles North of New Kirk
Description of Proposal:	80 WTG Project for electric production

Proposed Frequency Bands				
Low Freq	High Freq	Freq Unit	ERP	ERP Unit





Notice of Proposed Construction or Alteration - Off Airport

[Add a New Case \(Off Airport\) - Desk Reference Guide V_2018.2.1](#)

[Add a New Case \(Off Airport\) for Wind Turbines - Met Towers \(with WT Farm\) - WT-Barge Crane - Desk Reference Guide V_2018.2.1](#)

Project Name: PNEWI-000610354-19

Sponsor: PNE USA

Details for Case : 16

[Show Project Summary](#)

Case Status	
ASN:	2019-WTW-4418-OE
Status:	Determined
7460-2 Forms:	<p>01/13/2021</p> <p>7460-2 (PART 1) required at least 10 days prior to start of construction.</p> <p>Add Supplemental Notice (7460-2)</p>
Public Comments:	None
Date Accepted:	04/22/2019
Date Determined:	08/18/2019
Letters:	<p>03/24/2021 EXT</p> <p>08/18/2019 DNH</p> <p>06/24/2019 NPH</p>
Documents:	<p>None</p> <p>Project Documents:</p> <p>04/22/2019 Chilocco - FAA Fi...</p> <p>04/22/2019 Chilocco - FAA F...</p> <p>04/18/2019 Chilocco - FAA Fi...</p>

Construction / Alteration Information	
Notice Of:	
Duration:	Permanent
if Temporary :	Months: Days:
Work Schedule - Start:	01/01/2020
Work Schedule - End:	01/01/2021
<p><i>*For temporary cranes-Does the permanent structure require separate notice to the FAA? To find out, use the Notice Criteria Tool. If separate notice is required, please ensure it is filed. If it is not filed, please state the reason in the Description of Proposal.</i></p> <p>State Filing:</p>	

Structure Summary	
Structure Type:	Wind Turbine *legacy*
Structure Type:	<input type="text" value="WIND_TURBINE"/> Wind Turbine
Structure Name:	16
FDC NOTAM:	
NOTAM Number:	
FCC Number:	
Prior ASN:	

Structure Details	
Latitude:	36° 59' 41.70" N
Longitude:	97° 5' 55.28" W
Horizontal Datum:	NAD83
Site Elevation (SE):	1188 (nearest foot) PASSED
Structure Height (AGL):	599 (nearest foot)
Current Height (AGL):	(nearest foot)
<p><i>* For notice of alteration or existing provide the current AGL height of the existing structure. Include details in the Description of Proposal</i></p>	
Minimum Operating Height (AGL):	(nearest foot)
<p><i>* For aeronautical study of a crane or construction equipment the maximum height should be listed above as the Structure Height (AGL). Additionally, provide the minimum operating height to avoid delays if impacts are identified that require negotiation to a reduced height. If the Structure Height and minimum operating height are the same enter the same value in both fields.</i></p>	
Requested Marking/Lighting:	Red lights and paint
Recommended Marking/Lighting:	White Paint/Synchronized Red Lights
Current Marking/Lighting:	N/A Proposed Structure
Other :	<input type="text"/>
Nearest City:	New Kirk
Nearest State:	Oklahoma
Description of Location:	14 Miles North of New Kirk
Description of Proposal:	80 WTG Project for electric production

Proposed Frequency Bands				
Low Freq	High Freq	Freq Unit	ERP	ERP Unit





Notice of Proposed Construction or Alteration - Off Airport

[Add a New Case \(Off Airport\) - Desk Reference Guide V_2018.2.1](#)

[Add a New Case \(Off Airport\) for Wind Turbines - Met Towers \(with WT Farm\) - WT-Barge Crane - Desk Reference Guide V_2018.2.1](#)

Project Name: PNEWI-000610354-19

Sponsor: PNE USA

Details for Case : 17

[Show Project Summary](#)

Case Status	
ASN:	2019-WTW-4419-OE
Status:	Determined
7460-2 Forms:	<p>01/13/2021</p> <p>7460-2 (PART 1) required at least 10 days prior to start of construction.</p> <p>Add Supplemental Notice (7460-2)</p>
Public Comments:	None
Date Accepted:	04/22/2019
Date Determined:	08/18/2019
Letters:	<p>03/24/2021 EXT</p> <p>08/18/2019 DNH</p> <p>06/24/2019 NPH</p>
Documents:	<p>None</p> <p>Project Documents:</p> <p>04/22/2019 Chilocco - FAA Fi...</p> <p>04/22/2019 Chilocco - FAA F...</p> <p>04/18/2019 Chilocco - FAA Fi...</p>

Construction / Alteration Information	
Notice Of:	
Duration:	Permanent
if Temporary :	Months: Days:
Work Schedule - Start:	01/01/2020
Work Schedule - End:	01/01/2021
<p><i>*For temporary cranes-Does the permanent structure require separate notice to the FAA? To find out, use the Notice Criteria Tool. If separate notice is required, please ensure it is filed. If it is not filed, please state the reason in the Description of Proposal.</i></p> <p>State Filing:</p>	

Structure Summary	
Structure Type:	Wind Turbine *legacy*
Structure Type:	<input type="text" value="WIND_TURBINE"/> Wind Turbine
Structure Name:	17
FDC NOTAM:	
NOTAM Number:	
FCC Number:	
Prior ASN:	

Structure Details	
Latitude:	36° 57' 28.83" N
Longitude:	97° 5' 53.46" W
Horizontal Datum:	NAD83
Site Elevation (SE):	1185 (nearest foot) PASSED
Structure Height (AGL):	599 (nearest foot)
Current Height (AGL):	(nearest foot)
<p><i>* For notice of alteration or existing provide the current AGL height of the existing structure. Include details in the Description of Proposal</i></p>	
Minimum Operating Height (AGL):	(nearest foot)
<p><i>* For aeronautical study of a crane or construction equipment the maximum height should be listed above as the Structure Height (AGL). Additionally, provide the minimum operating height to avoid delays if impacts are identified that require negotiation to a reduced height. If the Structure Height and minimum operating height are the same enter the same value in both fields.</i></p>	
Requested Marking/Lighting:	Red lights and paint
Recommended Marking/Lighting:	White Paint/Synchronized Red Lights
Current Marking/Lighting:	N/A Proposed Structure
Other :	<input type="text"/>
Nearest City:	New Kirk
Nearest State:	Oklahoma
Description of Location:	14 Miles North of New Kirk
Description of Proposal:	80 WTG Project for electric production

Proposed Frequency Bands				
Low Freq	High Freq	Freq Unit	ERP	ERP Unit





Notice of Proposed Construction or Alteration - Off Airport

[Add a New Case \(Off Airport\) - Desk Reference Guide V_2018.2.1](#)

[Add a New Case \(Off Airport\) for Wind Turbines - Met Towers \(with WT Farm\) - WT-Barge Crane - Desk Reference Guide V_2018.2.1](#)

Project Name: PNEWI-000610354-19

Sponsor: PNE USA

Details for Case : 18

[Show Project Summary](#)

Case Status	
ASN:	2019-WTW-4420-OE
Status:	Determined
7460-2 Forms:	<p>01/13/2021</p> <p>7460-2 (PART 1) required at least 10 days prior to start of construction.</p> <p>Add Supplemental Notice (7460-2)</p>
Public Comments:	None
Date Accepted:	04/22/2019
Date Determined:	08/18/2019
Letters:	<p>03/24/2021 EXT</p> <p>08/18/2019 DNH</p> <p>06/24/2019 NPH</p>
Documents:	<p>None</p> <p>Project Documents:</p> <p>04/22/2019 Chilocco - FAA Fi...</p> <p>04/22/2019 Chilocco - FAA F...</p> <p>04/18/2019 Chilocco - FAA Fi...</p>

Construction / Alteration Information	
Notice Of:	
Duration:	Permanent
if Temporary :	Months: Days:
Work Schedule - Start:	01/01/2020
Work Schedule - End:	01/01/2021
<p><i>*For temporary cranes-Does the permanent structure require separate notice to the FAA? To find out, use the Notice Criteria Tool. If separate notice is required, please ensure it is filed. If it is not filed, please state the reason in the Description of Proposal.</i></p> <p>State Filing:</p>	

Structure Summary	
Structure Type:	Wind Turbine *legacy*
Structure Type:	<input type="text" value="WIND_TURBINE"/> Wind Turbine
Structure Name:	18
FDC NOTAM:	
NOTAM Number:	
FCC Number:	
Prior ASN:	

Structure Details	
Latitude:	36° 59' 11.82" N
Longitude:	97° 5' 49.72" W
Horizontal Datum:	NAD83
Site Elevation (SE):	1173 (nearest foot) PASSED
Structure Height (AGL):	599 (nearest foot)
Current Height (AGL):	(nearest foot)
<p><i>* For notice of alteration or existing provide the current AGL height of the existing structure. Include details in the Description of Proposal</i></p>	
Minimum Operating Height (AGL):	(nearest foot)
<p><i>* For aeronautical study of a crane or construction equipment the maximum height should be listed above as the Structure Height (AGL). Additionally, provide the minimum operating height to avoid delays if impacts are identified that require negotiation to a reduced height. If the Structure Height and minimum operating height are the same enter the same value in both fields.</i></p>	
Requested Marking/Lighting:	Red lights and paint
Recommended Marking/Lighting:	White Paint/Synchronized Red Lights
Current Marking/Lighting:	N/A Proposed Structure
Other :	<input type="text"/>
Nearest City:	New Kirk
Nearest State:	Oklahoma
Description of Location:	14 Miles North of New Kirk
Description of Proposal:	80 WTG Project for electric production

Proposed Frequency Bands				
Low Freq	High Freq	Freq Unit	ERP	ERP Unit





Notice of Proposed Construction or Alteration - Off Airport

[Add a New Case \(Off Airport\) - Desk Reference Guide V_2018.2.1](#)

[Add a New Case \(Off Airport\) for Wind Turbines - Met Towers \(with WT Farm\) - WT-Barge Crane - Desk Reference Guide V_2018.2.1](#)

Project Name: PNEWI-000610354-19

Sponsor: PNE USA

Details for Case : 19

[Show Project Summary](#)

Case Status					
ASN:	2019-WTW-4421-OE				
Status:	Determined				
7460-2 Forms:	<p>01/13/2021</p> <p>7460-2 (PART 1) required at least 10 days prior to start of construction.</p> <p>Add Supplemental Notice (7460-2)</p>				
Public Comments:	None				
Date Accepted:	04/22/2019				
Date Determined:	08/18/2019				
Letters:	<p>03/24/2021 EXT</p> <p>08/18/2019 DNH</p> <p>06/24/2019 NPH</p>				
Documents:	<p>None</p> <p>Project Documents:</p> <p>04/22/2019 Chilocco - FAA Fi...</p> <p>04/22/2019 Chilocco - FAA F...</p> <p>04/18/2019 Chilocco - FAA Fi...</p>				
Construction / Alteration Information					
Notice Of:					
Duration:	Permanent				
if Temporary :	Months: Days:				
Work Schedule - Start:	01/01/2020				
Work Schedule - End:	01/01/2021				
<p><i>*For temporary cranes-Does the permanent structure require separate notice to the FAA? To find out, use the Notice Criteria Tool. If separate notice is required, please ensure it is filed. If it is not filed, please state the reason in the Description of Proposal.</i></p> <p>State Filing:</p>					
Structure Details					
Latitude:	36° 58' 18.63" N				
Longitude:	97° 5' 45.12" W				
Horizontal Datum:	NAD83				
Site Elevation (SE):	1188 (nearest foot) PASSED				
Structure Height (AGL):	599 (nearest foot)				
Current Height (AGL):	(nearest foot)				
<p><i>* For notice of alteration or existing provide the current AGL height of the existing structure. Include details in the Description of Proposal</i></p>					
Minimum Operating Height (AGL):	(nearest foot)				
<p><i>* For aeronautical study of a crane or construction equipment the maximum height should be listed above as the Structure Height (AGL). Additionally, provide the minimum operating height to avoid delays if impacts are identified that require negotiation to a reduced height. If the Structure Height and minimum operating height are the same enter the same value in both fields.</i></p>					
Requested Marking/Lighting:	Red lights and paint				
Recommended Marking/Lighting:	White Paint/Synchronized Red Lights				
Current Marking/Lighting:	N/A Proposed Structure				
Other :	<input type="text"/>				
Nearest City:	New Kirk				
Nearest State:	Oklahoma				
Description of Location:	14 Miles North of New Kirk				
Description of Proposal:	80 WTG Project for electric production				
Structure Summary					
Structure Type:	Wind Turbine *legacy*				
Structure Type:	<input type="text" value="WIND_TURBINE"/> Wind Turbine				
Structure Name:	19				
FDC NOTAM:					
NOTAM Number:					
FCC Number:					
Prior ASN:					
Proposed Frequency Bands					
	Low Freq	High Freq	Freq Unit	ERP	ERP Unit





Notice of Proposed Construction or Alteration - Off Airport

[Add a New Case \(Off Airport\) - Desk Reference Guide V_2018.2.1](#)

[Add a New Case \(Off Airport\) for Wind Turbines - Met Towers \(with WT Farm\) - WT-Barge Crane - Desk Reference Guide V_2018.2.1](#)

Project Name: PNEWI-000610354-19

Sponsor: PNE USA

Details for Case : 20

[Show Project Summary](#)

Case Status	
ASN:	2019-WTW-4422-OE
Status:	Determined
7460-2 Forms:	01/13/2021 7460-2 (PART 1) required at least 10 days prior to start of construction. Add Supplemental Notice (7460-2)
Public Comments:	None
Date Accepted:	04/22/2019
Date Determined:	08/18/2019
Letters:	03/24/2021 EXT 08/18/2019 DNH 06/24/2019 NPH
Documents:	None Project Documents: 04/22/2019 Chilocco - FAA Fi... 04/22/2019 Chilocco - FAA F.. 04/18/2019 Chilocco - FAA Fi...

Construction / Alteration Information	
Notice Of:	
Duration:	Permanent
if Temporary :	Months: Days:
Work Schedule - Start:	01/01/2020
Work Schedule - End:	01/01/2021
*For temporary cranes-Does the permanent structure require separate notice to the FAA? To find out, use the Notice Criteria Tool. If separate notice is required, please ensure it is filed. If it is not filed, please state the reason in the Description of Proposal.	
State Filing:	

Structure Summary	
Structure Type:	Wind Turbine *legacy*
Structure Type:	<input type="text" value="WIND_TURBINE"/> Wind Turbine
Structure Name:	20
FDC NOTAM:	
NOTAM Number:	
FCC Number:	
Prior ASN:	

Structure Details	
Latitude:	36° 57' 42.06" N
Longitude:	97° 5' 44.96" W
Horizontal Datum:	NAD83
Site Elevation (SE):	1180 (nearest foot) PASSED
Structure Height (AGL):	599 (nearest foot)
Current Height (AGL):	(nearest foot)
* For notice of alteration or existing provide the current AGL height of the existing structure. Include details in the Description of Proposal	
Minimum Operating Height (AGL):	(nearest foot)
* For aeronautical study of a crane or construction equipment the maximum height should be listed above as the Structure Height (AGL). Additionally, provide the minimum operating height to avoid delays if impacts are identified that require negotiation to a reduced height. If the Structure Height and minimum operating height are the same enter the same value in both fields.	
Requested Marking/Lighting:	Red lights and paint
Recommended Marking/Lighting:	White Paint/Synchronized Red Lights
Current Marking/Lighting:	N/A Proposed Structure
Other :	<input type="text"/>
Nearest City:	New Kirk
Nearest State:	Oklahoma
Description of Location:	14 Miles North of New Kirk
Description of Proposal:	80 WTG Project for electric production

Proposed Frequency Bands				
Low Freq	High Freq	Freq Unit	ERP	ERP Unit





Notice of Proposed Construction or Alteration - Off Airport

[Add a New Case \(Off Airport\) - Desk Reference Guide V_2018.2.1](#)

[Add a New Case \(Off Airport\) for Wind Turbines - Met Towers \(with WT Farm\) - WT-Barge Crane - Desk Reference Guide V_2018.2.1](#)

Project Name: PNEWI-000610355-19

Sponsor: PNE USA

Details for Case : 21

[Show Project Summary](#)

Case Status											
ASN:	2019-WTW-4423-OE										
Status:	Determined										
7460-2 Forms:	<p>01/13/2021</p> <p>7460-2 (PART 1) required at least 10 days prior to start of construction.</p> <p>Add Supplemental Notice (7460-2)</p>										
Public Comments:	None										
Date Accepted:	04/22/2019										
Date Determined:	08/18/2019										
Letters:	<p>03/24/2021 EXT</p> <p>08/18/2019 DNH</p> <p>06/24/2019 NPH</p>										
Documents:	<p>None</p> <p>Project Documents:</p> <p>04/22/2019 Chilocco - FAA Fi...</p> <p>04/22/2019 Chilocco - FAA F...</p> <p>04/18/2019 Chilocco - FAA Fi...</p>										
Construction / Alteration Information											
Notice Of:											
Duration:	Permanent										
if Temporary :	Months: Days:										
Work Schedule - Start:	01/01/2020										
Work Schedule - End:	01/01/2021										
<p><i>*For temporary cranes-Does the permanent structure require separate notice to the FAA? To find out, use the Notice Criteria Tool. If separate notice is required, please ensure it is filed. If it is not filed, please state the reason in the Description of Proposal.</i></p> <p>State Filing:</p>											
Structure Details											
Latitude:	36° 59' 49.53" N										
Longitude:	97° 5' 41.70" W										
Horizontal Datum:	NAD83										
Site Elevation (SE):	1159 (nearest foot) PASSED										
Structure Height (AGL):	599 (nearest foot)										
Current Height (AGL):	(nearest foot)										
<p><i>* For notice of alteration or existing provide the current AGL height of the existing structure. Include details in the Description of Proposal</i></p>											
Minimum Operating Height (AGL):	(nearest foot)										
<p><i>* For aeronautical study of a crane or construction equipment the maximum height should be listed above as the Structure Height (AGL). Additionally, provide the minimum operating height to avoid delays if impacts are identified that require negotiation to a reduced height. If the Structure Height and minimum operating height are the same enter the same value in both fields.</i></p>											
Requested Marking/Lighting:	Red lights and paint										
Recommended Marking/Lighting:	White Paint/Synchronized Red Lights										
Current Marking/Lighting:	N/A Proposed Structure										
Other :	<input type="text"/>										
Nearest City:	New Kirk										
Nearest State:	Oklahoma										
Description of Location:	14 Miles North of New Kirk										
Description of Proposal:	80 WTG Project for electric production										
Structure Summary											
Structure Type:	Wind Turbine *legacy*										
Structure Type:	<input type="text" value="WIND_TURBINE"/> Wind Turbine										
Structure Name:	21										
FDC NOTAM:											
NOTAM Number:											
FCC Number:											
Prior ASN:											
Proposed Frequency Bands											
	<table border="1"> <thead> <tr> <th>Low Freq</th> <th>High Freq</th> <th>Freq Unit</th> <th>ERP</th> <th>ERP Unit</th> </tr> </thead> <tbody> <tr> <td></td> <td></td> <td></td> <td></td> <td></td> </tr> </tbody> </table>	Low Freq	High Freq	Freq Unit	ERP	ERP Unit					
Low Freq	High Freq	Freq Unit	ERP	ERP Unit							





Notice of Proposed Construction or Alteration - Off Airport

[Add a New Case \(Off Airport\) - Desk Reference Guide V_2018.2.1](#)

[Add a New Case \(Off Airport\) for Wind Turbines - Met Towers \(with WT Farm\) - WT-Barge Crane - Desk Reference Guide V_2018.2.1](#)

Project Name: PNEWI-000610355-19

Sponsor: PNE USA

Details for Case : 22

[Show Project Summary](#)

Case Status	
ASN:	2019-WTW-4424-OE
Status:	Determined
7460-2 Forms:	<p>01/13/2021</p> <p>7460-2 (PART 1) required at least 10 days prior to start of construction.</p> <p>Add Supplemental Notice (7460-2)</p>
Public Comments:	None
Date Accepted:	04/22/2019
Date Determined:	08/18/2019
Letters:	<p>03/24/2021 EXT</p> <p>08/18/2019 DNH</p> <p>06/24/2019 NPH</p>
Documents:	<p>None</p> <p>Project Documents:</p> <p>04/22/2019 Chilocco - FAA Fi...</p> <p>04/22/2019 Chilocco - FAA F...</p> <p>04/18/2019 Chilocco - FAA Fi...</p>

Construction / Alteration Information	
Notice Of:	
Duration:	Permanent
if Temporary :	Months: Days:
Work Schedule - Start:	01/01/2020
Work Schedule - End:	01/01/2021
<p><i>*For temporary cranes-Does the permanent structure require separate notice to the FAA? To find out, use the Notice Criteria Tool. If separate notice is required, please ensure it is filed. If it is not filed, please state the reason in the Description of Proposal.</i></p> <p>State Filing:</p>	

Structure Summary	
Structure Type:	Wind Turbine *legacy*
Structure Type:	<input type="text" value="WIND_TURBINE"/> Wind Turbine
Structure Name:	22
FDC NOTAM:	
NOTAM Number:	
FCC Number:	
Prior ASN:	

Structure Details	
Latitude:	36° 59' 29.77" N
Longitude:	97° 5' 41.59" W
Horizontal Datum:	NAD83
Site Elevation (SE):	1175 (nearest foot) PASSED
Structure Height (AGL):	599 (nearest foot)
Current Height (AGL):	(nearest foot)
<p><i>* For notice of alteration or existing provide the current AGL height of the existing structure. Include details in the Description of Proposal</i></p>	
Minimum Operating Height (AGL):	(nearest foot)
<p><i>* For aeronautical study of a crane or construction equipment the maximum height should be listed above as the Structure Height (AGL). Additionally, provide the minimum operating height to avoid delays if impacts are identified that require negotiation to a reduced height. If the Structure Height and minimum operating height are the same enter the same value in both fields.</i></p>	
Requested Marking/Lighting:	Red lights and paint
Recommended Marking/Lighting:	White Paint/Synchronized Red Lights
Current Marking/Lighting:	N/A Proposed Structure
Other :	<input type="text"/>
Nearest City:	New Kirk
Nearest State:	Oklahoma
Description of Location:	14 Miles North of New Kirk
Description of Proposal:	80 WTG Project for electric production

Proposed Frequency Bands				
Low Freq	High Freq	Freq Unit	ERP	ERP Unit





Notice of Proposed Construction or Alteration - Off Airport

[Add a New Case \(Off Airport\) - Desk Reference Guide V_2018.2.1](#)

[Add a New Case \(Off Airport\) for Wind Turbines - Met Towers \(with WT Farm\) - WT-Barge Crane - Desk Reference Guide V_2018.2.1](#)

Project Name: PNEWI-000610355-19

Sponsor: PNE USA

Details for Case : 23

[Show Project Summary](#)

Case Status	
ASN:	2019-WTW-4425-OE
Status:	Determined
7460-2 Forms:	<p>01/13/2021</p> <p>7460-2 (PART 1) required at least 10 days prior to start of construction.</p> <p>Add Supplemental Notice (7460-2)</p>
Public Comments:	None
Date Accepted:	04/22/2019
Date Determined:	08/18/2019
Letters:	<p>03/24/2021 EXT</p> <p>08/18/2019 DNH</p> <p>06/24/2019 NPH</p>
Documents:	<p>None</p> <p>Project Documents:</p> <p>04/22/2019 Chilocco - FAA Fi...</p> <p>04/22/2019 Chilocco - FAA F...</p> <p>04/18/2019 Chilocco - FAA Fi...</p>

Construction / Alteration Information	
Notice Of:	
Duration:	Permanent
if Temporary :	Months: Days:
Work Schedule - Start:	01/01/2020
Work Schedule - End:	01/01/2021
<p><i>*For temporary cranes-Does the permanent structure require separate notice to the FAA? To find out, use the Notice Criteria Tool. If separate notice is required, please ensure it is filed. If it is not filed, please state the reason in the Description of Proposal.</i></p> <p>State Filing:</p>	

Structure Summary	
Structure Type:	Wind Turbine *legacy*
Structure Type:	<input type="text" value="WIND_TURBINE"/> Wind Turbine
Structure Name:	23
FDC NOTAM:	
NOTAM Number:	
FCC Number:	
Prior ASN:	

Structure Details	
Latitude:	36° 58' 49.64" N
Longitude:	97° 5' 34.68" W
Horizontal Datum:	NAD83
Site Elevation (SE):	1168 (nearest foot) PASSED
Structure Height (AGL):	599 (nearest foot)
Current Height (AGL):	(nearest foot)
<p><i>* For notice of alteration or existing provide the current AGL height of the existing structure. Include details in the Description of Proposal</i></p>	
Minimum Operating Height (AGL):	(nearest foot)
<p><i>* For aeronautical study of a crane or construction equipment the maximum height should be listed above as the Structure Height (AGL). Additionally, provide the minimum operating height to avoid delays if impacts are identified that require negotiation to a reduced height. If the Structure Height and minimum operating height are the same enter the same value in both fields.</i></p>	
Requested Marking/Lighting:	Red lights and paint
Recommended Marking/Lighting:	White Paint/Synchronized Red Lights
Current Marking/Lighting:	N/A Proposed Structure
Other :	<input type="text"/>
Nearest City:	New Kirk
Nearest State:	Oklahoma
Description of Location:	14 Miles North of New Kirk
Description of Proposal:	80 WTG Project for electric production

Proposed Frequency Bands				
Low Freq	High Freq	Freq Unit	ERP	ERP Unit





Notice of Proposed Construction or Alteration - Off Airport

[Add a New Case \(Off Airport\) - Desk Reference Guide V_2018.2.1](#)

[Add a New Case \(Off Airport\) for Wind Turbines - Met Towers \(with WT Farm\) - WT-Barge Crane - Desk Reference Guide V_2018.2.1](#)

Project Name: PNEWI-000610355-19

Sponsor: PNE USA

Details for Case : 24

[Show Project Summary](#)

Case Status	
ASN:	2019-WTW-4426-OE
Status:	Determined
7460-2 Forms:	<p>01/13/2021</p> <p>7460-2 (PART 1) required at least 10 days prior to start of construction.</p> <p>Add Supplemental Notice (7460-2)</p>
Public Comments:	None
Date Accepted:	04/22/2019
Date Determined:	08/18/2019
Letters:	<p>03/24/2021 EXT</p> <p>08/18/2019 DNH</p> <p>06/24/2019 NPH</p>
Documents:	<p>None</p> <p>Project Documents:</p> <p>04/22/2019 Chilocco - FAA Fi...</p> <p>04/22/2019 Chilocco - FAA F...</p> <p>04/18/2019 Chilocco - FAA Fi...</p>

Construction / Alteration Information	
Notice Of:	
Duration:	Permanent
if Temporary :	Months: Days:
Work Schedule - Start:	01/01/2020
Work Schedule - End:	01/01/2021
<p><i>*For temporary cranes-Does the permanent structure require separate notice to the FAA? To find out, use the Notice Criteria Tool. If separate notice is required, please ensure it is filed. If it is not filed, please state the reason in the Description of Proposal.</i></p> <p>State Filing:</p>	

Structure Summary	
Structure Type:	Wind Turbine *legacy*
Structure Type:	<input type="text" value="WIND_TURBINE"/> Wind Turbine
Structure Name:	24
FDC NOTAM:	
NOTAM Number:	
FCC Number:	
Prior ASN:	

Structure Details	
Latitude:	36° 57' 57.88" N
Longitude:	97° 5' 37.65" W
Horizontal Datum:	NAD83
Site Elevation (SE):	1187 (nearest foot) PASSED
Structure Height (AGL):	599 (nearest foot)
Current Height (AGL):	(nearest foot)
<p><i>* For notice of alteration or existing provide the current AGL height of the existing structure. Include details in the Description of Proposal</i></p>	
Minimum Operating Height (AGL):	(nearest foot)
<p><i>* For aeronautical study of a crane or construction equipment the maximum height should be listed above as the Structure Height (AGL). Additionally, provide the minimum operating height to avoid delays if impacts are identified that require negotiation to a reduced height. If the Structure Height and minimum operating height are the same enter the same value in both fields.</i></p>	
Requested Marking/Lighting:	Red lights and paint
Recommended Marking/Lighting:	White Paint/Synchronized Red Lights
Current Marking/Lighting:	N/A Proposed Structure
Other :	<input type="text"/>
Nearest City:	New Kirk
Nearest State:	Oklahoma
Description of Location:	14 Miles North of New Kirk
Description of Proposal:	80 WTG Project for electric production

Proposed Frequency Bands				
Low Freq	High Freq	Freq Unit	ERP	ERP Unit





Notice of Proposed Construction or Alteration - Off Airport

[Add a New Case \(Off Airport\) - Desk Reference Guide V_2018.2.1](#)

[Add a New Case \(Off Airport\) for Wind Turbines - Met Towers \(with WT Farm\) - WT-Barge Crane - Desk Reference Guide V_2018.2.1](#)

Project Name: PNEWI-000610355-19

Sponsor: PNE USA

Details for Case : 25

[Show Project Summary](#)

Case Status											
ASN:	2019-WTW-4427-OE										
Status:	Determined										
7460-2 Forms:	<p>01/13/2021</p> <p>7460-2 (PART 1) required at least 10 days prior to start of construction.</p> <p>Add Supplemental Notice (7460-2)</p>										
Public Comments:	None										
Date Accepted:	04/22/2019										
Date Determined:	08/18/2019										
Letters:	<p>03/24/2021 EXT</p> <p>08/18/2019 DNH</p> <p>06/24/2019 NPH</p>										
Documents:	<p>None</p> <p>Project Documents:</p> <p>04/22/2019 Chilocco - FAA Fi...</p> <p>04/22/2019 Chilocco - FAA F...</p> <p>04/18/2019 Chilocco - FAA Fi...</p>										
Construction / Alteration Information											
Notice Of:											
Duration:	Permanent										
if Temporary :	Months: Days:										
Work Schedule - Start:	01/01/2020										
Work Schedule - End:	01/01/2021										
<p><i>*For temporary cranes-Does the permanent structure require separate notice to the FAA? To find out, use the Notice Criteria Tool. If separate notice is required, please ensure it is filed. If it is not filed, please state the reason in the Description of Proposal.</i></p> <p>State Filing:</p>											
Structure Details											
Latitude:	36° 59' 13.44" N										
Longitude:	97° 5' 37.59" W										
Horizontal Datum:	NAD83										
Site Elevation (SE):	1161 (nearest foot) PASSED										
Structure Height (AGL):	599 (nearest foot)										
Current Height (AGL):	(nearest foot)										
<p><i>* For notice of alteration or existing provide the current AGL height of the existing structure. Include details in the Description of Proposal</i></p>											
Minimum Operating Height (AGL):	(nearest foot)										
<p><i>* For aeronautical study of a crane or construction equipment the maximum height should be listed above as the Structure Height (AGL). Additionally, provide the minimum operating height to avoid delays if impacts are identified that require negotiation to a reduced height. If the Structure Height and minimum operating height are the same enter the same value in both fields.</i></p>											
Requested Marking/Lighting:	Red lights and paint										
Recommended Marking/Lighting:	White Paint/Synchronized Red Lights										
Current Marking/Lighting:	N/A Proposed Structure										
Other :	<input type="text"/>										
Nearest City:	New Kirk										
Nearest State:	Oklahoma										
Description of Location:	14 Miles North of New Kirk										
Description of Proposal:	80 WTG Project for electric production										
Structure Summary											
Structure Type:	Wind Turbine *legacy*										
Structure Type:	<input type="text" value="WIND_TURBINE"/> Wind Turbine										
Structure Name:	25										
FDC NOTAM:											
NOTAM Number:											
FCC Number:											
Prior ASN:											
Proposed Frequency Bands											
	<table border="1"> <thead> <tr> <th>Low Freq</th> <th>High Freq</th> <th>Freq Unit</th> <th>ERP</th> <th>ERP Unit</th> </tr> </thead> <tbody> <tr> <td></td> <td></td> <td></td> <td></td> <td></td> </tr> </tbody> </table>	Low Freq	High Freq	Freq Unit	ERP	ERP Unit					
Low Freq	High Freq	Freq Unit	ERP	ERP Unit							





Notice of Proposed Construction or Alteration - Off Airport

[Add a New Case \(Off Airport\) - Desk Reference Guide V_2018.2.1](#)

[Add a New Case \(Off Airport\) for Wind Turbines - Met Towers \(with WT Farm\) - WT-Barge Crane - Desk Reference Guide V_2018.2.1](#)

Project Name: PNEWI-000610355-19

Sponsor: PNE USA

Details for Case : 26

[Show Project Summary](#)

Case Status	
ASN:	2019-WTW-4428-OE
Status:	Determined
7460-2 Forms:	<p>01/13/2021</p> <p>7460-2 (PART 1) required at least 10 days prior to start of construction.</p> <p>Add Supplemental Notice (7460-2)</p>
Public Comments:	None
Date Accepted:	04/22/2019
Date Determined:	08/18/2019
Letters:	<p>03/24/2021 EXT</p> <p>08/18/2019 DNH</p> <p>06/24/2019 NPH</p>
Documents:	<p>None</p> <p>Project Documents:</p> <p>04/22/2019 Chilocco - FAA Fi...</p> <p>04/22/2019 Chilocco - FAA F...</p> <p>04/18/2019 Chilocco - FAA Fi...</p>

Construction / Alteration Information	
Notice Of:	
Duration:	Permanent
if Temporary :	Months: Days:
Work Schedule - Start:	01/01/2020
Work Schedule - End:	01/01/2021
<p><i>*For temporary cranes-Does the permanent structure require separate notice to the FAA? To find out, use the Notice Criteria Tool. If separate notice is required, please ensure it is filed. If it is not filed, please state the reason in the Description of Proposal.</i></p> <p>State Filing:</p>	

Structure Summary	
Structure Type:	Wind Turbine *legacy*
Structure Type:	<input type="text" value="WIND_TURBINE"/> Wind Turbine
Structure Name:	26
FDC NOTAM:	
NOTAM Number:	
FCC Number:	
Prior ASN:	

Structure Details	
Latitude:	36° 57' 28.65" N
Longitude:	97° 5' 34.25" W
Horizontal Datum:	NAD83
Site Elevation (SE):	1172 (nearest foot) PASSED
Structure Height (AGL):	599 (nearest foot)
Current Height (AGL):	(nearest foot)
<p><i>* For notice of alteration or existing provide the current AGL height of the existing structure. Include details in the Description of Proposal</i></p>	
Minimum Operating Height (AGL):	(nearest foot)
<p><i>* For aeronautical study of a crane or construction equipment the maximum height should be listed above as the Structure Height (AGL). Additionally, provide the minimum operating height to avoid delays if impacts are identified that require negotiation to a reduced height. If the Structure Height and minimum operating height are the same enter the same value in both fields.</i></p>	
Requested Marking/Lighting:	Red lights and paint
Recommended Marking/Lighting:	White Paint/Synchronized Red Lights
Current Marking/Lighting:	N/A Proposed Structure
Other :	<input type="text"/>
Nearest City:	New Kirk
Nearest State:	Oklahoma
Description of Location:	14 Miles North of New Kirk
Description of Proposal:	80 WTG Project for electric production

Proposed Frequency Bands				
Low Freq	High Freq	Freq Unit	ERP	ERP Unit





Notice of Proposed Construction or Alteration - Off Airport

[Add a New Case \(Off Airport\) - Desk Reference Guide V_2018.2.1](#)

[Add a New Case \(Off Airport\) for Wind Turbines - Met Towers \(with WT Farm\) - WT-Barge Crane - Desk Reference Guide V_2018.2.1](#)

Project Name: PNEWI-000610355-19

Sponsor: PNE USA

Details for Case : 27

[Show Project Summary](#)

Case Status											
ASN:	2019-WTW-4429-OE										
Status:	Determined										
7460-2 Forms:	<p>01/13/2021</p> <p>7460-2 (PART 1) required at least 10 days prior to start of construction.</p> <p>Add Supplemental Notice (7460-2)</p>										
Public Comments:	None										
Date Accepted:	04/22/2019										
Date Determined:	08/18/2019										
Letters:	<p>03/24/2021 EXT</p> <p>08/18/2019 DNH</p> <p>06/24/2019 NPH</p>										
Documents:	<p>None</p> <p>Project Documents:</p> <p>04/22/2019 Chilocco - FAA Fi...</p> <p>04/22/2019 Chilocco - FAA F...</p> <p>04/18/2019 Chilocco - FAA Fi...</p>										
Construction / Alteration Information											
Notice Of:											
Duration:	Permanent										
if Temporary :	Months: Days:										
Work Schedule - Start:	01/01/2020										
Work Schedule - End:	01/01/2021										
<p><i>*For temporary cranes-Does the permanent structure require separate notice to the FAA? To find out, use the Notice Criteria Tool. If separate notice is required, please ensure it is filed. If it is not filed, please state the reason in the Description of Proposal.</i></p> <p>State Filing:</p>											
Structure Details											
Latitude:	36° 57' 56.31" N										
Longitude:	97° 5' 22.97" W										
Horizontal Datum:	NAD83										
Site Elevation (SE):	1188 (nearest foot) PASSED										
Structure Height (AGL):	599 (nearest foot)										
Current Height (AGL):	(nearest foot)										
<p><i>* For notice of alteration or existing provide the current AGL height of the existing structure. Include details in the Description of Proposal</i></p>											
Minimum Operating Height (AGL):	(nearest foot)										
<p><i>* For aeronautical study of a crane or construction equipment the maximum height should be listed above as the Structure Height (AGL). Additionally, provide the minimum operating height to avoid delays if impacts are identified that require negotiation to a reduced height. If the Structure Height and minimum operating height are the same enter the same value in both fields.</i></p>											
Requested Marking/Lighting:	Red lights and paint										
Recommended Marking/Lighting:	White Paint/Synchronized Red Lights										
Current Marking/Lighting:	N/A Proposed Structure										
Other :	<input type="text"/>										
Nearest City:	New Kirk										
Nearest State:	Oklahoma										
Description of Location:	14 Miles North of New Kirk										
Description of Proposal:	80 WTG Project for electric production										
Structure Summary											
Structure Type:	Wind Turbine *legacy*										
Structure Type:	<input type="text" value="WIND_TURBINE"/> Wind Turbine										
Structure Name:	27										
FDC NOTAM:											
NOTAM Number:											
FCC Number:											
Prior ASN:											
Proposed Frequency Bands											
	<table border="1"> <thead> <tr> <th>Low Freq</th> <th>High Freq</th> <th>Freq Unit</th> <th>ERP</th> <th>ERP Unit</th> </tr> </thead> <tbody> <tr> <td></td> <td></td> <td></td> <td></td> <td></td> </tr> </tbody> </table>	Low Freq	High Freq	Freq Unit	ERP	ERP Unit					
Low Freq	High Freq	Freq Unit	ERP	ERP Unit							





Notice of Proposed Construction or Alteration - Off Airport

[Add a New Case \(Off Airport\) - Desk Reference Guide V_2018.2.1](#)

[Add a New Case \(Off Airport\) for Wind Turbines - Met Towers \(with WT Farm\) - WT-Barge Crane - Desk Reference Guide V_2018.2.1](#)

Project Name: PNEWI-000610355-19

Sponsor: PNE USA

Details for Case : 28

[Show Project Summary](#)

Case Status	
ASN:	2019-WTW-4430-OE
Status:	Determined
7460-2 Forms:	<p>01/13/2021</p> <p>7460-2 (PART 1) required at least 10 days prior to start of construction.</p> <p>Add Supplemental Notice (7460-2)</p>
Public Comments:	None
Date Accepted:	04/22/2019
Date Determined:	08/18/2019
Letters:	<p>03/24/2021 EXT</p> <p>08/18/2019 DNH</p> <p>06/24/2019 NPH</p>
Documents:	<p>None</p> <p>Project Documents:</p> <p>04/22/2019 Chilocco - FAA Fi...</p> <p>04/22/2019 Chilocco - FAA F...</p> <p>04/18/2019 Chilocco - FAA Fi...</p>

Construction / Alteration Information	
Notice Of:	
Duration:	Permanent
if Temporary :	Months: Days:
Work Schedule - Start:	01/01/2020
Work Schedule - End:	01/01/2021
<p><i>*For temporary cranes-Does the permanent structure require separate notice to the FAA? To find out, use the Notice Criteria Tool. If separate notice is required, please ensure it is filed. If it is not filed, please state the reason in the Description of Proposal.</i></p> <p>State Filing:</p>	

Structure Summary	
Structure Type:	Wind Turbine *legacy*
Structure Type:	<input type="text" value="WIND_TURBINE"/> Wind Turbine
Structure Name:	28
FDC NOTAM:	
NOTAM Number:	
FCC Number:	
Prior ASN:	

Structure Details	
Latitude:	36° 58' 50.18" N
Longitude:	97° 5' 21.30" W
Horizontal Datum:	NAD83
Site Elevation (SE):	1162 (nearest foot) PASSED
Structure Height (AGL):	599 (nearest foot)
Current Height (AGL):	(nearest foot)
<p><i>* For notice of alteration or existing provide the current AGL height of the existing structure. Include details in the Description of Proposal</i></p>	
Minimum Operating Height (AGL):	(nearest foot)
<p><i>* For aeronautical study of a crane or construction equipment the maximum height should be listed above as the Structure Height (AGL). Additionally, provide the minimum operating height to avoid delays if impacts are identified that require negotiation to a reduced height. If the Structure Height and minimum operating height are the same enter the same value in both fields.</i></p>	
Requested Marking/Lighting:	Red lights and paint
Recommended Marking/Lighting:	White Paint/Synchronized Red Lights
Current Marking/Lighting:	N/A Proposed Structure
Other :	<input type="text"/>
Nearest City:	New Kirk
Nearest State:	Oklahoma
Description of Location:	14 Miles North of New Kirk
Description of Proposal:	80 WTG Project for electric production

Proposed Frequency Bands				
Low Freq	High Freq	Freq Unit	ERP	ERP Unit





Notice of Proposed Construction or Alteration - Off Airport

[Add a New Case \(Off Airport\) - Desk Reference Guide V_2018.2.1](#)

[Add a New Case \(Off Airport\) for Wind Turbines - Met Towers \(with WT Farm\) - WT-Barge Crane - Desk Reference Guide V_2018.2.1](#)

Project Name: PNEWI-000610355-19

Sponsor: PNE USA

Details for Case : 29

[Show Project Summary](#)

Case Status											
ASN:	2019-WTW-4431-OE										
Status:	Determined										
7460-2 Forms:	<p>01/13/2021</p> <p>7460-2 (PART 1) required at least 10 days prior to start of construction.</p> <p>Add Supplemental Notice (7460-2)</p>										
Public Comments:	None										
Date Accepted:	04/22/2019										
Date Determined:	08/18/2019										
Letters:	<p>03/24/2021 EXT</p> <p>08/18/2019 DNH</p> <p>06/24/2019 NPH</p>										
Documents:	<p>None</p> <p>Project Documents:</p> <p>04/22/2019 Chilocco - FAA Fi...</p> <p>04/22/2019 Chilocco - FAA F...</p> <p>04/18/2019 Chilocco - FAA Fi...</p>										
Construction / Alteration Information											
Notice Of:											
Duration:	Permanent										
if Temporary :	Months: Days:										
Work Schedule - Start:	01/01/2020										
Work Schedule - End:	01/01/2021										
<p><i>*For temporary cranes-Does the permanent structure require separate notice to the FAA? To find out, use the Notice Criteria Tool. If separate notice is required, please ensure it is filed. If it is not filed, please state the reason in the Description of Proposal.</i></p> <p>State Filing:</p>											
Structure Details											
Latitude:	36° 57' 28.60" N										
Longitude:	97° 5' 20.71" W										
Horizontal Datum:	NAD83										
Site Elevation (SE):	1174 (nearest foot) PASSED										
Structure Height (AGL):	599 (nearest foot)										
Current Height (AGL):	(nearest foot)										
<p><i>* For notice of alteration or existing provide the current AGL height of the existing structure. Include details in the Description of Proposal</i></p>											
Minimum Operating Height (AGL):	(nearest foot)										
<p><i>* For aeronautical study of a crane or construction equipment the maximum height should be listed above as the Structure Height (AGL). Additionally, provide the minimum operating height to avoid delays if impacts are identified that require negotiation to a reduced height. If the Structure Height and minimum operating height are the same enter the same value in both fields.</i></p>											
Requested Marking/Lighting:	Red lights and paint										
Recommended Marking/Lighting:	White Paint/Synchronized Red Lights										
Current Marking/Lighting:	N/A Proposed Structure										
Other :	<input type="text"/>										
Nearest City:	New Kirk										
Nearest State:	Oklahoma										
Description of Location:	14 Miles North of New Kirk										
Description of Proposal:	80 WTG Project for electric production										
Structure Summary											
Structure Type:	Wind Turbine *legacy*										
Structure Type:	<input type="text" value="WIND_TURBINE"/> Wind Turbine										
Structure Name:	29										
FDC NOTAM:											
NOTAM Number:											
FCC Number:											
Prior ASN:											
Proposed Frequency Bands											
	<table border="1"> <thead> <tr> <th>Low Freq</th> <th>High Freq</th> <th>Freq Unit</th> <th>ERP</th> <th>ERP Unit</th> </tr> </thead> <tbody> <tr> <td></td> <td></td> <td></td> <td></td> <td></td> </tr> </tbody> </table>	Low Freq	High Freq	Freq Unit	ERP	ERP Unit					
Low Freq	High Freq	Freq Unit	ERP	ERP Unit							





Notice of Proposed Construction or Alteration - Off Airport

[Add a New Case \(Off Airport\) - Desk Reference Guide V_2018.2.1](#)

[Add a New Case \(Off Airport\) for Wind Turbines - Met Towers \(with WT Farm\) - WT-Barge Crane - Desk Reference Guide V_2018.2.1](#)

Project Name: PNEWI-000610355-19

Sponsor: PNE USA

Details for Case : 30

[Show Project Summary](#)

Case Status	
ASN:	2019-WTW-4432-OE
Status:	Determined
7460-2 Forms:	<p>01/13/2021</p> <p>7460-2 (PART 1) required at least 10 days prior to start of construction.</p> <p>Add Supplemental Notice (7460-2)</p>
Public Comments:	None
Date Accepted:	04/22/2019
Date Determined:	08/18/2019
Letters:	<p>03/24/2021 EXT</p> <p>08/18/2019 DNH</p> <p>06/24/2019 NPH</p>
Documents:	<p>None</p> <p>Project Documents:</p> <p>04/22/2019 Chilocco - FAA Fi...</p> <p>04/22/2019 Chilocco - FAA F...</p> <p>04/18/2019 Chilocco - FAA Fi...</p>

Construction / Alteration Information	
Notice Of:	
Duration:	Permanent
if Temporary :	Months: Days:
Work Schedule - Start:	01/01/2020
Work Schedule - End:	01/01/2021
<p><i>*For temporary cranes-Does the permanent structure require separate notice to the FAA? To find out, use the Notice Criteria Tool. If separate notice is required, please ensure it is filed. If it is not filed, please state the reason in the Description of Proposal.</i></p> <p>State Filing:</p>	

Structure Summary	
Structure Type:	Wind Turbine *legacy*
Structure Type:	<input type="text" value="WIND_TURBINE"/> Wind Turbine
Structure Name:	30
FDC NOTAM:	
NOTAM Number:	
FCC Number:	
Prior ASN:	

Structure Details	
Latitude:	36° 58' 9.96" N
Longitude:	97° 5' 14.99" W
Horizontal Datum:	NAD83
Site Elevation (SE):	1188 (nearest foot) PASSED
Structure Height (AGL):	599 (nearest foot)
Current Height (AGL):	(nearest foot)
<p><i>* For notice of alteration or existing provide the current AGL height of the existing structure. Include details in the Description of Proposal</i></p>	
Minimum Operating Height (AGL):	(nearest foot)
<p><i>* For aeronautical study of a crane or construction equipment the maximum height should be listed above as the Structure Height (AGL). Additionally, provide the minimum operating height to avoid delays if impacts are identified that require negotiation to a reduced height. If the Structure Height and minimum operating height are the same enter the same value in both fields.</i></p>	
Requested Marking/Lighting:	Red lights and paint
Recommended Marking/Lighting:	White Paint/Synchronized Red Lights
Current Marking/Lighting:	N/A Proposed Structure
Other :	<input type="text"/>
Nearest City:	New Kirk
Nearest State:	Oklahoma
Description of Location:	14 Miles North of New Kirk
Description of Proposal:	80 WTG Project for electric production

Proposed Frequency Bands				
Low Freq	High Freq	Freq Unit	ERP	ERP Unit





Notice of Proposed Construction or Alteration - Off Airport

[Add a New Case \(Off Airport\) - Desk Reference Guide V_2018.2.1](#)

[Add a New Case \(Off Airport\) for Wind Turbines - Met Towers \(with WT Farm\) - WT-Barge Crane - Desk Reference Guide V_2018.2.1](#)

Project Name: PNEWI-000610355-19

Sponsor: PNE USA

Details for Case : 31

[Show Project Summary](#)

Case Status					
ASN:	2019-WTW-4433-OE				
Status:	Determined				
7460-2 Forms:	<p>01/13/2021</p> <p>7460-2 (PART 1) required at least 10 days prior to start of construction.</p> <p>Add Supplemental Notice (7460-2)</p>				
Public Comments:	None				
Date Accepted:	04/22/2019				
Date Determined:	08/18/2019				
Letters:	<p>03/24/2021 EXT</p> <p>08/18/2019 DNH</p> <p>06/24/2019 NPH</p>				
Documents:	<p>None</p> <p>Project Documents:</p> <p>04/22/2019 Chilocco - FAA Fi...</p> <p>04/22/2019 Chilocco - FAA F...</p> <p>04/18/2019 Chilocco - FAA Fi...</p>				
Construction / Alteration Information					
Notice Of:					
Duration:	Permanent				
if Temporary :	Months: Days:				
Work Schedule - Start:	01/01/2020				
Work Schedule - End:	01/01/2021				
<p><i>*For temporary cranes-Does the permanent structure require separate notice to the FAA? To find out, use the Notice Criteria Tool. If separate notice is required, please ensure it is filed. If it is not filed, please state the reason in the Description of Proposal.</i></p> <p>State Filing:</p>					
Structure Details					
Latitude:	36° 57' 42.46" N				
Longitude:	97° 5' 13.29" W				
Horizontal Datum:	NAD83				
Site Elevation (SE):	1189 (nearest foot) PASSED				
Structure Height (AGL):	599 (nearest foot)				
Current Height (AGL):	(nearest foot)				
<p><i>* For notice of alteration or existing provide the current AGL height of the existing structure. Include details in the Description of Proposal</i></p>					
Minimum Operating Height (AGL):	(nearest foot)				
<p><i>* For aeronautical study of a crane or construction equipment the maximum height should be listed above as the Structure Height (AGL). Additionally, provide the minimum operating height to avoid delays if impacts are identified that require negotiation to a reduced height. If the Structure Height and minimum operating height are the same enter the same value in both fields.</i></p>					
Requested Marking/Lighting:	Red lights and paint				
Recommended Marking/Lighting:	White Paint/Synchronized Red Lights				
Current Marking/Lighting:	N/A Proposed Structure				
Other :	<input type="text"/>				
Nearest City:	New Kirk				
Nearest State:	Oklahoma				
Description of Location:	14 Miles North of New Kirk				
Description of Proposal:	80 WTG Project for electric production				
Structure Summary					
Structure Type:	Wind Turbine *legacy*				
Structure Type:	<input type="text" value="WIND_TURBINE"/> Wind Turbine				
Structure Name:	31				
FDC NOTAM:					
NOTAM Number:					
FCC Number:					
Prior ASN:					
Proposed Frequency Bands					
	Low Freq	High Freq	Freq Unit	ERP	ERP Unit





Notice of Proposed Construction or Alteration - Off Airport

[Add a New Case \(Off Airport\) - Desk Reference Guide V_2018.2.1](#)

[Add a New Case \(Off Airport\) for Wind Turbines - Met Towers \(with WT Farm\) - WT-Barge Crane - Desk Reference Guide V_2018.2.1](#)

Project Name: PNEWI-000610355-19

Sponsor: PNE USA

Details for Case : 32

[Show Project Summary](#)

Case Status					
ASN:	2019-WTW-4434-OE				
Status:	Determined				
7460-2 Forms:	<p>01/13/2021</p> <p>7460-2 (PART 1) required at least 10 days prior to start of construction.</p> <p>Add Supplemental Notice (7460-2)</p>				
Public Comments:	None				
Date Accepted:	04/22/2019				
Date Determined:	08/18/2019				
Letters:	<p>03/24/2021 EXT</p> <p>08/18/2019 DNH</p> <p>06/24/2019 NPH</p>				
Documents:	<p>None</p> <p>Project Documents:</p> <p>04/22/2019 Chilocco - FAA Fi...</p> <p>04/22/2019 Chilocco - FAA F...</p> <p>04/18/2019 Chilocco - FAA Fi...</p>				
Construction / Alteration Information					
Notice Of:					
Duration:	Permanent				
if Temporary :	Months: Days:				
Work Schedule - Start:	01/01/2020				
Work Schedule - End:	01/01/2021				
<p><i>*For temporary cranes-Does the permanent structure require separate notice to the FAA? To find out, use the Notice Criteria Tool. If separate notice is required, please ensure it is filed. If it is not filed, please state the reason in the Description of Proposal.</i></p> <p>State Filing:</p>					
Structure Details					
Latitude:	36° 57' 56.46" N				
Longitude:	97° 5' 6.19" W				
Horizontal Datum:	NAD83				
Site Elevation (SE):	1193 (nearest foot) PASSED				
Structure Height (AGL):	599 (nearest foot)				
Current Height (AGL):	(nearest foot)				
<p><i>* For notice of alteration or existing provide the current AGL height of the existing structure. Include details in the Description of Proposal</i></p>					
Minimum Operating Height (AGL):	(nearest foot)				
<p><i>* For aeronautical study of a crane or construction equipment the maximum height should be listed above as the Structure Height (AGL). Additionally, provide the minimum operating height to avoid delays if impacts are identified that require negotiation to a reduced height. If the Structure Height and minimum operating height are the same enter the same value in both fields.</i></p>					
Requested Marking/Lighting:	Red lights and paint				
Recommended Marking/Lighting:	White Paint/Synchronized Red Lights				
Current Marking/Lighting:	N/A Proposed Structure				
Other :	<input type="text"/>				
Nearest City:	New Kirk				
Nearest State:	Oklahoma				
Description of Location:	14 Miles North of New Kirk				
Description of Proposal:	80 WTG Project for electric production				
Structure Summary					
Structure Type:	Wind Turbine *legacy*				
Structure Type:	<input type="text" value="WIND_TURBINE"/> Wind Turbine				
Structure Name:	32				
FDC NOTAM:					
NOTAM Number:					
FCC Number:					
Prior ASN:					
Proposed Frequency Bands					
	Low Freq	High Freq	Freq Unit	ERP	ERP Unit





Notice of Proposed Construction or Alteration - Off Airport

[Add a New Case \(Off Airport\) - Desk Reference Guide V_2018.2.1](#)

[Add a New Case \(Off Airport\) for Wind Turbines - Met Towers \(with WT Farm\) - WT-Barge Crane - Desk Reference Guide V_2018.2.1](#)

Project Name: PNEWI-000610355-19

Sponsor: PNE USA

Details for Case : 33

[Show Project Summary](#)

Case Status											
ASN:	2019-WTW-4435-OE										
Status:	Determined										
7460-2 Forms:	<p>01/13/2021</p> <p>7460-2 (PART 1) required at least 10 days prior to start of construction.</p> <p>Add Supplemental Notice (7460-2)</p>										
Public Comments:	None										
Date Accepted:	04/22/2019										
Date Determined:	08/18/2019										
Letters:	<p>03/24/2021 EXT</p> <p>08/18/2019 DNH</p> <p>06/24/2019 NPH</p>										
Documents:	<p>None</p> <p>Project Documents:</p> <p>04/22/2019 Chilocco - FAA Fi...</p> <p>04/22/2019 Chilocco - FAA F...</p> <p>04/18/2019 Chilocco - FAA Fi...</p>										
Construction / Alteration Information											
Notice Of:											
Duration:	Permanent										
if Temporary :	Months: Days:										
Work Schedule - Start:	01/01/2020										
Work Schedule - End:	01/01/2021										
<p><i>*For temporary cranes-Does the permanent structure require separate notice to the FAA? To find out, use the Notice Criteria Tool. If separate notice is required, please ensure it is filed. If it is not filed, please state the reason in the Description of Proposal.</i></p> <p>State Filing:</p>											
Structure Details											
Latitude:	36° 57' 28.61" N										
Longitude:	97° 5' 3.16" W										
Horizontal Datum:	NAD83										
Site Elevation (SE):	1179 (nearest foot) PASSED										
Structure Height (AGL):	599 (nearest foot)										
Current Height (AGL):	(nearest foot)										
<p><i>* For notice of alteration or existing provide the current AGL height of the existing structure. Include details in the Description of Proposal</i></p>											
Minimum Operating Height (AGL):	(nearest foot)										
<p><i>* For aeronautical study of a crane or construction equipment the maximum height should be listed above as the Structure Height (AGL). Additionally, provide the minimum operating height to avoid delays if impacts are identified that require negotiation to a reduced height. If the Structure Height and minimum operating height are the same enter the same value in both fields.</i></p>											
Requested Marking/Lighting:	Red lights and paint										
Recommended Marking/Lighting:	White Paint/Synchronized Red Lights										
Current Marking/Lighting:	N/A Proposed Structure										
Other :	<input type="text"/>										
Nearest City:	New Kirk										
Nearest State:	Oklahoma										
Description of Location:	14 Miles North of New Kirk										
Description of Proposal:	80 WTG Project for electric production										
Structure Summary											
Structure Type:	Wind Turbine *legacy*										
Structure Type:	<input type="text" value="WIND_TURBINE"/> Wind Turbine										
Structure Name:	33										
FDC NOTAM:											
NOTAM Number:											
FCC Number:											
Prior ASN:											
Proposed Frequency Bands											
	<table border="1"> <thead> <tr> <th>Low Freq</th> <th>High Freq</th> <th>Freq Unit</th> <th>ERP</th> <th>ERP Unit</th> </tr> </thead> <tbody> <tr> <td></td> <td></td> <td></td> <td></td> <td></td> </tr> </tbody> </table>	Low Freq	High Freq	Freq Unit	ERP	ERP Unit					
Low Freq	High Freq	Freq Unit	ERP	ERP Unit							





Notice of Proposed Construction or Alteration - Off Airport

[Add a New Case \(Off Airport\) - Desk Reference Guide V_2018.2.1](#)

[Add a New Case \(Off Airport\) for Wind Turbines - Met Towers \(with WT Farm\) - WT-Barge Crane - Desk Reference Guide V_2018.2.1](#)

Project Name: PNEWI-000610355-19

Sponsor: PNE USA

Details for Case : 34

[Show Project Summary](#)

Case Status											
ASN:	2019-WTW-4436-OE										
Status:	Determined										
7460-2 Forms:	<p>01/13/2021</p> <p>7460-2 (PART 1) required at least 10 days prior to start of construction.</p> <p>Add Supplemental Notice (7460-2)</p>										
Public Comments:	None										
Date Accepted:	04/22/2019										
Date Determined:	08/18/2019										
Letters:	<p>03/24/2021 EXT</p> <p>08/18/2019 DNH</p> <p>06/24/2019 NPH</p>										
Documents:	<p>None</p> <p>Project Documents:</p> <p>04/22/2019 Chilocco - FAA Fi...</p> <p>04/22/2019 Chilocco - FAA F...</p> <p>04/18/2019 Chilocco - FAA Fi...</p>										
Construction / Alteration Information											
Notice Of:											
Duration:	Permanent										
if Temporary :	Months: Days:										
Work Schedule - Start:	01/01/2020										
Work Schedule - End:	01/01/2021										
<p><i>*For temporary cranes-Does the permanent structure require separate notice to the FAA? To find out, use the Notice Criteria Tool. If separate notice is required, please ensure it is filed. If it is not filed, please state the reason in the Description of Proposal.</i></p> <p>State Filing:</p>											
Structure Details											
Latitude:	36° 57' 45.29" N										
Longitude:	97° 4' 55.67" W										
Horizontal Datum:	NAD83										
Site Elevation (SE):	1176 (nearest foot) PASSED										
Structure Height (AGL):	599 (nearest foot)										
Current Height (AGL):	(nearest foot)										
<p><i>* For notice of alteration or existing provide the current AGL height of the existing structure. Include details in the Description of Proposal</i></p>											
Minimum Operating Height (AGL):	(nearest foot)										
<p><i>* For aeronautical study of a crane or construction equipment the maximum height should be listed above as the Structure Height (AGL). Additionally, provide the minimum operating height to avoid delays if impacts are identified that require negotiation to a reduced height. If the Structure Height and minimum operating height are the same enter the same value in both fields.</i></p>											
Requested Marking/Lighting:	Red lights and paint										
Recommended Marking/Lighting:	White Paint/Synchronized Red Lights										
Current Marking/Lighting:	N/A Proposed Structure										
Other :	<input type="text"/>										
Nearest City:	New Kirk										
Nearest State:	Oklahoma										
Description of Location:	14 Miles North of New Kirk										
Description of Proposal:	80 WTG Project for electric production										
Structure Summary											
Structure Type:	Wind Turbine *legacy*										
Structure Type:	<input type="text" value="WIND_TURBINE"/> Wind Turbine										
Structure Name:	34										
FDC NOTAM:											
NOTAM Number:											
FCC Number:											
Prior ASN:											
Proposed Frequency Bands											
	<table border="1"> <thead> <tr> <th>Low Freq</th> <th>High Freq</th> <th>Freq Unit</th> <th>ERP</th> <th>ERP Unit</th> </tr> </thead> <tbody> <tr> <td></td> <td></td> <td></td> <td></td> <td></td> </tr> </tbody> </table>	Low Freq	High Freq	Freq Unit	ERP	ERP Unit					
Low Freq	High Freq	Freq Unit	ERP	ERP Unit							





Notice of Proposed Construction or Alteration - Off Airport

[Add a New Case \(Off Airport\) - Desk Reference Guide V_2018.2.1](#)

[Add a New Case \(Off Airport\) for Wind Turbines - Met Towers \(with WT Farm\) - WT-Barge Crane - Desk Reference Guide V_2018.2.1](#)

Project Name: PNEWI-000610355-19

Sponsor: PNE USA

Details for Case : 35

[Show Project Summary](#)

Case Status	
ASN:	2019-WTW-4437-OE
Status:	Determined
7460-2 Forms:	<p>01/13/2021</p> <p>7460-2 (PART 1) required at least 10 days prior to start of construction.</p> <p>Add Supplemental Notice (7460-2)</p>
Public Comments:	None
Date Accepted:	04/22/2019
Date Determined:	08/18/2019
Letters:	<p>03/24/2021 EXT</p> <p>08/18/2019 DNH</p> <p>06/24/2019 NPH</p>
Documents:	<p>None</p> <p>Project Documents:</p> <p>04/22/2019 Chilocco - FAA Fi...</p> <p>04/22/2019 Chilocco - FAA F...</p> <p>04/18/2019 Chilocco - FAA Fi...</p>

Construction / Alteration Information	
Notice Of:	
Duration:	Permanent
if Temporary :	Months: Days:
Work Schedule - Start:	01/01/2020
Work Schedule - End:	01/01/2021
<p><i>*For temporary cranes-Does the permanent structure require separate notice to the FAA? To find out, use the Notice Criteria Tool. If separate notice is required, please ensure it is filed. If it is not filed, please state the reason in the Description of Proposal.</i></p> <p>State Filing:</p>	

Structure Summary	
Structure Type:	Wind Turbine *legacy*
Structure Type:	<input type="text" value="WIND_TURBINE"/> Wind Turbine
Structure Name:	35
FDC NOTAM:	
NOTAM Number:	
FCC Number:	
Prior ASN:	

Structure Details	
Latitude:	36° 58' 50.00" N
Longitude:	97° 4' 59.84" W
Horizontal Datum:	NAD83
Site Elevation (SE):	1160 (nearest foot) PASSED
Structure Height (AGL):	599 (nearest foot)
Current Height (AGL):	(nearest foot)
<p><i>* For notice of alteration or existing provide the current AGL height of the existing structure. Include details in the Description of Proposal</i></p>	
Minimum Operating Height (AGL):	(nearest foot)
<p><i>* For aeronautical study of a crane or construction equipment the maximum height should be listed above as the Structure Height (AGL). Additionally, provide the minimum operating height to avoid delays if impacts are identified that require negotiation to a reduced height. If the Structure Height and minimum operating height are the same enter the same value in both fields.</i></p>	
Requested Marking/Lighting:	Red lights and paint
Recommended Marking/Lighting:	White Paint/Synchronized Red Lights
Current Marking/Lighting:	N/A Proposed Structure
Other :	<input type="text"/>
Nearest City:	New Kirk
Nearest State:	Oklahoma
Description of Location:	14 Miles North of New Kirk
Description of Proposal:	80 WTG Project for electric production

Proposed Frequency Bands				
Low Freq	High Freq	Freq Unit	ERP	ERP Unit





Notice of Proposed Construction or Alteration - Off Airport

[Add a New Case \(Off Airport\) - Desk Reference Guide V_2018.2.1](#)

[Add a New Case \(Off Airport\) for Wind Turbines - Met Towers \(with WT Farm\) - WT-Barge Crane - Desk Reference Guide V_2018.2.1](#)

Project Name: PNEWI-000610355-19

Sponsor: PNE USA

Details for Case : 36

[Show Project Summary](#)

Case Status					
ASN:	2019-WTW-4438-OE				
Status:	Determined				
7460-2 Forms:	<p>01/13/2021</p> <p>7460-2 (PART 1) required at least 10 days prior to start of construction.</p> <p>Add Supplemental Notice (7460-2)</p>				
Public Comments:	None				
Date Accepted:	04/22/2019				
Date Determined:	08/18/2019				
Letters:	<p>03/24/2021 EXT</p> <p>08/18/2019 DNH</p> <p>06/24/2019 NPH</p>				
Documents:	<p>None</p> <p>Project Documents:</p> <p>04/22/2019 Chilocco - FAA Fi...</p> <p>04/22/2019 Chilocco - FAA F...</p> <p>04/18/2019 Chilocco - FAA Fi...</p>				
Construction / Alteration Information					
Notice Of:					
Duration:	Permanent				
if Temporary :	Months: Days:				
Work Schedule - Start:	01/01/2020				
Work Schedule - End:	01/01/2021				
<p><i>*For temporary cranes-Does the permanent structure require separate notice to the FAA? To find out, use the Notice Criteria Tool. If separate notice is required, please ensure it is filed. If it is not filed, please state the reason in the Description of Proposal.</i></p> <p>State Filing:</p>					
Structure Details					
Latitude:	36° 57' 32.68" N				
Longitude:	97° 4' 44.02" W				
Horizontal Datum:	NAD83				
Site Elevation (SE):	1172 (nearest foot) PASSED				
Structure Height (AGL):	599 (nearest foot)				
Current Height (AGL):	(nearest foot)				
<p><i>* For notice of alteration or existing provide the current AGL height of the existing structure. Include details in the Description of Proposal</i></p>					
Minimum Operating Height (AGL):	(nearest foot)				
<p><i>* For aeronautical study of a crane or construction equipment the maximum height should be listed above as the Structure Height (AGL). Additionally, provide the minimum operating height to avoid delays if impacts are identified that require negotiation to a reduced height. If the Structure Height and minimum operating height are the same enter the same value in both fields.</i></p>					
Requested Marking/Lighting:	Red lights and paint				
Recommended Marking/Lighting:	White Paint/Synchronized Red Lights				
Current Marking/Lighting:	N/A Proposed Structure				
Other :	<input type="text"/>				
Nearest City:	New Kirk				
Nearest State:	Oklahoma				
Description of Location:	14 Miles North of New Kirk				
Description of Proposal:	80 WTG Project for electric production				
Structure Summary					
Structure Type:	Wind Turbine *legacy*				
Structure Type:	<input type="text" value="WIND_TURBINE"/> Wind Turbine				
Structure Name:	36				
FDC NOTAM:					
NOTAM Number:					
FCC Number:					
Prior ASN:					
Proposed Frequency Bands					
	Low Freq	High Freq	Freq Unit	ERP	ERP Unit





Notice of Proposed Construction or Alteration - Off Airport

[Add a New Case \(Off Airport\) - Desk Reference Guide V_2018.2.1](#)

[Add a New Case \(Off Airport\) for Wind Turbines - Met Towers \(with WT Farm\) - WT-Barge Crane - Desk Reference Guide V_2018.2.1](#)

Project Name: PNEWI-000610355-19

Sponsor: PNE USA

Details for Case : 37

[Show Project Summary](#)

Case Status	
ASN:	2019-WTW-4439-OE
Status:	Determined
7460-2 Forms:	<p>01/13/2021</p> <p>7460-2 (PART 1) required at least 10 days prior to start of construction.</p> <p>Add Supplemental Notice (7460-2)</p>
Public Comments:	None
Date Accepted:	04/22/2019
Date Determined:	08/18/2019
Letters:	<p>03/24/2021 EXT</p> <p>08/18/2019 DNH</p> <p>06/24/2019 NPH</p>
Documents:	<p>None</p> <p>Project Documents:</p> <p>04/22/2019 Chilocco - FAA Fi...</p> <p>04/22/2019 Chilocco - FAA F...</p> <p>04/18/2019 Chilocco - FAA Fi...</p>

Construction / Alteration Information	
Notice Of:	
Duration:	Permanent
if Temporary :	Months: Days:
Work Schedule - Start:	01/01/2020
Work Schedule - End:	01/01/2021
<p><i>*For temporary cranes-Does the permanent structure require separate notice to the FAA? To find out, use the Notice Criteria Tool. If separate notice is required, please ensure it is filed. If it is not filed, please state the reason in the Description of Proposal.</i></p> <p>State Filing:</p>	

Structure Summary	
Structure Type:	Wind Turbine *legacy*
Structure Type:	<input type="text" value="WIND_TURBINE"/> Wind Turbine
Structure Name:	37
FDC NOTAM:	
NOTAM Number:	
FCC Number:	
Prior ASN:	

Structure Details	
Latitude:	36° 57' 50.73" N
Longitude:	97° 4' 42.72" W
Horizontal Datum:	NAD83
Site Elevation (SE):	1169 (nearest foot) PASSED
Structure Height (AGL):	599 (nearest foot)
Current Height (AGL):	(nearest foot)
<p><i>* For notice of alteration or existing provide the current AGL height of the existing structure. Include details in the Description of Proposal</i></p>	
Minimum Operating Height (AGL):	(nearest foot)
<p><i>* For aeronautical study of a crane or construction equipment the maximum height should be listed above as the Structure Height (AGL). Additionally, provide the minimum operating height to avoid delays if impacts are identified that require negotiation to a reduced height. If the Structure Height and minimum operating height are the same enter the same value in both fields.</i></p>	
Requested Marking/Lighting:	Red lights and paint
Recommended Marking/Lighting:	White Paint/Synchronized Red Lights
Current Marking/Lighting:	N/A Proposed Structure
Other :	<input type="text"/>
Nearest City:	New Kirk
Nearest State:	Oklahoma
Description of Location:	14 Miles North of New Kirk
Description of Proposal:	80 WTG Project for electric production

Proposed Frequency Bands				
Low Freq	High Freq	Freq Unit	ERP	ERP Unit





Notice of Proposed Construction or Alteration - Off Airport

[Add a New Case \(Off Airport\) - Desk Reference Guide V_2018.2.1](#)[Add a New Case \(Off Airport\) for Wind Turbines - Met Towers \(with WT Farm\) - WT-Barge Crane - Desk Reference Guide V_2018.2.1](#)

Project Name: PNEWI-000610355-19

Sponsor: PNE USA

Details for Case : 38

[Show Project Summary](#)

Case Status					
ASN:	2019-WTW-4440-OE				
Status:	Determined				
7460-2 Forms:	01/13/2021 7460-2 (PART 1) required at least 10 days prior to start of construction. Add Supplemental Notice (7460-2)				
Public Comments:	None				
Date Accepted:	04/22/2019				
Date Determined:	08/18/2019				
Letters:	03/24/2021 EXT 08/18/2019 DNH 06/24/2019 NPH				
Documents:	None Project Documents: 04/22/2019 Chilocco - FAA Fi... 04/22/2019 Chilocco - FAA F... 04/18/2019 Chilocco - FAA Fi...				
Construction / Alteration Information					
Notice Of:					
Duration:	Permanent				
if Temporary:	Months: Days:				
Work Schedule - Start:	01/01/2020				
Work Schedule - End:	01/01/2021				
*For temporary cranes-Does the permanent structure require separate notice to the FAA? To find out, use the Notice Criteria Tool. If separate notice is required, please ensure it is filed. If it is not filed, please state the reason in the Description of Proposal.					
State Filing:					
Structure Details					
Latitude:	36° 58' 8.70" N				
Longitude:	97° 4' 40.48" W				
Horizontal Datum:	NAD83				
Site Elevation (SE):	1163 (nearest foot) PASSED				
Structure Height (AGL):	599 (nearest foot)				
Current Height (AGL):	(nearest foot)				
* For notice of alteration or existing provide the current AGL height of the existing structure. Include details in the Description of Proposal					
Minimum Operating Height (AGL):	(nearest foot)				
* For aeronautical study of a crane or construction equipment the maximum height should be listed above as the Structure Height (AGL). Additionally, provide the minimum operating height to avoid delays if impacts are identified that require negotiation to a reduced height. If the Structure Height and minimum operating height are the same enter the same value in both fields.					
Requested Marking/Lighting:	Red lights and paint				
Recommended Marking/Lighting:	White Paint/Synchronized Red Lights				
Current Marking/Lighting:	N/A Proposed Structure				
Nearest City:	New Kirk				
Nearest State:	Oklahoma				
Description of Location:	14 Miles North of New Kirk				
Description of Proposal:	80 WTG Project for electric production				
Structure Summary					
Structure Type:	Wind Turbine *legacy*				
Structure Type:	<input type="text" value="WIND_TURBINE"/> Wind Turbine				
Structure Name:	38				
FDC NOTAM:					
NOTAM Number:					
FCC Number:					
Prior ASN:					
Proposed Frequency Bands					
	Low Freq	High Freq	Freq Unit	ERP	ERP Unit





Notice of Proposed Construction or Alteration - Off Airport

[Add a New Case \(Off Airport\) - Desk Reference Guide V_2018.2.1](#)

[Add a New Case \(Off Airport\) for Wind Turbines - Met Towers \(with WT Farm\) - WT-Barge Crane - Desk Reference Guide V_2018.2.1](#)

Project Name: PNEWI-000610355-19

Sponsor: PNE USA

Details for Case : 39

[Show Project Summary](#)

Case Status											
ASN:	2019-WTW-4441-OE										
Status:	Determined										
7460-2 Forms:	<p>01/13/2021</p> <p>7460-2 (PART 1) required at least 10 days prior to start of construction.</p> <p>Add Supplemental Notice (7460-2)</p>										
Public Comments:	None										
Date Accepted:	04/22/2019										
Date Determined:	08/18/2019										
Letters:	<p>03/24/2021 EXT</p> <p>08/18/2019 DNH</p> <p>06/24/2019 NPH</p>										
Documents:	<p>None</p> <p>Project Documents:</p> <p>04/22/2019 Chilocco - FAA Fi...</p> <p>04/22/2019 Chilocco - FAA F...</p> <p>04/18/2019 Chilocco - FAA Fi...</p>										
Construction / Alteration Information											
Notice Of:											
Duration:	Permanent										
if Temporary :	Months: Days:										
Work Schedule - Start:	01/01/2020										
Work Schedule - End:	01/01/2021										
<p><i>*For temporary cranes-Does the permanent structure require separate notice to the FAA? To find out, use the Notice Criteria Tool. If separate notice is required, please ensure it is filed. If it is not filed, please state the reason in the Description of Proposal.</i></p> <p>State Filing:</p>											
Structure Details											
Latitude:	36° 57' 51.64" N										
Longitude:	97° 4' 28.78" W										
Horizontal Datum:	NAD83										
Site Elevation (SE):	1180 (nearest foot) PASSED										
Structure Height (AGL):	599 (nearest foot)										
Current Height (AGL):	(nearest foot)										
<p><i>* For notice of alteration or existing provide the current AGL height of the existing structure. Include details in the Description of Proposal</i></p>											
Minimum Operating Height (AGL):	(nearest foot)										
<p><i>* For aeronautical study of a crane or construction equipment the maximum height should be listed above as the Structure Height (AGL). Additionally, provide the minimum operating height to avoid delays if impacts are identified that require negotiation to a reduced height. If the Structure Height and minimum operating height are the same enter the same value in both fields.</i></p>											
Requested Marking/Lighting:	Red lights and paint										
Recommended Marking/Lighting:	White Paint/Synchronized Red Lights										
Current Marking/Lighting:	N/A Proposed Structure										
Other :	<input type="text"/>										
Nearest City:	New Kirk										
Nearest State:	Oklahoma										
Description of Location:	14 Miles North of New Kirk										
Description of Proposal:	80 WTG Project for electric production										
Structure Summary											
Structure Type:	Wind Turbine *legacy*										
Structure Type:	<input type="text" value="WIND_TURBINE"/> Wind Turbine										
Structure Name:	39										
FDC NOTAM:											
NOTAM Number:											
FCC Number:											
Prior ASN:											
Proposed Frequency Bands											
	<table border="1"> <thead> <tr> <th>Low Freq</th> <th>High Freq</th> <th>Freq Unit</th> <th>ERP</th> <th>ERP Unit</th> </tr> </thead> <tbody> <tr> <td></td> <td></td> <td></td> <td></td> <td></td> </tr> </tbody> </table>	Low Freq	High Freq	Freq Unit	ERP	ERP Unit					
Low Freq	High Freq	Freq Unit	ERP	ERP Unit							





Notice of Proposed Construction or Alteration - Off Airport

[Add a New Case \(Off Airport\) - Desk Reference Guide V_2018.2.1](#)

[Add a New Case \(Off Airport\) for Wind Turbines - Met Towers \(with WT Farm\) - WT-Barge Crane - Desk Reference Guide V_2018.2.1](#)

Project Name: PNEWI-000610355-19

Sponsor: PNE USA

Details for Case : 40

[Show Project Summary](#)

Case Status											
ASN:	2019-WTW-4442-OE										
Status:	Determined										
7460-2 Forms:	<p>01/13/2021</p> <p>7460-2 (PART 1) required at least 10 days prior to start of construction.</p> <p>Add Supplemental Notice (7460-2)</p>										
Public Comments:	None										
Date Accepted:	04/22/2019										
Date Determined:	08/18/2019										
Letters:	<p>03/24/2021 EXT</p> <p>08/18/2019 DNH</p> <p>06/24/2019 NPH</p>										
Documents:	<p>None</p> <p>Project Documents:</p> <p>04/22/2019 Chilocco - FAA Fi...</p> <p>04/22/2019 Chilocco - FAA F...</p> <p>04/18/2019 Chilocco - FAA Fi...</p>										
Construction / Alteration Information											
Notice Of:											
Duration:	Permanent										
if Temporary :	Months: Days:										
Work Schedule - Start:	01/01/2020										
Work Schedule - End:	01/01/2021										
<p><i>*For temporary cranes-Does the permanent structure require separate notice to the FAA? To find out, use the Notice Criteria Tool. If separate notice is required, please ensure it is filed. If it is not filed, please state the reason in the Description of Proposal.</i></p> <p>State Filing:</p>											
Structure Details											
Latitude:	36° 58' 44.29" N										
Longitude:	97° 4' 38.21" W										
Horizontal Datum:	NAD83										
Site Elevation (SE):	1155 (nearest foot) PASSED										
Structure Height (AGL):	599 (nearest foot)										
Current Height (AGL):	(nearest foot)										
<p><i>* For notice of alteration or existing provide the current AGL height of the existing structure. Include details in the Description of Proposal</i></p>											
Minimum Operating Height (AGL):	(nearest foot)										
<p><i>* For aeronautical study of a crane or construction equipment the maximum height should be listed above as the Structure Height (AGL). Additionally, provide the minimum operating height to avoid delays if impacts are identified that require negotiation to a reduced height. If the Structure Height and minimum operating height are the same enter the same value in both fields.</i></p>											
Requested Marking/Lighting:	Red lights and paint										
Recommended Marking/Lighting:	White Paint/Synchronized Red Lights										
Current Marking/Lighting:	N/A Proposed Structure										
Other :	<input type="text"/>										
Nearest City:	New Kirk										
Nearest State:	Oklahoma										
Description of Location:	14 Miles North of New Kirk										
Description of Proposal:	80 WTG Project for electric production										
Structure Summary											
Structure Type:	Wind Turbine *legacy*										
Structure Type:	<input type="text" value="WIND_TURBINE"/> Wind Turbine										
Structure Name:	40										
FDC NOTAM:											
NOTAM Number:											
FCC Number:											
Prior ASN:											
Proposed Frequency Bands											
	<table border="1"> <thead> <tr> <th>Low Freq</th> <th>High Freq</th> <th>Freq Unit</th> <th>ERP</th> <th>ERP Unit</th> </tr> </thead> <tbody> <tr> <td></td> <td></td> <td></td> <td></td> <td></td> </tr> </tbody> </table>	Low Freq	High Freq	Freq Unit	ERP	ERP Unit					
Low Freq	High Freq	Freq Unit	ERP	ERP Unit							





Notice of Proposed Construction or Alteration - Off Airport

[Add a New Case \(Off Airport\) - Desk Reference Guide V_2018.2.1](#)

[Add a New Case \(Off Airport\) for Wind Turbines - Met Towers \(with WT Farm\) - WT-Barge Crane - Desk Reference Guide V_2018.2.1](#)

Project Name: PNEWI-000610356-19

Sponsor: PNE USA

Details for Case : 41

[Show Project Summary](#)

Case Status	
ASN:	2019-WTW-4443-OE
Status:	Determined
7460-2 Forms:	<p>01/13/2021</p> <p>7460-2 (PART 1) required at least 10 days prior to start of construction.</p> <p>Add Supplemental Notice (7460-2)</p>
Public Comments:	None
Date Accepted:	04/22/2019
Date Determined:	08/18/2019
Letters:	<p>03/24/2021 EXT</p> <p>08/18/2019 DNH</p> <p>06/24/2019 NPH</p>
Documents:	<p>None</p> <p>Project Documents:</p> <p>04/22/2019 Chilocco - FAA Fi...</p> <p>04/22/2019 Chilocco - FAA F...</p> <p>04/18/2019 Chilocco - FAA Fi...</p>

Construction / Alteration Information	
Notice Of:	
Duration:	Permanent
if Temporary :	Months: Days:
Work Schedule - Start:	01/01/2020
Work Schedule - End:	01/01/2021
<p><i>*For temporary cranes-Does the permanent structure require separate notice to the FAA? To find out, use the Notice Criteria Tool. If separate notice is required, please ensure it is filed. If it is not filed, please state the reason in the Description of Proposal.</i></p> <p>State Filing:</p>	

Structure Summary	
Structure Type:	Wind Turbine *legacy*
Structure Type:	<input type="text" value="WIND_TURBINE"/> Wind Turbine
Structure Name:	41
FDC NOTAM:	
NOTAM Number:	
FCC Number:	
Prior ASN:	

Structure Details	
Latitude:	36° 57' 34.29" N
Longitude:	97° 4' 19.27" W
Horizontal Datum:	NAD83
Site Elevation (SE):	1175 (nearest foot) PASSED
Structure Height (AGL):	599 (nearest foot)
Current Height (AGL):	(nearest foot)
<p><i>* For notice of alteration or existing provide the current AGL height of the existing structure. Include details in the Description of Proposal</i></p>	
Minimum Operating Height (AGL):	(nearest foot)
<p><i>* For aeronautical study of a crane or construction equipment the maximum height should be listed above as the Structure Height (AGL). Additionally, provide the minimum operating height to avoid delays if impacts are identified that require negotiation to a reduced height. If the Structure Height and minimum operating height are the same enter the same value in both fields.</i></p>	
Requested Marking/Lighting:	Red lights and paint
Recommended Marking/Lighting:	White Paint/Synchronized Red Lights
Current Marking/Lighting:	N/A Proposed Structure
Other :	<input type="text"/>
Nearest City:	New Kirk
Nearest State:	Oklahoma
Description of Location:	14 Miles North of New Kirk
Description of Proposal:	80 WTG Project for electric production

Proposed Frequency Bands				
Low Freq	High Freq	Freq Unit	ERP	ERP Unit





Notice of Proposed Construction or Alteration - Off Airport

[Add a New Case \(Off Airport\) - Desk Reference Guide V_2018.2.1](#)

[Add a New Case \(Off Airport\) for Wind Turbines - Met Towers \(with WT Farm\) - WT-Barge Crane - Desk Reference Guide V_2018.2.1](#)

Project Name: PNEWI-000610356-19

Sponsor: PNE USA

Details for Case : 42

[Show Project Summary](#)

Case Status											
ASN:	2019-WTW-4444-OE										
Status:	Determined										
7460-2 Forms:	<p>01/13/2021</p> <p>7460-2 (PART 1) required at least 10 days prior to start of construction.</p> <p>Add Supplemental Notice (7460-2)</p>										
Public Comments:	None										
Date Accepted:	04/22/2019										
Date Determined:	08/18/2019										
Letters:	<p>03/24/2021 EXT</p> <p>08/18/2019 DNH</p> <p>06/24/2019 NPH</p>										
Documents:	<p>None</p> <p>Project Documents:</p> <p>04/22/2019 Chilocco - FAA Fi...</p> <p>04/22/2019 Chilocco - FAA F...</p> <p>04/18/2019 Chilocco - FAA Fi...</p>										
Construction / Alteration Information											
Notice Of:											
Duration:	Permanent										
if Temporary :	Months: Days:										
Work Schedule - Start:	01/01/2020										
Work Schedule - End:	01/01/2021										
<p><i>*For temporary cranes-Does the permanent structure require separate notice to the FAA? To find out, use the Notice Criteria Tool. If separate notice is required, please ensure it is filed. If it is not filed, please state the reason in the Description of Proposal.</i></p> <p>State Filing:</p>											
Structure Details											
Latitude:	36° 57' 52.63" N										
Longitude:	97° 4' 14.08" W										
Horizontal Datum:	NAD83										
Site Elevation (SE):	1170 (nearest foot) PASSED										
Structure Height (AGL):	599 (nearest foot)										
Current Height (AGL):	(nearest foot)										
<p><i>* For notice of alteration or existing provide the current AGL height of the existing structure. Include details in the Description of Proposal</i></p>											
Minimum Operating Height (AGL):	(nearest foot)										
<p><i>* For aeronautical study of a crane or construction equipment the maximum height should be listed above as the Structure Height (AGL). Additionally, provide the minimum operating height to avoid delays if impacts are identified that require negotiation to a reduced height. If the Structure Height and minimum operating height are the same enter the same value in both fields.</i></p>											
Requested Marking/Lighting:	Red lights and paint										
Recommended Marking/Lighting:	White Paint/Synchronized Red Lights										
Current Marking/Lighting:	N/A Proposed Structure										
Other :	<input type="text"/>										
Nearest City:	New Kirk										
Nearest State:	Oklahoma										
Description of Location:	14 Miles North of New Kirk										
Description of Proposal:	80 WTG Project for electric production										
Structure Summary											
Structure Type:	Wind Turbine *legacy*										
Structure Type:	<input type="text" value="WIND_TURBINE"/> Wind Turbine										
Structure Name:	42										
FDC NOTAM:											
NOTAM Number:											
FCC Number:											
Prior ASN:											
Proposed Frequency Bands											
	<table border="1"> <thead> <tr> <th>Low Freq</th> <th>High Freq</th> <th>Freq Unit</th> <th>ERP</th> <th>ERP Unit</th> </tr> </thead> <tbody> <tr> <td></td> <td></td> <td></td> <td></td> <td></td> </tr> </tbody> </table>	Low Freq	High Freq	Freq Unit	ERP	ERP Unit					
Low Freq	High Freq	Freq Unit	ERP	ERP Unit							





Notice of Proposed Construction or Alteration - Off Airport

[Add a New Case \(Off Airport\) - Desk Reference Guide V_2018.2.1](#)

[Add a New Case \(Off Airport\) for Wind Turbines - Met Towers \(with WT Farm\) - WT-Barge Crane - Desk Reference Guide V_2018.2.1](#)

Project Name: PNEWI-000610356-19

Sponsor: PNE USA

Details for Case : 43

[Show Project Summary](#)

Case Status											
ASN:	2019-WTW-4445-OE										
Status:	Determined										
7460-2 Forms:	<p>01/13/2021</p> <p>7460-2 (PART 1) required at least 10 days prior to start of construction.</p> <p>Add Supplemental Notice (7460-2)</p>										
Public Comments:	None										
Date Accepted:	04/22/2019										
Date Determined:	08/18/2019										
Letters:	<p>03/24/2021 EXT</p> <p>08/18/2019 DNH</p> <p>06/24/2019 NPH</p>										
Documents:	<p>None</p> <p>Project Documents:</p> <p>04/22/2019 Chilocco - FAA Fi...</p> <p>04/22/2019 Chilocco - FAA F...</p> <p>04/18/2019 Chilocco - FAA Fi...</p>										
Construction / Alteration Information											
Notice Of:											
Duration:	Permanent										
if Temporary :	Months: Days:										
Work Schedule - Start:	01/01/2020										
Work Schedule - End:	01/01/2021										
<p><i>*For temporary cranes-Does the permanent structure require separate notice to the FAA? To find out, use the Notice Criteria Tool. If separate notice is required, please ensure it is filed. If it is not filed, please state the reason in the Description of Proposal.</i></p> <p>State Filing:</p>											
Structure Details											
Latitude:	36° 58' 6.49" N										
Longitude:	97° 4' 4.31" W										
Horizontal Datum:	NAD83										
Site Elevation (SE):	1178 (nearest foot) PASSED										
Structure Height (AGL):	599 (nearest foot)										
Current Height (AGL):	(nearest foot)										
<p><i>* For notice of alteration or existing provide the current AGL height of the existing structure. Include details in the Description of Proposal</i></p>											
Minimum Operating Height (AGL):	(nearest foot)										
<p><i>* For aeronautical study of a crane or construction equipment the maximum height should be listed above as the Structure Height (AGL). Additionally, provide the minimum operating height to avoid delays if impacts are identified that require negotiation to a reduced height. If the Structure Height and minimum operating height are the same enter the same value in both fields.</i></p>											
Requested Marking/Lighting:	Red lights and paint										
Recommended Marking/Lighting:	White Paint/Synchronized Red Lights										
Current Marking/Lighting:	N/A Proposed Structure										
Other :	<input type="text"/>										
Nearest City:	New Kirk										
Nearest State:	Oklahoma										
Description of Location:	14 Miles North of New Kirk										
Description of Proposal:	80 WTG Project for electric production										
Structure Summary											
Structure Type:	Wind Turbine *legacy*										
Structure Type:	<input type="text" value="WIND_TURBINE"/> Wind Turbine										
Structure Name:	43										
FDC NOTAM:											
NOTAM Number:											
FCC Number:											
Prior ASN:											
Proposed Frequency Bands											
	<table border="1"> <thead> <tr> <th>Low Freq</th> <th>High Freq</th> <th>Freq Unit</th> <th>ERP</th> <th>ERP Unit</th> </tr> </thead> <tbody> <tr> <td></td> <td></td> <td></td> <td></td> <td></td> </tr> </tbody> </table>	Low Freq	High Freq	Freq Unit	ERP	ERP Unit					
Low Freq	High Freq	Freq Unit	ERP	ERP Unit							





Notice of Proposed Construction or Alteration - Off Airport

[Add a New Case \(Off Airport\) - Desk Reference Guide V_2018.2.1](#)

[Add a New Case \(Off Airport\) for Wind Turbines - Met Towers \(with WT Farm\) - WT-Barge Crane - Desk Reference Guide V_2018.2.1](#)

Project Name: PNEWI-000610356-19

Sponsor: PNE USA

Details for Case : 44

[Show Project Summary](#)

Case Status											
ASN:	2019-WTW-4446-OE										
Status:	Determined										
7460-2 Forms:	<p>01/13/2021</p> <p>7460-2 (PART 1) required at least 10 days prior to start of construction.</p> <p>Add Supplemental Notice (7460-2)</p>										
Public Comments:	None										
Date Accepted:	04/22/2019										
Date Determined:	08/18/2019										
Letters:	<p>03/24/2021 EXT</p> <p>08/18/2019 DNH</p> <p>06/24/2019 NPH</p>										
Documents:	<p>None</p> <p>Project Documents:</p> <p>04/22/2019 Chilocco - FAA Fi...</p> <p>04/22/2019 Chilocco - FAA F...</p> <p>04/18/2019 Chilocco - FAA Fi...</p>										
Construction / Alteration Information											
Notice Of:											
Duration:	Permanent										
if Temporary :	Months: Days:										
Work Schedule - Start:	01/01/2020										
Work Schedule - End:	01/01/2021										
<p><i>*For temporary cranes-Does the permanent structure require separate notice to the FAA? To find out, use the Notice Criteria Tool. If separate notice is required, please ensure it is filed. If it is not filed, please state the reason in the Description of Proposal.</i></p> <p>State Filing:</p>											
Structure Details											
Latitude:	36° 57' 30.78" N										
Longitude:	97° 4' 3.19" W										
Horizontal Datum:	NAD83										
Site Elevation (SE):	1162 (nearest foot) PASSED										
Structure Height (AGL):	599 (nearest foot)										
Current Height (AGL):	(nearest foot)										
<p><i>* For notice of alteration or existing provide the current AGL height of the existing structure. Include details in the Description of Proposal</i></p>											
Minimum Operating Height (AGL):	(nearest foot)										
<p><i>* For aeronautical study of a crane or construction equipment the maximum height should be listed above as the Structure Height (AGL). Additionally, provide the minimum operating height to avoid delays if impacts are identified that require negotiation to a reduced height. If the Structure Height and minimum operating height are the same enter the same value in both fields.</i></p>											
Requested Marking/Lighting:	Red lights and paint										
Recommended Marking/Lighting:	White Paint/Synchronized Red Lights										
Current Marking/Lighting:	N/A Proposed Structure										
Other :	<input type="text"/>										
Nearest City:	New Kirk										
Nearest State:	Oklahoma										
Description of Location:	14 Miles North of New Kirk										
Description of Proposal:	80 WTG Project for electric production										
Structure Summary											
Structure Type:	Wind Turbine *legacy*										
Structure Type:	<input type="text" value="WIND_TURBINE"/> Wind Turbine										
Structure Name:	44										
FDC NOTAM:											
NOTAM Number:											
FCC Number:											
Prior ASN:											
Proposed Frequency Bands											
	<table border="1"> <thead> <tr> <th>Low Freq</th> <th>High Freq</th> <th>Freq Unit</th> <th>ERP</th> <th>ERP Unit</th> </tr> </thead> <tbody> <tr> <td></td> <td></td> <td></td> <td></td> <td></td> </tr> </tbody> </table>	Low Freq	High Freq	Freq Unit	ERP	ERP Unit					
Low Freq	High Freq	Freq Unit	ERP	ERP Unit							





Notice of Proposed Construction or Alteration - Off Airport

[Add a New Case \(Off Airport\) - Desk Reference Guide V_2018.2.1](#)

[Add a New Case \(Off Airport\) for Wind Turbines - Met Towers \(with WT Farm\) - WT-Barge Crane - Desk Reference Guide V_2018.2.1](#)

Project Name: PNEWI-000610356-19

Sponsor: PNE USA

Details for Case : 45

[Show Project Summary](#)

Case Status	
ASN:	2019-WTW-4447-OE
Status:	Determined
7460-2 Forms:	<p>01/13/2021</p> <p>7460-2 (PART 1) required at least 10 days prior to start of construction.</p> <p>Add Supplemental Notice (7460-2)</p>
Public Comments:	None
Date Accepted:	04/22/2019
Date Determined:	08/18/2019
Letters:	<p>03/24/2021 EXT</p> <p>08/18/2019 DNH</p> <p>06/24/2019 NPH</p>
Documents:	<p>None</p> <p>Project Documents:</p> <p>04/22/2019 Chilocco - FAA Fi...</p> <p>04/22/2019 Chilocco - FAA F...</p> <p>04/18/2019 Chilocco - FAA Fi...</p>

Construction / Alteration Information	
Notice Of:	
Duration:	Permanent
if Temporary :	Months: Days:
Work Schedule - Start:	01/01/2020
Work Schedule - End:	01/01/2021
<p><i>*For temporary cranes-Does the permanent structure require separate notice to the FAA? To find out, use the Notice Criteria Tool. If separate notice is required, please ensure it is filed. If it is not filed, please state the reason in the Description of Proposal.</i></p> <p>State Filing:</p>	

Structure Summary	
Structure Type:	Wind Turbine *legacy*
Structure Type:	<input type="text" value="WIND_TURBINE"/> Wind Turbine
Structure Name:	45
FDC NOTAM:	
NOTAM Number:	
FCC Number:	
Prior ASN:	

Structure Details	
Latitude:	36° 59' 40.58" N
Longitude:	97° 3' 55.78" W
Horizontal Datum:	NAD83
Site Elevation (SE):	1149 (nearest foot) PASSED
Structure Height (AGL):	599 (nearest foot)
Current Height (AGL):	(nearest foot)
<p><i>* For notice of alteration or existing provide the current AGL height of the existing structure. Include details in the Description of Proposal</i></p>	
Minimum Operating Height (AGL):	(nearest foot)
<p><i>* For aeronautical study of a crane or construction equipment the maximum height should be listed above as the Structure Height (AGL). Additionally, provide the minimum operating height to avoid delays if impacts are identified that require negotiation to a reduced height. If the Structure Height and minimum operating height are the same enter the same value in both fields.</i></p>	
Requested Marking/Lighting:	Red lights and paint
Recommended Marking/Lighting:	White Paint/Synchronized Red Lights
Current Marking/Lighting:	N/A Proposed Structure
Other :	<input type="text"/>
Nearest City:	New Kirk
Nearest State:	Oklahoma
Description of Location:	14 Miles North of New Kirk
Description of Proposal:	80 WTG Project for electric production

Proposed Frequency Bands				
Low Freq	High Freq	Freq Unit	ERP	ERP Unit





Notice of Proposed Construction or Alteration - Off Airport

[Add a New Case \(Off Airport\) - Desk Reference Guide V_2018.2.1](#)

[Add a New Case \(Off Airport\) for Wind Turbines - Met Towers \(with WT Farm\) - WT-Barge Crane - Desk Reference Guide V_2018.2.1](#)

Project Name: PNEWI-000610356-19

Sponsor: PNE USA

Details for Case : 46

[Show Project Summary](#)

Case Status					
ASN:	2019-WTW-4448-OE				
Status:	Determined				
7460-2 Forms:	<p>01/13/2021</p> <p>7460-2 (PART 1) required at least 10 days prior to start of construction.</p> <p>Add Supplemental Notice (7460-2)</p>				
Public Comments:	None				
Date Accepted:	04/22/2019				
Date Determined:	08/18/2019				
Letters:	<p>03/24/2021 EXT</p> <p>08/18/2019 DNH</p> <p>06/24/2019 NPH</p>				
Documents:	<p>None</p> <p>Project Documents:</p> <p>04/22/2019 Chilocco - FAA Fi...</p> <p>04/22/2019 Chilocco - FAA F...</p> <p>04/18/2019 Chilocco - FAA Fi...</p>				
Construction / Alteration Information					
Notice Of:					
Duration:	Permanent				
if Temporary :	Months: Days:				
Work Schedule - Start:	01/01/2020				
Work Schedule - End:	01/01/2021				
<p><i>*For temporary cranes-Does the permanent structure require separate notice to the FAA? To find out, use the Notice Criteria Tool. If separate notice is required, please ensure it is filed. If it is not filed, please state the reason in the Description of Proposal.</i></p> <p>State Filing:</p>					
Structure Details					
Latitude:	36° 59' 25.53" N				
Longitude:	97° 3' 42.04" W				
Horizontal Datum:	NAD83				
Site Elevation (SE):	1156 (nearest foot) PASSED				
Structure Height (AGL):	599 (nearest foot)				
Current Height (AGL):	(nearest foot)				
<p><i>* For notice of alteration or existing provide the current AGL height of the existing structure. Include details in the Description of Proposal</i></p>					
Minimum Operating Height (AGL):	(nearest foot)				
<p><i>* For aeronautical study of a crane or construction equipment the maximum height should be listed above as the Structure Height (AGL). Additionally, provide the minimum operating height to avoid delays if impacts are identified that require negotiation to a reduced height. If the Structure Height and minimum operating height are the same enter the same value in both fields.</i></p>					
Requested Marking/Lighting:	Red lights and paint				
Recommended Marking/Lighting:	White Paint/Synchronized Red Lights				
Current Marking/Lighting:	N/A Proposed Structure				
Other :	<input type="text"/>				
Nearest City:	New Kirk				
Nearest State:	Oklahoma				
Description of Location:	14 Miles North of New Kirk				
Description of Proposal:	80 WTG Project for electric production				
Structure Summary					
Structure Type:	Wind Turbine *legacy*				
Structure Type:	<input type="text" value="WIND_TURBINE"/> Wind Turbine				
Structure Name:	46				
FDC NOTAM:					
NOTAM Number:					
FCC Number:					
Prior ASN:					
Proposed Frequency Bands					
	Low Freq	High Freq	Freq Unit	ERP	ERP Unit





Notice of Proposed Construction or Alteration - Off Airport

[Add a New Case \(Off Airport\) - Desk Reference Guide V_2018.2.1](#)

[Add a New Case \(Off Airport\) for Wind Turbines - Met Towers \(with WT Farm\) - WT-Barge Crane - Desk Reference Guide V_2018.2.1](#)

Project Name: PNEWI-000610356-19

Sponsor: PNE USA

Details for Case : 47

[Show Project Summary](#)

Case Status											
ASN:	2019-WTW-4449-OE										
Status:	Determined										
7460-2 Forms:	<p>01/13/2021</p> <p>7460-2 (PART 1) required at least 10 days prior to start of construction.</p> <p>Add Supplemental Notice (7460-2)</p>										
Public Comments:	None										
Date Accepted:	04/22/2019										
Date Determined:	08/18/2019										
Letters:	<p>03/24/2021 EXT</p> <p>08/18/2019 DNH</p> <p>06/24/2019 NPH</p>										
Documents:	<p>None</p> <p>Project Documents:</p> <p>04/22/2019 Chilocco - FAA Fi...</p> <p>04/22/2019 Chilocco - FAA F...</p> <p>04/18/2019 Chilocco - FAA Fi...</p>										
Construction / Alteration Information											
Notice Of:											
Duration:	Permanent										
if Temporary :	Months: Days:										
Work Schedule - Start:	01/01/2020										
Work Schedule - End:	01/01/2021										
<p><i>*For temporary cranes-Does the permanent structure require separate notice to the FAA? To find out, use the Notice Criteria Tool. If separate notice is required, please ensure it is filed. If it is not filed, please state the reason in the Description of Proposal.</i></p> <p>State Filing:</p>											
Structure Details											
Latitude:	36° 59' 0.57" N										
Longitude:	97° 3' 27.13" W										
Horizontal Datum:	NAD83										
Site Elevation (SE):	1141 (nearest foot) PASSED										
Structure Height (AGL):	599 (nearest foot)										
Current Height (AGL):	(nearest foot)										
<p><i>* For notice of alteration or existing provide the current AGL height of the existing structure. Include details in the Description of Proposal</i></p>											
Minimum Operating Height (AGL):	(nearest foot)										
<p><i>* For aeronautical study of a crane or construction equipment the maximum height should be listed above as the Structure Height (AGL). Additionally, provide the minimum operating height to avoid delays if impacts are identified that require negotiation to a reduced height. If the Structure Height and minimum operating height are the same enter the same value in both fields.</i></p>											
Requested Marking/Lighting:	Red lights and paint										
Recommended Marking/Lighting:	White Paint/Synchronized Red Lights										
Current Marking/Lighting:	N/A Proposed Structure										
Other :	<input type="text"/>										
Nearest City:	New Kirk										
Nearest State:	Oklahoma										
Description of Location:	14 Miles North of New Kirk										
Description of Proposal:	80 WTG Project for electric production										
Structure Summary											
Structure Type:	Wind Turbine *legacy*										
Structure Type:	<input type="text" value="WIND_TURBINE"/> Wind Turbine										
Structure Name:	47										
FDC NOTAM:											
NOTAM Number:											
FCC Number:											
Prior ASN:											
Proposed Frequency Bands											
	<table border="1"> <thead> <tr> <th>Low Freq</th> <th>High Freq</th> <th>Freq Unit</th> <th>ERP</th> <th>ERP Unit</th> </tr> </thead> <tbody> <tr> <td></td> <td></td> <td></td> <td></td> <td></td> </tr> </tbody> </table>	Low Freq	High Freq	Freq Unit	ERP	ERP Unit					
Low Freq	High Freq	Freq Unit	ERP	ERP Unit							





Notice of Proposed Construction or Alteration - Off Airport

[Add a New Case \(Off Airport\) - Desk Reference Guide V_2018.2.1](#)

[Add a New Case \(Off Airport\) for Wind Turbines - Met Towers \(with WT Farm\) - WT-Barge Crane - Desk Reference Guide V_2018.2.1](#)

Project Name: PNEWI-000610356-19

Sponsor: PNE USA

Details for Case : 48

[Show Project Summary](#)

Case Status											
ASN:	2019-WTW-4450-OE										
Status:	Determined										
7460-2 Forms:	<p>01/13/2021</p> <p>7460-2 (PART 1) required at least 10 days prior to start of construction.</p> <p>Add Supplemental Notice (7460-2)</p>										
Public Comments:	None										
Date Accepted:	04/22/2019										
Date Determined:	08/18/2019										
Letters:	<p>03/24/2021 EXT</p> <p>08/18/2019 DNH</p> <p>06/24/2019 NPH</p>										
Documents:	<p>None</p> <p>Project Documents:</p> <p>04/22/2019 Chilocco - FAA Fi...</p> <p>04/22/2019 Chilocco - FAA F...</p> <p>04/18/2019 Chilocco - FAA Fi...</p>										
Construction / Alteration Information											
Notice Of:											
Duration:	Permanent										
if Temporary :	Months: Days:										
Work Schedule - Start:	01/01/2020										
Work Schedule - End:	01/01/2021										
<p><i>*For temporary cranes-Does the permanent structure require separate notice to the FAA? To find out, use the Notice Criteria Tool. If separate notice is required, please ensure it is filed. If it is not filed, please state the reason in the Description of Proposal.</i></p> <p>State Filing:</p>											
Structure Details											
Latitude:	36° 59' 49.30" N										
Longitude:	97° 3' 31.37" W										
Horizontal Datum:	NAD83										
Site Elevation (SE):	1178 (nearest foot) PASSED										
Structure Height (AGL):	599 (nearest foot)										
Current Height (AGL):	(nearest foot)										
<p><i>* For notice of alteration or existing provide the current AGL height of the existing structure. Include details in the Description of Proposal</i></p>											
Minimum Operating Height (AGL):	(nearest foot)										
<p><i>* For aeronautical study of a crane or construction equipment the maximum height should be listed above as the Structure Height (AGL). Additionally, provide the minimum operating height to avoid delays if impacts are identified that require negotiation to a reduced height. If the Structure Height and minimum operating height are the same enter the same value in both fields.</i></p>											
Requested Marking/Lighting:	Red lights and paint										
Recommended Marking/Lighting:	White Paint/Synchronized Red Lights										
Current Marking/Lighting:	N/A Proposed Structure										
Other :	<input type="text"/>										
Nearest City:	New Kirk										
Nearest State:	Oklahoma										
Description of Location:	14 Miles North of New Kirk										
Description of Proposal:	80 WTG Project for electric production										
Structure Summary											
Structure Type:	Wind Turbine *legacy*										
Structure Type:	<input type="text" value="WIND_TURBINE"/> Wind Turbine										
Structure Name:	48										
FDC NOTAM:											
NOTAM Number:											
FCC Number:											
Prior ASN:											
Proposed Frequency Bands											
	<table border="1"> <thead> <tr> <th>Low Freq</th> <th>High Freq</th> <th>Freq Unit</th> <th>ERP</th> <th>ERP Unit</th> </tr> </thead> <tbody> <tr> <td></td> <td></td> <td></td> <td></td> <td></td> </tr> </tbody> </table>	Low Freq	High Freq	Freq Unit	ERP	ERP Unit					
Low Freq	High Freq	Freq Unit	ERP	ERP Unit							





Notice of Proposed Construction or Alteration - Off Airport

[Add a New Case \(Off Airport\) - Desk Reference Guide V_2018.2.1](#)

[Add a New Case \(Off Airport\) for Wind Turbines - Met Towers \(with WT Farm\) - WT-Barge Crane - Desk Reference Guide V_2018.2.1](#)

Project Name: PNEWI-000610356-19

Sponsor: PNE USA

Details for Case : 49

[Show Project Summary](#)

Case Status					
ASN:	2019-WTW-4451-OE				
Status:	Determined				
7460-2 Forms:	<p>01/13/2021</p> <p>7460-2 (PART 1) required at least 10 days prior to start of construction.</p> <p>Add Supplemental Notice (7460-2)</p>				
Public Comments:	None				
Date Accepted:	04/22/2019				
Date Determined:	08/18/2019				
Letters:	<p>03/24/2021 EXT</p> <p>08/18/2019 DNH</p> <p>06/24/2019 NPH</p>				
Documents:	<p>None</p> <p>Project Documents:</p> <p>04/22/2019 Chilocco - FAA Fi...</p> <p>04/22/2019 Chilocco - FAA F...</p> <p>04/18/2019 Chilocco - FAA Fi...</p>				
Construction / Alteration Information					
Notice Of:					
Duration:	Permanent				
if Temporary :	Months: Days:				
Work Schedule - Start:	01/01/2020				
Work Schedule - End:	01/01/2021				
<p><i>*For temporary cranes-Does the permanent structure require separate notice to the FAA? To find out, use the Notice Criteria Tool. If separate notice is required, please ensure it is filed. If it is not filed, please state the reason in the Description of Proposal.</i></p> <p>State Filing:</p>					
Structure Details					
Latitude:	36° 59' 31.11" N				
Longitude:	97° 3' 28.51" W				
Horizontal Datum:	NAD83				
Site Elevation (SE):	1155 (nearest foot) PASSED				
Structure Height (AGL):	599 (nearest foot)				
Current Height (AGL):	(nearest foot)				
<p><i>* For notice of alteration or existing provide the current AGL height of the existing structure. Include details in the Description of Proposal</i></p>					
Minimum Operating Height (AGL):	(nearest foot)				
<p><i>* For aeronautical study of a crane or construction equipment the maximum height should be listed above as the Structure Height (AGL). Additionally, provide the minimum operating height to avoid delays if impacts are identified that require negotiation to a reduced height. If the Structure Height and minimum operating height are the same enter the same value in both fields.</i></p>					
Requested Marking/Lighting:	Red lights and paint				
Recommended Marking/Lighting:	White Paint/Synchronized Red Lights				
Current Marking/Lighting:	N/A Proposed Structure				
Other :	<input type="text"/>				
Nearest City:	New Kirk				
Nearest State:	Oklahoma				
Description of Location:	14 Miles North of New Kirk				
Description of Proposal:	80 WTG Project for electric production				
Structure Summary					
Structure Type:	Wind Turbine *legacy*				
Structure Type:	<input type="text" value="WIND_TURBINE"/> Wind Turbine				
Structure Name:	49				
FDC NOTAM:					
NOTAM Number:					
FCC Number:					
Prior ASN:					
Proposed Frequency Bands					
	Low Freq	High Freq	Freq Unit	ERP	ERP Unit





Notice of Proposed Construction or Alteration - Off Airport

[Add a New Case \(Off Airport\) - Desk Reference Guide V_2018.2.1](#)[Add a New Case \(Off Airport\) for Wind Turbines - Met Towers \(with WT Farm\) - WT-Barge Crane - Desk Reference Guide V_2018.2.1](#)

Project Name: PNEWI-000610356-19

Sponsor: PNE USA

Details for Case : 50

[Show Project Summary](#)

Case Status					
ASN:	2019-WTW-4452-OE				
Status:	Determined				
7460-2 Forms:	01/13/2021 7460-2 (PART 1) required at least 10 days prior to start of construction. Add Supplemental Notice (7460-2)				
Public Comments:	None				
Date Accepted:	04/22/2019				
Date Determined:	08/18/2019				
Letters:	03/24/2021 EXT 08/18/2019 DNH 06/24/2019 NPH				
Documents:	None Project Documents: 04/22/2019 Chilocco - FAA Fi... 04/22/2019 Chilocco - FAA F.. 04/18/2019 Chilocco - FAA Fi...				
Construction / Alteration Information					
Notice Of:					
Duration:	Permanent				
if Temporary :	Months: Days:				
Work Schedule - Start:	01/01/2020				
Work Schedule - End:	01/01/2021				
*For temporary cranes-Does the permanent structure require separate notice to the FAA? To find out, use the Notice Criteria Tool. If separate notice is required, please ensure it is filed. If it is not filed, please state the reason in the Description of Proposal.					
State Filing:					
Structure Details					
Latitude:	36° 59' 44.71" N				
Longitude:	97° 3' 14.49" W				
Horizontal Datum:	NAD83				
Site Elevation (SE):	1160 (nearest foot) PASSED				
Structure Height (AGL):	599 (nearest foot)				
Current Height (AGL):	(nearest foot)				
* For notice of alteration or existing provide the current AGL height of the existing structure. Include details in the Description of Proposal					
Minimum Operating Height (AGL):	(nearest foot)				
* For aeronautical study of a crane or construction equipment the maximum height should be listed above as the Structure Height (AGL). Additionally, provide the minimum operating height to avoid delays if impacts are identified that require negotiation to a reduced height. If the Structure Height and minimum operating height are the same enter the same value in both fields.					
Requested Marking/Lighting:	Red lights and paint				
Recommended Marking/Lighting:	White Paint/Synchronized Red Lights				
Current Marking/Lighting:	N/A Proposed Structure				
Other :	<input type="text"/>				
Nearest City:	New Kirk				
Nearest State:	Oklahoma				
Description of Location:	14 Miles North of New Kirk				
Description of Proposal:	80 WTG Project for electric production				
Structure Summary					
Structure Type:	Wind Turbine *legacy*				
Structure Type:	<input type="text" value="WIND_TURBINE"/> Wind Turbine				
Structure Name:	50				
FDC NOTAM:					
NOTAM Number:					
FCC Number:					
Prior ASN:					
Proposed Frequency Bands					
	Low Freq	High Freq	Freq Unit	ERP	ERP Unit





Notice of Proposed Construction or Alteration - Off Airport

[Add a New Case \(Off Airport\) - Desk Reference Guide V_2018.2.1](#)

[Add a New Case \(Off Airport\) for Wind Turbines - Met Towers \(with WT Farm\) - WT-Barge Crane - Desk Reference Guide V_2018.2.1](#)

Project Name: PNEWI-000610356-19

Sponsor: PNE USA

Details for Case : 51

[Show Project Summary](#)

Case Status	
ASN:	2019-WTW-4453-OE
Status:	Determined
7460-2 Forms:	<p>01/13/2021</p> <p>7460-2 (PART 1) required at least 10 days prior to start of construction.</p> <p>Add Supplemental Notice (7460-2)</p>
Public Comments:	None
Date Accepted:	04/22/2019
Date Determined:	08/18/2019
Letters:	<p>03/24/2021 EXT</p> <p>08/18/2019 DNH</p> <p>06/24/2019 NPH</p>
Documents:	<p>None</p> <p>Project Documents:</p> <p>04/22/2019 Chilocco - FAA Fi...</p> <p>04/22/2019 Chilocco - FAA F...</p> <p>04/18/2019 Chilocco - FAA Fi...</p>

Construction / Alteration Information	
Notice Of:	
Duration:	Permanent
if Temporary :	Months: Days:
Work Schedule - Start:	01/01/2020
Work Schedule - End:	01/01/2021
<p><i>*For temporary cranes-Does the permanent structure require separate notice to the FAA? To find out, use the Notice Criteria Tool. If separate notice is required, please ensure it is filed. If it is not filed, please state the reason in the Description of Proposal.</i></p> <p>State Filing:</p>	

Structure Summary	
Structure Type:	Wind Turbine *legacy*
Structure Type:	<input type="text" value="WIND_TURBINE"/> Wind Turbine
Structure Name:	51
FDC NOTAM:	
NOTAM Number:	
FCC Number:	
Prior ASN:	

Structure Details	
Latitude:	36° 59' 1.15" N
Longitude:	97° 3' 10.58" W
Horizontal Datum:	NAD83
Site Elevation (SE):	1149 (nearest foot) PASSED
Structure Height (AGL):	599 (nearest foot)
Current Height (AGL):	(nearest foot)
<p><i>* For notice of alteration or existing provide the current AGL height of the existing structure. Include details in the Description of Proposal</i></p>	
Minimum Operating Height (AGL):	(nearest foot)
<p><i>* For aeronautical study of a crane or construction equipment the maximum height should be listed above as the Structure Height (AGL). Additionally, provide the minimum operating height to avoid delays if impacts are identified that require negotiation to a reduced height. If the Structure Height and minimum operating height are the same enter the same value in both fields.</i></p>	
Requested Marking/Lighting:	Red lights and paint
Recommended Marking/Lighting:	White Paint/Synchronized Red Lights
Current Marking/Lighting:	N/A Proposed Structure
Other :	<input type="text"/>
Nearest City:	New Kirk
Nearest State:	Oklahoma
Description of Location:	14 Miles North of New Kirk
Description of Proposal:	80 WTG Project for electric production

Proposed Frequency Bands				
Low Freq	High Freq	Freq Unit	ERP	ERP Unit





Notice of Proposed Construction or Alteration - Off Airport

[Add a New Case \(Off Airport\) - Desk Reference Guide V_2018.2.1](#)

[Add a New Case \(Off Airport\) for Wind Turbines - Met Towers \(with WT Farm\) - WT-Barge Crane - Desk Reference Guide V_2018.2.1](#)

Project Name: PNEWI-000610356-19

Sponsor: PNE USA

Details for Case : 52

[Show Project Summary](#)

Case Status				
ASN:	2019-WTW-4454-OE			
Status:	Determined			
7460-2 Forms:	<p>01/13/2021</p> <p>7460-2 (PART 1) required at least 10 days prior to start of construction.</p> <p>Add Supplemental Notice (7460-2)</p>			
Public Comments:	None			
Date Accepted:	04/22/2019			
Date Determined:	08/18/2019			
Letters:	<p>03/24/2021 EXT</p> <p>08/18/2019 DNH</p> <p>06/24/2019 NPH</p>			
Documents:	<p>None</p> <p>Project Documents:</p> <p>04/22/2019 Chilocco - FAA Fi...</p> <p>04/22/2019 Chilocco - FAA F...</p> <p>04/18/2019 Chilocco - FAA Fi...</p>			
Construction / Alteration Information				
Notice Of:				
Duration:	Permanent			
if Temporary :	Months: Days:			
Work Schedule - Start:	01/01/2020			
Work Schedule - End:	01/01/2021			
<p><i>*For temporary cranes-Does the permanent structure require separate notice to the FAA? To find out, use the Notice Criteria Tool. If separate notice is required, please ensure it is filed. If it is not filed, please state the reason in the Description of Proposal.</i></p> <p>State Filing:</p>				
Structure Details				
Latitude:	36° 59' 18.03" N			
Longitude:	97° 3' 6.40" W			
Horizontal Datum:	NAD83			
Site Elevation (SE):	1152 (nearest foot) PASSED			
Structure Height (AGL):	599 (nearest foot)			
Current Height (AGL):	(nearest foot)			
<p><i>* For notice of alteration or existing provide the current AGL height of the existing structure. Include details in the Description of Proposal</i></p>				
Minimum Operating Height (AGL):	(nearest foot)			
<p><i>* For aeronautical study of a crane or construction equipment the maximum height should be listed above as the Structure Height (AGL). Additionally, provide the minimum operating height to avoid delays if impacts are identified that require negotiation to a reduced height. If the Structure Height and minimum operating height are the same enter the same value in both fields.</i></p>				
Requested Marking/Lighting:	Red lights and paint			
Recommended Marking/Lighting:	White Paint/Synchronized Red Lights			
Current Marking/Lighting:	N/A Proposed Structure			
Other :	<input type="text"/>			
Nearest City:	New Kirk			
Nearest State:	Oklahoma			
Description of Location:	14 Miles North of New Kirk			
Description of Proposal:	80 WTG Project for electric production			
Structure Summary				
Structure Type:	Wind Turbine *legacy*			
Structure Type:	<input type="text" value="WIND_TURBINE"/> Wind Turbine			
Structure Name:	52			
FDC NOTAM:				
NOTAM Number:				
FCC Number:				
Prior ASN:				
Proposed Frequency Bands				
Low Freq	High Freq	Freq Unit	ERP	ERP Unit





Notice of Proposed Construction or Alteration - Off Airport

[Add a New Case \(Off Airport\) - Desk Reference Guide V_2018.2.1](#)

[Add a New Case \(Off Airport\) for Wind Turbines - Met Towers \(with WT Farm\) - WT-Barge Crane - Desk Reference Guide V_2018.2.1](#)

Project Name: PNEWI-000610356-19

Sponsor: PNE USA

Details for Case : 53

[Show Project Summary](#)

Case Status	
ASN:	2019-WTW-4455-OE
Status:	Determined
7460-2 Forms:	<p>01/13/2021</p> <p>7460-2 (PART 1) required at least 10 days prior to start of construction.</p> <p>Add Supplemental Notice (7460-2)</p>
Public Comments:	None
Date Accepted:	04/22/2019
Date Determined:	08/18/2019
Letters:	<p>03/24/2021 EXT</p> <p>08/18/2019 DNH</p> <p>06/24/2019 NPH</p>
Documents:	<p>None</p> <p>Project Documents:</p> <p>04/22/2019 Chilocco - FAA Fi...</p> <p>04/22/2019 Chilocco - FAA F...</p> <p>04/18/2019 Chilocco - FAA Fi...</p>

Construction / Alteration Information	
Notice Of:	
Duration:	Permanent
if Temporary :	Months: Days:
Work Schedule - Start:	01/01/2020
Work Schedule - End:	01/01/2021
<p><i>*For temporary cranes-Does the permanent structure require separate notice to the FAA? To find out, use the Notice Criteria Tool. If separate notice is required, please ensure it is filed. If it is not filed, please state the reason in the Description of Proposal.</i></p> <p>State Filing:</p>	

Structure Summary	
Structure Type:	Wind Turbine *legacy*
Structure Type:	<input type="text" value="WIND_TURBINE"/> Wind Turbine
Structure Name:	53
FDC NOTAM:	
NOTAM Number:	
FCC Number:	
Prior ASN:	

Structure Details	
Latitude:	36° 59' 41.63" N
Longitude:	97° 2' 59.00" W
Horizontal Datum:	NAD83
Site Elevation (SE):	1165 (nearest foot) PASSED
Structure Height (AGL):	599 (nearest foot)
Current Height (AGL):	(nearest foot)
<p><i>* For notice of alteration or existing provide the current AGL height of the existing structure. Include details in the Description of Proposal</i></p>	
Minimum Operating Height (AGL):	(nearest foot)
<p><i>* For aeronautical study of a crane or construction equipment the maximum height should be listed above as the Structure Height (AGL). Additionally, provide the minimum operating height to avoid delays if impacts are identified that require negotiation to a reduced height. If the Structure Height and minimum operating height are the same enter the same value in both fields.</i></p>	
Requested Marking/Lighting:	Red lights and paint
Recommended Marking/Lighting:	White Paint/Synchronized Red Lights
Current Marking/Lighting:	N/A Proposed Structure
Other :	<input type="text"/>
Nearest City:	New Kirk
Nearest State:	Oklahoma
Description of Location:	14 Miles North of New Kirk
Description of Proposal:	80 WTG Project for electric production

Proposed Frequency Bands				
Low Freq	High Freq	Freq Unit	ERP	ERP Unit





Notice of Proposed Construction or Alteration - Off Airport

[Add a New Case \(Off Airport\) - Desk Reference Guide V_2018.2.1](#)

[Add a New Case \(Off Airport\) for Wind Turbines - Met Towers \(with WT Farm\) - WT-Barge Crane - Desk Reference Guide V_2018.2.1](#)

Project Name: PNEWI-000610356-19

Sponsor: PNE USA

Details for Case : 54

[Show Project Summary](#)

Case Status					
ASN:	2019-WTW-4456-OE				
Status:	Determined				
7460-2 Forms:	<p>01/13/2021</p> <p>7460-2 (PART 1) required at least 10 days prior to start of construction.</p> <p>Add Supplemental Notice (7460-2)</p>				
Public Comments:	None				
Date Accepted:	04/22/2019				
Date Determined:	08/18/2019				
Letters:	<p>03/24/2021 EXT</p> <p>08/18/2019 DNH</p> <p>06/24/2019 NPH</p>				
Documents:	<p>None</p> <p>Project Documents:</p> <p>04/22/2019 Chilocco - FAA Fi...</p> <p>04/22/2019 Chilocco - FAA F...</p> <p>04/18/2019 Chilocco - FAA Fi...</p>				
Construction / Alteration Information					
Notice Of:					
Duration:	Permanent				
if Temporary :	Months: Days:				
Work Schedule - Start:	01/01/2020				
Work Schedule - End:	01/01/2021				
<p><i>*For temporary cranes-Does the permanent structure require separate notice to the FAA? To find out, use the Notice Criteria Tool. If separate notice is required, please ensure it is filed. If it is not filed, please state the reason in the Description of Proposal.</i></p> <p>State Filing:</p>					
Structure Details					
Latitude:	36° 59' 1.21" N				
Longitude:	97° 2' 55.99" W				
Horizontal Datum:	NAD83				
Site Elevation (SE):	1147 (nearest foot) PASSED				
Structure Height (AGL):	599 (nearest foot)				
Current Height (AGL):	(nearest foot)				
<p><i>* For notice of alteration or existing provide the current AGL height of the existing structure. Include details in the Description of Proposal</i></p>					
Minimum Operating Height (AGL):	(nearest foot)				
<p><i>* For aeronautical study of a crane or construction equipment the maximum height should be listed above as the Structure Height (AGL). Additionally, provide the minimum operating height to avoid delays if impacts are identified that require negotiation to a reduced height. If the Structure Height and minimum operating height are the same enter the same value in both fields.</i></p>					
Requested Marking/Lighting:	Red lights and paint				
Recommended Marking/Lighting:	White Paint/Synchronized Red Lights				
Current Marking/Lighting:	N/A Proposed Structure				
Other :	<input type="text"/>				
Nearest City:	New Kirk				
Nearest State:	Oklahoma				
Description of Location:	14 Miles North of New Kirk				
Description of Proposal:	80 WTG Project for electric production				
Structure Summary					
Structure Type:	Wind Turbine *legacy*				
Structure Type:	<input type="text" value="WIND_TURBINE"/> Wind Turbine				
Structure Name:	54				
FDC NOTAM:					
NOTAM Number:					
FCC Number:					
Prior ASN:					
Proposed Frequency Bands					
	Low Freq	High Freq	Freq Unit	ERP	ERP Unit





Notice of Proposed Construction or Alteration - Off Airport

[Add a New Case \(Off Airport\) - Desk Reference Guide V_2018.2.1](#)

[Add a New Case \(Off Airport\) for Wind Turbines - Met Towers \(with WT Farm\) - WT-Barge Crane - Desk Reference Guide V_2018.2.1](#)

Project Name: PNEWI-000610356-19

Sponsor: PNE USA

Details for Case : 55

[Show Project Summary](#)

Case Status											
ASN:	2019-WTW-4457-OE										
Status:	Determined										
7460-2 Forms:	<p>01/13/2021</p> <p>7460-2 (PART 1) required at least 10 days prior to start of construction.</p> <p>Add Supplemental Notice (7460-2)</p>										
Public Comments:	None										
Date Accepted:	04/22/2019										
Date Determined:	08/18/2019										
Letters:	<p>03/24/2021 EXT</p> <p>08/18/2019 DNH</p> <p>06/24/2019 NPH</p>										
Documents:	<p>None</p> <p>Project Documents:</p> <p>04/22/2019 Chilocco - FAA Fi...</p> <p>04/22/2019 Chilocco - FAA F...</p> <p>04/18/2019 Chilocco - FAA Fi...</p>										
Construction / Alteration Information											
Notice Of:											
Duration:	Permanent										
if Temporary :	Months: Days:										
Work Schedule - Start:	01/01/2020										
Work Schedule - End:	01/01/2021										
<p><i>*For temporary cranes-Does the permanent structure require separate notice to the FAA? To find out, use the Notice Criteria Tool. If separate notice is required, please ensure it is filed. If it is not filed, please state the reason in the Description of Proposal.</i></p> <p>State Filing:</p>											
Structure Details											
Latitude:	36° 59' 32.01" N										
Longitude:	97° 2' 50.57" W										
Horizontal Datum:	NAD83										
Site Elevation (SE):	1150 (nearest foot) PASSED										
Structure Height (AGL):	599 (nearest foot)										
Current Height (AGL):	(nearest foot)										
<p><i>* For notice of alteration or existing provide the current AGL height of the existing structure. Include details in the Description of Proposal</i></p>											
Minimum Operating Height (AGL):	(nearest foot)										
<p><i>* For aeronautical study of a crane or construction equipment the maximum height should be listed above as the Structure Height (AGL). Additionally, provide the minimum operating height to avoid delays if impacts are identified that require negotiation to a reduced height. If the Structure Height and minimum operating height are the same enter the same value in both fields.</i></p>											
Requested Marking/Lighting:	Red lights and paint										
Recommended Marking/Lighting:	White Paint/Synchronized Red Lights										
Current Marking/Lighting:	N/A Proposed Structure										
Other :	<input type="text"/>										
Nearest City:	New Kirk										
Nearest State:	Oklahoma										
Description of Location:	14 Miles North of New Kirk										
Description of Proposal:	80 WTG Project for electric production										
Structure Summary											
Structure Type:	Wind Turbine *legacy*										
Structure Type:	<input type="text" value="WIND_TURBINE"/> Wind Turbine										
Structure Name:	55										
FDC NOTAM:											
NOTAM Number:											
FCC Number:											
Prior ASN:											
Proposed Frequency Bands											
	<table border="1"> <thead> <tr> <th>Low Freq</th> <th>High Freq</th> <th>Freq Unit</th> <th>ERP</th> <th>ERP Unit</th> </tr> </thead> <tbody> <tr> <td></td> <td></td> <td></td> <td></td> <td></td> </tr> </tbody> </table>	Low Freq	High Freq	Freq Unit	ERP	ERP Unit					
Low Freq	High Freq	Freq Unit	ERP	ERP Unit							





Notice of Proposed Construction or Alteration - Off Airport

[Add a New Case \(Off Airport\) - Desk Reference Guide V_2018.2.1](#)

[Add a New Case \(Off Airport\) for Wind Turbines - Met Towers \(with WT Farm\) - WT-Barge Crane - Desk Reference Guide V_2018.2.1](#)

Project Name: PNEWI-000610356-19

Sponsor: PNE USA

Details for Case : 56

[Show Project Summary](#)

Case Status					
ASN:	2019-WTW-4458-OE				
Status:	Determined				
7460-2 Forms:	<p>01/13/2021</p> <p>7460-2 (PART 1) required at least 10 days prior to start of construction.</p> <p>Add Supplemental Notice (7460-2)</p>				
Public Comments:	None				
Date Accepted:	04/22/2019				
Date Determined:	08/18/2019				
Letters:	<p>03/24/2021 EXT</p> <p>08/18/2019 DNH</p> <p>06/24/2019 NPH</p>				
Documents:	<p>None</p> <p>Project Documents:</p> <p>04/22/2019 Chilocco - FAA Fi...</p> <p>04/22/2019 Chilocco - FAA F...</p> <p>04/18/2019 Chilocco - FAA Fi...</p>				
Construction / Alteration Information					
Notice Of:					
Duration:	Permanent				
if Temporary :	Months: Days:				
Work Schedule - Start:	01/01/2020				
Work Schedule - End:	01/01/2021				
<p><i>*For temporary cranes-Does the permanent structure require separate notice to the FAA? To find out, use the Notice Criteria Tool. If separate notice is required, please ensure it is filed. If it is not filed, please state the reason in the Description of Proposal.</i></p> <p>State Filing:</p>					
Structure Details					
Latitude:	36° 59' 46.67" N				
Longitude:	97° 2' 32.01" W				
Horizontal Datum:	NAD83				
Site Elevation (SE):	1162 (nearest foot) PASSED				
Structure Height (AGL):	599 (nearest foot)				
Current Height (AGL):	(nearest foot)				
<p><i>* For notice of alteration or existing provide the current AGL height of the existing structure. Include details in the Description of Proposal</i></p>					
Minimum Operating Height (AGL):	(nearest foot)				
<p><i>* For aeronautical study of a crane or construction equipment the maximum height should be listed above as the Structure Height (AGL). Additionally, provide the minimum operating height to avoid delays if impacts are identified that require negotiation to a reduced height. If the Structure Height and minimum operating height are the same enter the same value in both fields.</i></p>					
Requested Marking/Lighting:	Red lights and paint				
Recommended Marking/Lighting:	White Paint/Synchronized Red Lights				
Current Marking/Lighting:	N/A Proposed Structure				
Other :	<input type="text"/>				
Nearest City:	New Kirk				
Nearest State:	Oklahoma				
Description of Location:	14 Miles North of New Kirk				
Description of Proposal:	80 WTG Project for electric production				
Structure Summary					
Structure Type:	Wind Turbine *legacy*				
Structure Type:	<input type="text" value="WIND_TURBINE"/> Wind Turbine				
Structure Name:	56				
FDC NOTAM:					
NOTAM Number:					
FCC Number:					
Prior ASN:					
Proposed Frequency Bands					
	Low Freq	High Freq	Freq Unit	ERP	ERP Unit





Notice of Proposed Construction or Alteration - Off Airport

[Add a New Case \(Off Airport\) - Desk Reference Guide V_2018.2.1](#)

[Add a New Case \(Off Airport\) for Wind Turbines - Met Towers \(with WT Farm\) - WT-Barge Crane - Desk Reference Guide V_2018.2.1](#)

Project Name: PNEWI-000610356-19

Sponsor: PNE USA

Details for Case : 57

[Show Project Summary](#)

Case Status	
ASN:	2019-WTW-4459-OE
Status:	Determined
7460-2 Forms:	<p>01/13/2021</p> <p>7460-2 (PART 1) required at least 10 days prior to start of construction.</p> <p>Add Supplemental Notice (7460-2)</p>
Public Comments:	None
Date Accepted:	04/22/2019
Date Determined:	08/18/2019
Letters:	<p>03/24/2021 EXT</p> <p>08/18/2019 DNH</p> <p>06/24/2019 NPH</p>
Documents:	<p>None</p> <p>Project Documents:</p> <p>04/22/2019 Chilocco - FAA Fi...</p> <p>04/22/2019 Chilocco - FAA F...</p> <p>04/18/2019 Chilocco - FAA Fi...</p>

Construction / Alteration Information	
Notice Of:	
Duration:	Permanent
if Temporary :	Months: Days:
Work Schedule - Start:	01/01/2020
Work Schedule - End:	01/01/2021
<p><i>*For temporary cranes-Does the permanent structure require separate notice to the FAA? To find out, use the Notice Criteria Tool. If separate notice is required, please ensure it is filed. If it is not filed, please state the reason in the Description of Proposal.</i></p> <p>State Filing:</p>	

Structure Summary	
Structure Type:	Wind Turbine *legacy*
Structure Type:	<input type="text" value="WIND_TURBINE"/> Wind Turbine
Structure Name:	57
FDC NOTAM:	
NOTAM Number:	
FCC Number:	
Prior ASN:	

Structure Details	
Latitude:	36° 59' 37.74" N
Longitude:	97° 2' 15.90" W
Horizontal Datum:	NAD83
Site Elevation (SE):	1162 (nearest foot) PASSED
Structure Height (AGL):	599 (nearest foot)
Current Height (AGL):	(nearest foot)
<p><i>* For notice of alteration or existing provide the current AGL height of the existing structure. Include details in the Description of Proposal</i></p>	
Minimum Operating Height (AGL):	(nearest foot)
<p><i>* For aeronautical study of a crane or construction equipment the maximum height should be listed above as the Structure Height (AGL). Additionally, provide the minimum operating height to avoid delays if impacts are identified that require negotiation to a reduced height. If the Structure Height and minimum operating height are the same enter the same value in both fields.</i></p>	
Requested Marking/Lighting:	Red lights and paint
Recommended Marking/Lighting:	White Paint/Synchronized Red Lights
Current Marking/Lighting:	N/A Proposed Structure
Other :	<input type="text"/>
Nearest City:	New Kirk
Nearest State:	Oklahoma
Description of Location:	14 Miles North of New Kirk
Description of Proposal:	80 WTG Project for electric production

Proposed Frequency Bands				
Low Freq	High Freq	Freq Unit	ERP	ERP Unit





Notice of Proposed Construction or Alteration - Off Airport

[Add a New Case \(Off Airport\) - Desk Reference Guide V_2018.2.1](#)

[Add a New Case \(Off Airport\) for Wind Turbines - Met Towers \(with WT Farm\) - WT-Barge Crane - Desk Reference Guide V_2018.2.1](#)

Project Name: PNEWI-000610356-19

Sponsor: PNE USA

Details for Case : 58

[Show Project Summary](#)

Case Status	
ASN:	2019-WTW-4460-OE
Status:	Determined
7460-2 Forms:	<p>01/13/2021</p> <p>7460-2 (PART 1) required at least 10 days prior to start of construction.</p> <p>Add Supplemental Notice (7460-2)</p>
Public Comments:	None
Date Accepted:	04/22/2019
Date Determined:	08/18/2019
Letters:	<p>03/24/2021 EXT</p> <p>08/18/2019 DNH</p> <p>06/24/2019 NPH</p>
Documents:	<p>None</p> <p>Project Documents:</p> <p>04/22/2019 Chilocco - FAA Fi...</p> <p>04/22/2019 Chilocco - FAA F...</p> <p>04/18/2019 Chilocco - FAA Fi...</p>

Construction / Alteration Information	
Notice Of:	
Duration:	Permanent
if Temporary :	Months: Days:
Work Schedule - Start:	01/01/2020
Work Schedule - End:	01/01/2021
<p><i>*For temporary cranes-Does the permanent structure require separate notice to the FAA? To find out, use the Notice Criteria Tool. If separate notice is required, please ensure it is filed. If it is not filed, please state the reason in the Description of Proposal.</i></p> <p>State Filing:</p>	

Structure Summary	
Structure Type:	Wind Turbine *legacy*
Structure Type:	<input type="text" value="WIND_TURBINE"/> Wind Turbine
Structure Name:	58
FDC NOTAM:	
NOTAM Number:	
FCC Number:	
Prior ASN:	

Structure Details	
Latitude:	36° 59' 19.66" N
Longitude:	97° 2' 17.45" W
Horizontal Datum:	NAD83
Site Elevation (SE):	1152 (nearest foot) PASSED
Structure Height (AGL):	599 (nearest foot)
Current Height (AGL):	(nearest foot)
<p><i>* For notice of alteration or existing provide the current AGL height of the existing structure. Include details in the Description of Proposal</i></p>	
Minimum Operating Height (AGL):	(nearest foot)
<p><i>* For aeronautical study of a crane or construction equipment the maximum height should be listed above as the Structure Height (AGL). Additionally, provide the minimum operating height to avoid delays if impacts are identified that require negotiation to a reduced height. If the Structure Height and minimum operating height are the same enter the same value in both fields.</i></p>	
Requested Marking/Lighting:	Red lights and paint
Recommended Marking/Lighting:	White Paint/Synchronized Red Lights
Current Marking/Lighting:	N/A Proposed Structure
Other :	<input type="text"/>
Nearest City:	New Kirk
Nearest State:	Oklahoma
Description of Location:	14 Miles North of New Kirk
Description of Proposal:	80 WTG Project for electric production

Proposed Frequency Bands				
Low Freq	High Freq	Freq Unit	ERP	ERP Unit





Notice of Proposed Construction or Alteration - Off Airport

[Add a New Case \(Off Airport\) - Desk Reference Guide V_2018.2.1](#)

[Add a New Case \(Off Airport\) for Wind Turbines - Met Towers \(with WT Farm\) - WT-Barge Crane - Desk Reference Guide V_2018.2.1](#)

Project Name: PNEWI-000610356-19

Sponsor: PNE USA

Details for Case : 59

[Show Project Summary](#)

Case Status	
ASN:	2019-WTW-4461-OE
Status:	Determined
7460-2 Forms:	<p>01/13/2021</p> <p>7460-2 (PART 1) required at least 10 days prior to start of construction.</p> <p>Add Supplemental Notice (7460-2)</p>
Public Comments:	None
Date Accepted:	04/22/2019
Date Determined:	08/18/2019
Letters:	<p>03/24/2021 EXT</p> <p>08/18/2019 DNH</p> <p>06/24/2019 NPH</p>
Documents:	<p>None</p> <p>Project Documents:</p> <p>04/22/2019 Chilocco - FAA Fi...</p> <p>04/22/2019 Chilocco - FAA F...</p> <p>04/18/2019 Chilocco - FAA Fi...</p>

Construction / Alteration Information	
Notice Of:	
Duration:	Permanent
if Temporary :	Months: Days:
Work Schedule - Start:	01/01/2020
Work Schedule - End:	01/01/2021
<p><i>*For temporary cranes-Does the permanent structure require separate notice to the FAA? To find out, use the Notice Criteria Tool. If separate notice is required, please ensure it is filed. If it is not filed, please state the reason in the Description of Proposal.</i></p> <p>State Filing:</p>	

Structure Summary	
Structure Type:	Wind Turbine *legacy*
Structure Type:	<input type="text" value="WIND_TURBINE"/> Wind Turbine
Structure Name:	59
FDC NOTAM:	
NOTAM Number:	
FCC Number:	
Prior ASN:	

Structure Details	
Latitude:	36° 59' 40.13" N
Longitude:	97° 1' 56.06" W
Horizontal Datum:	NAD83
Site Elevation (SE):	1152 (nearest foot) PASSED
Structure Height (AGL):	599 (nearest foot)
Current Height (AGL):	(nearest foot)
<p><i>* For notice of alteration or existing provide the current AGL height of the existing structure. Include details in the Description of Proposal</i></p>	
Minimum Operating Height (AGL):	(nearest foot)
<p><i>* For aeronautical study of a crane or construction equipment the maximum height should be listed above as the Structure Height (AGL). Additionally, provide the minimum operating height to avoid delays if impacts are identified that require negotiation to a reduced height. If the Structure Height and minimum operating height are the same enter the same value in both fields.</i></p>	
Requested Marking/Lighting:	Red lights and paint
Recommended Marking/Lighting:	White Paint/Synchronized Red Lights
Current Marking/Lighting:	N/A Proposed Structure
Other :	<input type="text"/>
Nearest City:	New Kirk
Nearest State:	Oklahoma
Description of Location:	14 Miles North of New Kirk
Description of Proposal:	80 WTG Project for electric production

Proposed Frequency Bands				
Low Freq	High Freq	Freq Unit	ERP	ERP Unit





Notice of Proposed Construction or Alteration - Off Airport

[Add a New Case \(Off Airport\) - Desk Reference Guide V_2018.2.1](#)

[Add a New Case \(Off Airport\) for Wind Turbines - Met Towers \(with WT Farm\) - WT-Barge Crane - Desk Reference Guide V_2018.2.1](#)

Project Name: PNEWI-000610356-19

Sponsor: PNE USA

Details for Case : 60

[Show Project Summary](#)

Case Status					
ASN:	2019-WTW-4462-OE				
Status:	Determined				
7460-2 Forms:	<p>01/13/2021</p> <p>7460-2 (PART 1) required at least 10 days prior to start of construction.</p> <p>Add Supplemental Notice (7460-2)</p>				
Public Comments:	None				
Date Accepted:	04/22/2019				
Date Determined:	08/18/2019				
Letters:	<p>03/24/2021 EXT</p> <p>08/18/2019 DNH</p> <p>06/24/2019 NPH</p>				
Documents:	<p>None</p> <p>Project Documents:</p> <p>04/22/2019 Chilocco - FAA Fi...</p> <p>04/22/2019 Chilocco - FAA F...</p> <p>04/18/2019 Chilocco - FAA Fi...</p>				
Construction / Alteration Information					
Notice Of:					
Duration:	Permanent				
if Temporary :	Months: Days:				
Work Schedule - Start:	01/01/2020				
Work Schedule - End:	01/01/2021				
<p><i>*For temporary cranes-Does the permanent structure require separate notice to the FAA? To find out, use the Notice Criteria Tool. If separate notice is required, please ensure it is filed. If it is not filed, please state the reason in the Description of Proposal.</i></p> <p>State Filing:</p>					
Structure Details					
Latitude:	36° 59' 26.22" N				
Longitude:	97° 1' 57.07" W				
Horizontal Datum:	NAD83				
Site Elevation (SE):	1138 (nearest foot) PASSED				
Structure Height (AGL):	599 (nearest foot)				
Current Height (AGL):	(nearest foot)				
<p><i>* For notice of alteration or existing provide the current AGL height of the existing structure. Include details in the Description of Proposal</i></p>					
Minimum Operating Height (AGL):	(nearest foot)				
<p><i>* For aeronautical study of a crane or construction equipment the maximum height should be listed above as the Structure Height (AGL). Additionally, provide the minimum operating height to avoid delays if impacts are identified that require negotiation to a reduced height. If the Structure Height and minimum operating height are the same enter the same value in both fields.</i></p>					
Requested Marking/Lighting:	Red lights and paint				
Recommended Marking/Lighting:	White Paint/Synchronized Red Lights				
Current Marking/Lighting:	N/A Proposed Structure				
Other :	<input type="text"/>				
Nearest City:	New Kirk				
Nearest State:	Oklahoma				
Description of Location:	14 Miles North of New Kirk				
Description of Proposal:	80 WTG Project for electric production				
Structure Summary					
Structure Type:	Wind Turbine *legacy*				
Structure Type:	<input type="text" value="WIND_TURBINE"/> Wind Turbine				
Structure Name:	60				
FDC NOTAM:					
NOTAM Number:					
FCC Number:					
Prior ASN:					
Proposed Frequency Bands					
	Low Freq	High Freq	Freq Unit	ERP	ERP Unit





Notice of Proposed Construction or Alteration - Off Airport

[Add a New Case \(Off Airport\) - Desk Reference Guide V_2018.2.1](#)

[Add a New Case \(Off Airport\) for Wind Turbines - Met Towers \(with WT Farm\) - WT-Barge Crane - Desk Reference Guide V_2018.2.1](#)

Project Name: PNEWI-000610357-19

Sponsor: PNE USA

Details for Case : 61

[Show Project Summary](#)

Case Status											
ASN:	2019-WTW-4463-OE										
Status:	Determined										
7460-2 Forms:	<p>01/13/2021</p> <p>7460-2 (PART 1) required at least 10 days prior to start of construction.</p> <p>Add Supplemental Notice (7460-2)</p>										
Public Comments:	None										
Date Accepted:	04/22/2019										
Date Determined:	08/18/2019										
Letters:	<p>03/24/2021 EXT</p> <p>08/18/2019 DNH</p> <p>06/24/2019 NPH</p>										
Documents:	<p>None</p> <p>Project Documents:</p> <p>04/22/2019 Chilocco - FAA Fi...</p> <p>04/22/2019 Chilocco - FAA F...</p> <p>04/18/2019 Chilocco - FAA Fi...</p>										
Construction / Alteration Information											
Notice Of:											
Duration:	Permanent										
if Temporary :	Months: Days:										
Work Schedule - Start:	01/01/2020										
Work Schedule - End:	01/01/2021										
<p><i>*For temporary cranes-Does the permanent structure require separate notice to the FAA? To find out, use the Notice Criteria Tool. If separate notice is required, please ensure it is filed. If it is not filed, please state the reason in the Description of Proposal.</i></p> <p>State Filing:</p>											
Structure Details											
Latitude:	36° 59' 0.58" N										
Longitude:	97° 2' 17.70" W										
Horizontal Datum:	NAD83										
Site Elevation (SE):	1146 (nearest foot) PASSED										
Structure Height (AGL):	599 (nearest foot)										
Current Height (AGL):	(nearest foot)										
<p><i>* For notice of alteration or existing provide the current AGL height of the existing structure. Include details in the Description of Proposal</i></p>											
Minimum Operating Height (AGL):	(nearest foot)										
<p><i>* For aeronautical study of a crane or construction equipment the maximum height should be listed above as the Structure Height (AGL). Additionally, provide the minimum operating height to avoid delays if impacts are identified that require negotiation to a reduced height. If the Structure Height and minimum operating height are the same enter the same value in both fields.</i></p>											
Requested Marking/Lighting:	Red lights and paint										
Recommended Marking/Lighting:	White Paint/Synchronized Red Lights										
Current Marking/Lighting:	N/A Proposed Structure										
Other :	<input type="text"/>										
Nearest City:	New Kirk										
Nearest State:	Oklahoma										
Description of Location:	14 Miles North of New Kirk										
Description of Proposal:	80 WTG Project for electric production										
Structure Summary											
Structure Type:	Wind Turbine *legacy*										
Structure Type:	<input type="text" value="WIND_TURBINE"/> Wind Turbine										
Structure Name:	61										
FDC NOTAM:											
NOTAM Number:											
FCC Number:											
Prior ASN:											
Proposed Frequency Bands											
	<table border="1"> <thead> <tr> <th>Low Freq</th> <th>High Freq</th> <th>Freq Unit</th> <th>ERP</th> <th>ERP Unit</th> </tr> </thead> <tbody> <tr> <td></td> <td></td> <td></td> <td></td> <td></td> </tr> </tbody> </table>	Low Freq	High Freq	Freq Unit	ERP	ERP Unit					
Low Freq	High Freq	Freq Unit	ERP	ERP Unit							





Notice of Proposed Construction or Alteration - Off Airport

[Add a New Case \(Off Airport\) - Desk Reference Guide V_2018.2.1](#)

[Add a New Case \(Off Airport\) for Wind Turbines - Met Towers \(with WT Farm\) - WT-Barge Crane - Desk Reference Guide V_2018.2.1](#)

Project Name: PNEWI-000610357-19

Sponsor: PNE USA

Details for Case : 61

[Show Project Summary](#)

Case Status	
ASN:	2019-WTW-4463-OE
Status:	Determined
7460-2 Forms:	<p>01/13/2021</p> <p>7460-2 (PART 1) required at least 10 days prior to start of construction.</p> <p>Add Supplemental Notice (7460-2)</p>
Public Comments:	None
Date Accepted:	04/22/2019
Date Determined:	08/18/2019
Letters:	<p>03/24/2021 EXT</p> <p>08/18/2019 DNH</p> <p>06/24/2019 NPH</p>
Documents:	<p>None</p> <p>Project Documents:</p> <p>04/22/2019 Chilocco - FAA Fi...</p> <p>04/22/2019 Chilocco - FAA F...</p> <p>04/18/2019 Chilocco - FAA Fi...</p>

Construction / Alteration Information	
Notice Of:	
Duration:	Permanent
if Temporary :	Months: Days:
Work Schedule - Start:	01/01/2020
Work Schedule - End:	01/01/2021
<p><i>*For temporary cranes-Does the permanent structure require separate notice to the FAA? To find out, use the Notice Criteria Tool. If separate notice is required, please ensure it is filed. If it is not filed, please state the reason in the Description of Proposal.</i></p> <p>State Filing:</p>	

Structure Summary	
Structure Type:	Wind Turbine *legacy*
Structure Type:	<input type="text" value="WIND_TURBINE"/> Wind Turbine
Structure Name:	61
FDC NOTAM:	
NOTAM Number:	
FCC Number:	
Prior ASN:	

Structure Details	
Latitude:	36° 59' 0.58" N
Longitude:	97° 2' 17.70" W
Horizontal Datum:	NAD83
Site Elevation (SE):	1146 (nearest foot) PASSED
Structure Height (AGL):	599 (nearest foot)
Current Height (AGL):	(nearest foot)
<p><i>* For notice of alteration or existing provide the current AGL height of the existing structure. Include details in the Description of Proposal</i></p>	
Minimum Operating Height (AGL):	(nearest foot)
<p><i>* For aeronautical study of a crane or construction equipment the maximum height should be listed above as the Structure Height (AGL). Additionally, provide the minimum operating height to avoid delays if impacts are identified that require negotiation to a reduced height. If the Structure Height and minimum operating height are the same enter the same value in both fields.</i></p>	
Requested Marking/Lighting:	Red lights and paint
Recommended Marking/Lighting:	White Paint/Synchronized Red Lights
Current Marking/Lighting:	N/A Proposed Structure
Other :	<input type="text"/>
Nearest City:	New Kirk
Nearest State:	Oklahoma
Description of Location:	14 Miles North of New Kirk
Description of Proposal:	80 WTG Project for electric production

Proposed Frequency Bands				
Low Freq	High Freq	Freq Unit	ERP	ERP Unit





Notice of Proposed Construction or Alteration - Off Airport

[Add a New Case \(Off Airport\) - Desk Reference Guide V_2018.2.1](#)

[Add a New Case \(Off Airport\) for Wind Turbines - Met Towers \(with WT Farm\) - WT-Barge Crane - Desk Reference Guide V_2018.2.1](#)

Project Name: PNEWI-000610357-19

Sponsor: PNE USA

Details for Case : 63

[Show Project Summary](#)

Case Status					
ASN:	2019-WTW-4465-OE				
Status:	Determined				
7460-2 Forms:	<p>01/13/2021</p> <p>7460-2 (PART 1) required at least 10 days prior to start of construction.</p> <p>Add Supplemental Notice (7460-2)</p>				
Public Comments:	None				
Date Accepted:	04/22/2019				
Date Determined:	08/18/2019				
Letters:	<p>03/24/2021 EXT</p> <p>08/18/2019 DNH</p> <p>06/24/2019 NPH</p>				
Documents:	<p>None</p> <p>Project Documents:</p> <p>04/22/2019 Chilocco - FAA Fi...</p> <p>04/22/2019 Chilocco - FAA F...</p> <p>04/18/2019 Chilocco - FAA Fi...</p>				
Construction / Alteration Information					
Notice Of:					
Duration:	Permanent				
if Temporary :	Months: Days:				
Work Schedule - Start:	01/01/2020				
Work Schedule - End:	01/01/2021				
<p><i>*For temporary cranes-Does the permanent structure require separate notice to the FAA? To find out, use the Notice Criteria Tool. If separate notice is required, please ensure it is filed. If it is not filed, please state the reason in the Description of Proposal.</i></p> <p>State Filing:</p>					
Structure Details					
Latitude:	36° 58' 45.49" N				
Longitude:	97° 1' 57.58" W				
Horizontal Datum:	NAD83				
Site Elevation (SE):	1129 (nearest foot) PASSED				
Structure Height (AGL):	599 (nearest foot)				
Current Height (AGL):	(nearest foot)				
<p><i>* For notice of alteration or existing provide the current AGL height of the existing structure. Include details in the Description of Proposal</i></p>					
Minimum Operating Height (AGL):	(nearest foot)				
<p><i>* For aeronautical study of a crane or construction equipment the maximum height should be listed above as the Structure Height (AGL). Additionally, provide the minimum operating height to avoid delays if impacts are identified that require negotiation to a reduced height. If the Structure Height and minimum operating height are the same enter the same value in both fields.</i></p>					
Requested Marking/Lighting:	Red lights and paint				
Recommended Marking/Lighting:	White Paint/Synchronized Red Lights				
Current Marking/Lighting:	N/A Proposed Structure				
Other :	<input type="text"/>				
Nearest City:	New Kirk				
Nearest State:	Oklahoma				
Description of Location:	14 Miles North of New Kirk				
Description of Proposal:	80 WTG Project for electric production				
Structure Summary					
Structure Type:	Wind Turbine *legacy*				
Structure Type:	<input type="text" value="WIND_TURBINE"/> Wind Turbine				
Structure Name:	63				
FDC NOTAM:					
NOTAM Number:					
FCC Number:					
Prior ASN:					
Proposed Frequency Bands					
	Low Freq	High Freq	Freq Unit	ERP	ERP Unit





Notice of Proposed Construction or Alteration - Off Airport

[Add a New Case \(Off Airport\) - Desk Reference Guide V_2018.2.1](#)

[Add a New Case \(Off Airport\) for Wind Turbines - Met Towers \(with WT Farm\) - WT-Barge Crane - Desk Reference Guide V_2018.2.1](#)

Project Name: PNEWI-000610357-19

Sponsor: PNE USA

Details for Case : 64

[Show Project Summary](#)

Case Status	
ASN:	2019-WTW-4466-OE
Status:	Determined
7460-2 Forms:	<p>01/13/2021</p> <p>7460-2 (PART 1) required at least 10 days prior to start of construction.</p> <p>Add Supplemental Notice (7460-2)</p>
Public Comments:	None
Date Accepted:	04/22/2019
Date Determined:	08/18/2019
Letters:	<p>03/24/2021 EXT</p> <p>08/18/2019 DNH</p> <p>06/24/2019 NPH</p>
Documents:	<p>None</p> <p>Project Documents:</p> <p>04/22/2019 Chilocco - FAA Fi...</p> <p>04/22/2019 Chilocco - FAA F...</p> <p>04/18/2019 Chilocco - FAA Fi...</p>

Construction / Alteration Information	
Notice Of:	
Duration:	Permanent
if Temporary :	Months: Days:
Work Schedule - Start:	01/01/2020
Work Schedule - End:	01/01/2021
<p><i>*For temporary cranes-Does the permanent structure require separate notice to the FAA? To find out, use the Notice Criteria Tool. If separate notice is required, please ensure it is filed. If it is not filed, please state the reason in the Description of Proposal.</i></p> <p>State Filing:</p>	

Structure Summary	
Structure Type:	Wind Turbine *legacy*
Structure Type:	<input type="text" value="WIND_TURBINE"/> Wind Turbine
Structure Name:	64
FDC NOTAM:	
NOTAM Number:	
FCC Number:	
Prior ASN:	

Structure Details	
Latitude:	36° 58' 34.41" N
Longitude:	97° 2' 24.44" W
Horizontal Datum:	NAD83
Site Elevation (SE):	1126 (nearest foot) PASSED
Structure Height (AGL):	599 (nearest foot)
Current Height (AGL):	(nearest foot)
<p><i>* For notice of alteration or existing provide the current AGL height of the existing structure. Include details in the Description of Proposal</i></p>	
Minimum Operating Height (AGL):	(nearest foot)
<p><i>* For aeronautical study of a crane or construction equipment the maximum height should be listed above as the Structure Height (AGL). Additionally, provide the minimum operating height to avoid delays if impacts are identified that require negotiation to a reduced height. If the Structure Height and minimum operating height are the same enter the same value in both fields.</i></p>	
Requested Marking/Lighting:	Red lights and paint
Recommended Marking/Lighting:	White Paint/Synchronized Red Lights
Current Marking/Lighting:	N/A Proposed Structure
Other :	<input type="text"/>
Nearest City:	New Kirk
Nearest State:	Oklahoma
Description of Location:	14 Miles North of New Kirk
Description of Proposal:	80 WTG Project for electric production

Proposed Frequency Bands				
Low Freq	High Freq	Freq Unit	ERP	ERP Unit





Notice of Proposed Construction or Alteration - Off Airport

[Add a New Case \(Off Airport\) - Desk Reference Guide V_2018.2.1](#)

[Add a New Case \(Off Airport\) for Wind Turbines - Met Towers \(with WT Farm\) - WT-Barge Crane - Desk Reference Guide V_2018.2.1](#)

Project Name: PNEWI-000610357-19

Sponsor: PNE USA

Details for Case : 65

[Show Project Summary](#)

Case Status											
ASN:	2019-WTW-4467-OE										
Status:	Determined										
7460-2 Forms:	<p>01/13/2021</p> <p>7460-2 (PART 1) required at least 10 days prior to start of construction.</p> <p>Add Supplemental Notice (7460-2)</p>										
Public Comments:	None										
Date Accepted:	04/22/2019										
Date Determined:	08/18/2019										
Letters:	<p>03/24/2021 EXT</p> <p>08/18/2019 DNH</p> <p>06/24/2019 NPH</p>										
Documents:	<p>None</p> <p>Project Documents:</p> <p>04/22/2019 Chilocco - FAA Fi...</p> <p>04/22/2019 Chilocco - FAA F...</p> <p>04/18/2019 Chilocco - FAA Fi...</p>										
Construction / Alteration Information											
Notice Of:											
Duration:	Permanent										
if Temporary :	Months: Days:										
Work Schedule - Start:	01/01/2020										
Work Schedule - End:	01/01/2021										
<p><i>*For temporary cranes-Does the permanent structure require separate notice to the FAA? To find out, use the Notice Criteria Tool. If separate notice is required, please ensure it is filed. If it is not filed, please state the reason in the Description of Proposal.</i></p> <p>State Filing:</p>											
Structure Details											
Latitude:	36° 58' 26.83" N										
Longitude:	97° 2' 11.35" W										
Horizontal Datum:	NAD83										
Site Elevation (SE):	1105 (nearest foot) PASSED										
Structure Height (AGL):	599 (nearest foot)										
Current Height (AGL):	(nearest foot)										
<p><i>* For notice of alteration or existing provide the current AGL height of the existing structure. Include details in the Description of Proposal</i></p>											
Minimum Operating Height (AGL):	(nearest foot)										
<p><i>* For aeronautical study of a crane or construction equipment the maximum height should be listed above as the Structure Height (AGL). Additionally, provide the minimum operating height to avoid delays if impacts are identified that require negotiation to a reduced height. If the Structure Height and minimum operating height are the same enter the same value in both fields.</i></p>											
Requested Marking/Lighting:	Red lights and paint										
Recommended Marking/Lighting:	White Paint/Synchronized Red Lights										
Current Marking/Lighting:	N/A Proposed Structure										
Other :	<input type="text"/>										
Nearest City:	New Kirk										
Nearest State:	Oklahoma										
Description of Location:	14 Miles North of New Kirk										
Description of Proposal:	80 WTG Project for electric production										
Structure Summary											
Structure Type:	Wind Turbine *legacy*										
Structure Type:	<input type="text" value="WIND_TURBINE"/> Wind Turbine										
Structure Name:	65										
FDC NOTAM:											
NOTAM Number:											
FCC Number:											
Prior ASN:											
Proposed Frequency Bands											
	<table border="1"> <thead> <tr> <th>Low Freq</th> <th>High Freq</th> <th>Freq Unit</th> <th>ERP</th> <th>ERP Unit</th> </tr> </thead> <tbody> <tr> <td></td> <td></td> <td></td> <td></td> <td></td> </tr> </tbody> </table>	Low Freq	High Freq	Freq Unit	ERP	ERP Unit					
Low Freq	High Freq	Freq Unit	ERP	ERP Unit							





Notice of Proposed Construction or Alteration - Off Airport

[Add a New Case \(Off Airport\) - Desk Reference Guide V_2018.2.1](#)

[Add a New Case \(Off Airport\) for Wind Turbines - Met Towers \(with WT Farm\) - WT-Barge Crane - Desk Reference Guide V_2018.2.1](#)

Project Name: PNEWI-000610357-19

Sponsor: PNE USA

Details for Case : 66

[Show Project Summary](#)

Case Status	
ASN:	2019-WTW-4468-OE
Status:	Determined
7460-2 Forms:	<p>01/13/2021</p> <p>7460-2 (PART 1) required at least 10 days prior to start of construction.</p> <p>Add Supplemental Notice (7460-2)</p>
Public Comments:	None
Date Accepted:	04/22/2019
Date Determined:	08/18/2019
Letters:	<p>03/24/2021 EXT</p> <p>08/18/2019 DNH</p> <p>06/24/2019 NPH</p>
Documents:	<p>None</p> <p>Project Documents:</p> <p>04/22/2019 Chilocco - FAA Fi...</p> <p>04/22/2019 Chilocco - FAA F...</p> <p>04/18/2019 Chilocco - FAA Fi...</p>

Construction / Alteration Information	
Notice Of:	
Duration:	Permanent
if Temporary :	Months: Days:
Work Schedule - Start:	01/01/2020
Work Schedule - End:	01/01/2021
<p><i>*For temporary cranes-Does the permanent structure require separate notice to the FAA? To find out, use the Notice Criteria Tool. If separate notice is required, please ensure it is filed. If it is not filed, please state the reason in the Description of Proposal.</i></p> <p>State Filing:</p>	

Structure Summary	
Structure Type:	Wind Turbine *legacy*
Structure Type:	<input type="text" value="WIND_TURBINE"/> Wind Turbine
Structure Name:	66
FDC NOTAM:	
NOTAM Number:	
FCC Number:	
Prior ASN:	

Structure Details	
Latitude:	36° 58' 6.13" N
Longitude:	97° 2' 17.24" W
Horizontal Datum:	NAD83
Site Elevation (SE):	1132 (nearest foot) PASSED
Structure Height (AGL):	599 (nearest foot)
Current Height (AGL):	(nearest foot)
<p><i>* For notice of alteration or existing provide the current AGL height of the existing structure. Include details in the Description of Proposal</i></p>	
Minimum Operating Height (AGL):	(nearest foot)
<p><i>* For aeronautical study of a crane or construction equipment the maximum height should be listed above as the Structure Height (AGL). Additionally, provide the minimum operating height to avoid delays if impacts are identified that require negotiation to a reduced height. If the Structure Height and minimum operating height are the same enter the same value in both fields.</i></p>	
Requested Marking/Lighting:	Red lights and paint
Recommended Marking/Lighting:	White Paint/Synchronized Red Lights
Current Marking/Lighting:	N/A Proposed Structure
Other :	<input type="text"/>
Nearest City:	New Kirk
Nearest State:	Oklahoma
Description of Location:	14 Miles North of New Kirk
Description of Proposal:	80 WTG Project for electric production

Proposed Frequency Bands				
Low Freq	High Freq	Freq Unit	ERP	ERP Unit





Notice of Proposed Construction or Alteration - Off Airport

[Add a New Case \(Off Airport\) - Desk Reference Guide V_2018.2.1](#)

[Add a New Case \(Off Airport\) for Wind Turbines - Met Towers \(with WT Farm\) - WT-Barge Crane - Desk Reference Guide V_2018.2.1](#)

Project Name: PNEWI-000610357-19

Sponsor: PNE USA

Details for Case : 67

[Show Project Summary](#)

Case Status	
ASN:	2019-WTW-4469-OE
Status:	Determined
7460-2 Forms:	<p>01/13/2021</p> <p>7460-2 (PART 1) required at least 10 days prior to start of construction.</p> <p>Add Supplemental Notice (7460-2)</p>
Public Comments:	None
Date Accepted:	04/22/2019
Date Determined:	08/18/2019
Letters:	<p>03/24/2021 EXT</p> <p>08/18/2019 DNH</p> <p>06/24/2019 NPH</p>
Documents:	<p>None</p> <p>Project Documents:</p> <p>04/22/2019 Chilocco - FAA Fi...</p> <p>04/22/2019 Chilocco - FAA F...</p> <p>04/18/2019 Chilocco - FAA Fi...</p>

Construction / Alteration Information	
Notice Of:	
Duration:	Permanent
if Temporary :	Months: Days:
Work Schedule - Start:	01/01/2020
Work Schedule - End:	01/01/2021
<p><i>*For temporary cranes-Does the permanent structure require separate notice to the FAA? To find out, use the Notice Criteria Tool. If separate notice is required, please ensure it is filed. If it is not filed, please state the reason in the Description of Proposal.</i></p> <p>State Filing:</p>	

Structure Summary	
Structure Type:	Wind Turbine *legacy*
Structure Type:	<input type="text" value="WIND_TURBINE"/> Wind Turbine
Structure Name:	67
FDC NOTAM:	
NOTAM Number:	
FCC Number:	
Prior ASN:	

Structure Details	
Latitude:	36° 58' 5.78" N
Longitude:	97° 1' 59.82" W
Horizontal Datum:	NAD83
Site Elevation (SE):	1115 (nearest foot) PASSED
Structure Height (AGL):	599 (nearest foot)
Current Height (AGL):	(nearest foot)
<p><i>* For notice of alteration or existing provide the current AGL height of the existing structure. Include details in the Description of Proposal</i></p>	
Minimum Operating Height (AGL):	(nearest foot)
<p><i>* For aeronautical study of a crane or construction equipment the maximum height should be listed above as the Structure Height (AGL). Additionally, provide the minimum operating height to avoid delays if impacts are identified that require negotiation to a reduced height. If the Structure Height and minimum operating height are the same enter the same value in both fields.</i></p>	
Requested Marking/Lighting:	Red lights and paint
Recommended Marking/Lighting:	White Paint/Synchronized Red Lights
Current Marking/Lighting:	N/A Proposed Structure
Other :	<input type="text"/>
Nearest City:	New Kirk
Nearest State:	Oklahoma
Description of Location:	14 Miles North of New Kirk
Description of Proposal:	80 WTG Project for electric production

Proposed Frequency Bands				
Low Freq	High Freq	Freq Unit	ERP	ERP Unit





Notice of Proposed Construction or Alteration - Off Airport

[Add a New Case \(Off Airport\) - Desk Reference Guide V_2018.2.1](#)

[Add a New Case \(Off Airport\) for Wind Turbines - Met Towers \(with WT Farm\) - WT-Barge Crane - Desk Reference Guide V_2018.2.1](#)

Project Name: PNEWI-000610357-19

Sponsor: PNE USA

Details for Case : 68

[Show Project Summary](#)

Case Status											
ASN:	2019-WTW-4470-OE										
Status:	Determined										
7460-2 Forms:	<p>01/13/2021</p> <p>7460-2 (PART 1) required at least 10 days prior to start of construction.</p> <p>Add Supplemental Notice (7460-2)</p>										
Public Comments:	None										
Date Accepted:	04/22/2019										
Date Determined:	08/18/2019										
Letters:	<p>03/24/2021 EXT</p> <p>08/18/2019 DNH</p> <p>06/24/2019 NPH</p>										
Documents:	<p>None</p> <p>Project Documents:</p> <p>04/22/2019 Chilocco - FAA Fi...</p> <p>04/22/2019 Chilocco - FAA F...</p> <p>04/18/2019 Chilocco - FAA Fi...</p>										
Construction / Alteration Information											
Notice Of:											
Duration:	Permanent										
if Temporary :	Months: Days:										
Work Schedule - Start:	01/01/2020										
Work Schedule - End:	01/01/2021										
<p><i>*For temporary cranes-Does the permanent structure require separate notice to the FAA? To find out, use the Notice Criteria Tool. If separate notice is required, please ensure it is filed. If it is not filed, please state the reason in the Description of Proposal.</i></p> <p>State Filing:</p>											
Structure Details											
Latitude:	36° 57' 48.28" N										
Longitude:	97° 2' 40.46" W										
Horizontal Datum:	NAD83										
Site Elevation (SE):	1120 (nearest foot) PASSED										
Structure Height (AGL):	599 (nearest foot)										
Current Height (AGL):	(nearest foot)										
<p><i>* For notice of alteration or existing provide the current AGL height of the existing structure. Include details in the Description of Proposal</i></p>											
Minimum Operating Height (AGL):	(nearest foot)										
<p><i>* For aeronautical study of a crane or construction equipment the maximum height should be listed above as the Structure Height (AGL). Additionally, provide the minimum operating height to avoid delays if impacts are identified that require negotiation to a reduced height. If the Structure Height and minimum operating height are the same enter the same value in both fields.</i></p>											
Requested Marking/Lighting:	Red lights and paint										
Recommended Marking/Lighting:	White Paint/Synchronized Red Lights										
Current Marking/Lighting:	N/A Proposed Structure										
Other :	<input type="text"/>										
Nearest City:	New Kirk										
Nearest State:	Oklahoma										
Description of Location:	14 Miles North of New Kirk										
Description of Proposal:	80 WTG Project for electric production										
Structure Summary											
Structure Type:	Wind Turbine *legacy*										
Structure Type:	<input type="text" value="WIND_TURBINE"/> Wind Turbine										
Structure Name:	68										
FDC NOTAM:											
NOTAM Number:											
FCC Number:											
Prior ASN:											
Proposed Frequency Bands											
	<table border="1"> <thead> <tr> <th>Low Freq</th> <th>High Freq</th> <th>Freq Unit</th> <th>ERP</th> <th>ERP Unit</th> </tr> </thead> <tbody> <tr> <td></td> <td></td> <td></td> <td></td> <td></td> </tr> </tbody> </table>	Low Freq	High Freq	Freq Unit	ERP	ERP Unit					
Low Freq	High Freq	Freq Unit	ERP	ERP Unit							





Notice of Proposed Construction or Alteration - Off Airport

[Add a New Case \(Off Airport\) - Desk Reference Guide V_2018.2.1](#)

[Add a New Case \(Off Airport\) for Wind Turbines - Met Towers \(with WT Farm\) - WT-Barge Crane - Desk Reference Guide V_2018.2.1](#)

Project Name: PNEWI-000610357-19

Sponsor: PNE USA

Details for Case : 69

[Show Project Summary](#)

Case Status											
ASN:	2019-WTW-4471-OE										
Status:	Determined										
7460-2 Forms:	<p>01/13/2021</p> <p>7460-2 (PART 1) required at least 10 days prior to start of construction.</p> <p>Add Supplemental Notice (7460-2)</p>										
Public Comments:	None										
Date Accepted:	04/22/2019										
Date Determined:	08/18/2019										
Letters:	<p>03/24/2021 EXT</p> <p>08/18/2019 DNH</p> <p>06/24/2019 NPH</p>										
Documents:	<p>None</p> <p>Project Documents:</p> <p>04/22/2019 Chilocco - FAA Fi...</p> <p>04/22/2019 Chilocco - FAA F...</p> <p>04/18/2019 Chilocco - FAA Fi...</p>										
Construction / Alteration Information											
Notice Of:											
Duration:	Permanent										
if Temporary :	Months: Days:										
Work Schedule - Start:	01/01/2020										
Work Schedule - End:	01/01/2021										
<p><i>*For temporary cranes-Does the permanent structure require separate notice to the FAA? To find out, use the Notice Criteria Tool. If separate notice is required, please ensure it is filed. If it is not filed, please state the reason in the Description of Proposal.</i></p> <p>State Filing:</p>											
Structure Details											
Latitude:	36° 57' 48.56" N										
Longitude:	97° 2' 24.36" W										
Horizontal Datum:	NAD83										
Site Elevation (SE):	1142 (nearest foot) PASSED										
Structure Height (AGL):	599 (nearest foot)										
Current Height (AGL):	(nearest foot)										
<p><i>* For notice of alteration or existing provide the current AGL height of the existing structure. Include details in the Description of Proposal</i></p>											
Minimum Operating Height (AGL):	(nearest foot)										
<p><i>* For aeronautical study of a crane or construction equipment the maximum height should be listed above as the Structure Height (AGL). Additionally, provide the minimum operating height to avoid delays if impacts are identified that require negotiation to a reduced height. If the Structure Height and minimum operating height are the same enter the same value in both fields.</i></p>											
Requested Marking/Lighting:	Red lights and paint										
Recommended Marking/Lighting:	White Paint/Synchronized Red Lights										
Current Marking/Lighting:	N/A Proposed Structure										
Other :	<input type="text"/>										
Nearest City:	New Kirk										
Nearest State:	Oklahoma										
Description of Location:	14 Miles North of New Kirk										
Description of Proposal:	80 WTG Project for electric production										
Structure Summary											
Structure Type:	Wind Turbine *legacy*										
Structure Type:	<input type="text" value="WIND_TURBINE"/> Wind Turbine										
Structure Name:	69										
FDC NOTAM:											
NOTAM Number:											
FCC Number:											
Prior ASN:											
Proposed Frequency Bands											
	<table border="1"> <thead> <tr> <th>Low Freq</th> <th>High Freq</th> <th>Freq Unit</th> <th>ERP</th> <th>ERP Unit</th> </tr> </thead> <tbody> <tr> <td></td> <td></td> <td></td> <td></td> <td></td> </tr> </tbody> </table>	Low Freq	High Freq	Freq Unit	ERP	ERP Unit					
Low Freq	High Freq	Freq Unit	ERP	ERP Unit							





Notice of Proposed Construction or Alteration - Off Airport

[Add a New Case \(Off Airport\) - Desk Reference Guide V_2018.2.1](#)

[Add a New Case \(Off Airport\) for Wind Turbines - Met Towers \(with WT Farm\) - WT-Barge Crane - Desk Reference Guide V_2018.2.1](#)

Project Name: PNEWI-000610357-19

Sponsor: PNE USA

Details for Case : 70

[Show Project Summary](#)

Case Status					
ASN:	2019-WTW-4472-OE				
Status:	Determined				
7460-2 Forms:	<p>01/13/2021</p> <p>7460-2 (PART 1) required at least 10 days prior to start of construction.</p> <p>Add Supplemental Notice (7460-2)</p>				
Public Comments:	None				
Date Accepted:	04/22/2019				
Date Determined:	08/18/2019				
Letters:	<p>03/24/2021 EXT</p> <p>08/18/2019 DNH</p> <p>06/24/2019 NPH</p>				
Documents:	<p>None</p> <p>Project Documents:</p> <p>04/22/2019 Chilocco - FAA Fi...</p> <p>04/22/2019 Chilocco - FAA F...</p> <p>04/18/2019 Chilocco - FAA Fi...</p>				
Construction / Alteration Information					
Notice Of:					
Duration:	Permanent				
if Temporary :	Months: Days:				
Work Schedule - Start:	01/01/2020				
Work Schedule - End:	01/01/2021				
<p><i>*For temporary cranes-Does the permanent structure require separate notice to the FAA? To find out, use the Notice Criteria Tool. If separate notice is required, please ensure it is filed. If it is not filed, please state the reason in the Description of Proposal.</i></p> <p>State Filing:</p>					
Structure Details					
Latitude:	36° 57' 46.10" N				
Longitude:	97° 1' 59.15" W				
Horizontal Datum:	NAD83				
Site Elevation (SE):	1142 (nearest foot) PASSED				
Structure Height (AGL):	599 (nearest foot)				
Current Height (AGL):	(nearest foot)				
<p><i>* For notice of alteration or existing provide the current AGL height of the existing structure. Include details in the Description of Proposal</i></p>					
Minimum Operating Height (AGL):	(nearest foot)				
<p><i>* For aeronautical study of a crane or construction equipment the maximum height should be listed above as the Structure Height (AGL). Additionally, provide the minimum operating height to avoid delays if impacts are identified that require negotiation to a reduced height. If the Structure Height and minimum operating height are the same enter the same value in both fields.</i></p>					
Requested Marking/Lighting:	Red lights and paint				
Recommended Marking/Lighting:	White Paint/Synchronized Red Lights				
Current Marking/Lighting:	N/A Proposed Structure				
Other :	<input type="text"/>				
Nearest City:	New Kirk				
Nearest State:	Oklahoma				
Description of Location:	14 Miles North of New Kirk				
Description of Proposal:	80 WTG Project for electric production				
Structure Summary					
Structure Type:	Wind Turbine *legacy*				
Structure Type:	<input type="text" value="WIND_TURBINE"/> Wind Turbine				
Structure Name:	70				
FDC NOTAM:					
NOTAM Number:					
FCC Number:					
Prior ASN:					
Proposed Frequency Bands					
	Low Freq	High Freq	Freq Unit	ERP	ERP Unit





Notice of Proposed Construction or Alteration - Off Airport

[Add a New Case \(Off Airport\) - Desk Reference Guide V_2018.2.1](#)

[Add a New Case \(Off Airport\) for Wind Turbines - Met Towers \(with WT Farm\) - WT-Barge Crane - Desk Reference Guide V_2018.2.1](#)

Project Name: PNEWI-000610357-19

Sponsor: PNE USA

Details for Case : 71

[Show Project Summary](#)

Case Status	
ASN:	2019-WTW-4473-OE
Status:	Determined
7460-2 Forms:	<p>01/13/2021</p> <p>7460-2 (PART 1) required at least 10 days prior to start of construction.</p> <p>Add Supplemental Notice (7460-2)</p>
Public Comments:	None
Date Accepted:	04/22/2019
Date Determined:	08/18/2019
Letters:	<p>03/24/2021 EXT</p> <p>08/18/2019 DNH</p> <p>06/24/2019 NPH</p>
Documents:	<p>None</p> <p>Project Documents:</p> <p>04/22/2019 Chilocco - FAA Fi...</p> <p>04/22/2019 Chilocco - FAA F...</p> <p>04/18/2019 Chilocco - FAA Fi...</p>

Construction / Alteration Information	
Notice Of:	
Duration:	Permanent
if Temporary :	Months: Days:
Work Schedule - Start:	01/01/2020
Work Schedule - End:	01/01/2021
<p><i>*For temporary cranes-Does the permanent structure require separate notice to the FAA? To find out, use the Notice Criteria Tool. If separate notice is required, please ensure it is filed. If it is not filed, please state the reason in the Description of Proposal.</i></p> <p>State Filing:</p>	

Structure Summary	
Structure Type:	Wind Turbine *legacy*
Structure Type:	<input type="text" value="WIND_TURBINE"/> Wind Turbine
Structure Name:	71
FDC NOTAM:	
NOTAM Number:	
FCC Number:	
Prior ASN:	

Structure Details	
Latitude:	36° 57' 29.54" N
Longitude:	97° 2' 47.37" W
Horizontal Datum:	NAD83
Site Elevation (SE):	1155 (nearest foot) PASSED
Structure Height (AGL):	599 (nearest foot)
Current Height (AGL):	(nearest foot)
<p><i>* For notice of alteration or existing provide the current AGL height of the existing structure. Include details in the Description of Proposal</i></p>	
Minimum Operating Height (AGL):	(nearest foot)
<p><i>* For aeronautical study of a crane or construction equipment the maximum height should be listed above as the Structure Height (AGL). Additionally, provide the minimum operating height to avoid delays if impacts are identified that require negotiation to a reduced height. If the Structure Height and minimum operating height are the same enter the same value in both fields.</i></p>	
Requested Marking/Lighting:	Red lights and paint
Recommended Marking/Lighting:	White Paint/Synchronized Red Lights
Current Marking/Lighting:	N/A Proposed Structure
Other :	<input type="text"/>
Nearest City:	New Kirk
Nearest State:	Oklahoma
Description of Location:	14 Miles North of New Kirk
Description of Proposal:	80 WTG Project for electric production

Proposed Frequency Bands				
Low Freq	High Freq	Freq Unit	ERP	ERP Unit





Notice of Proposed Construction or Alteration - Off Airport

[Add a New Case \(Off Airport\) - Desk Reference Guide V_2018.2.1](#)

[Add a New Case \(Off Airport\) for Wind Turbines - Met Towers \(with WT Farm\) - WT-Barge Crane - Desk Reference Guide V_2018.2.1](#)

Project Name: PNEWI-000610357-19

Sponsor: PNE USA

Details for Case : 72

[Show Project Summary](#)

Case Status					
ASN:	2019-WTW-4474-OE				
Status:	Determined				
7460-2 Forms:	<p>01/13/2021</p> <p>7460-2 (PART 1) required at least 10 days prior to start of construction.</p> <p>Add Supplemental Notice (7460-2)</p>				
Public Comments:	None				
Date Accepted:	04/22/2019				
Date Determined:	08/18/2019				
Letters:	<p>03/24/2021 EXT</p> <p>08/18/2019 DNH</p> <p>06/24/2019 NPH</p>				
Documents:	<p>None</p> <p>Project Documents:</p> <p>04/22/2019 Chilocco - FAA Fi...</p> <p>04/22/2019 Chilocco - FAA F...</p> <p>04/18/2019 Chilocco - FAA Fi...</p>				
Construction / Alteration Information					
Notice Of:					
Duration:	Permanent				
if Temporary :	Months: Days:				
Work Schedule - Start:	01/01/2020				
Work Schedule - End:	01/01/2021				
<p><i>*For temporary cranes-Does the permanent structure require separate notice to the FAA? To find out, use the Notice Criteria Tool. If separate notice is required, please ensure it is filed. If it is not filed, please state the reason in the Description of Proposal.</i></p> <p>State Filing:</p>					
Structure Details					
Latitude:	36° 57' 25.73" N				
Longitude:	97° 2' 30.85" W				
Horizontal Datum:	NAD83				
Site Elevation (SE):	1152 (nearest foot) PASSED				
Structure Height (AGL):	599 (nearest foot)				
Current Height (AGL):	(nearest foot)				
<p><i>* For notice of alteration or existing provide the current AGL height of the existing structure. Include details in the Description of Proposal</i></p>					
Minimum Operating Height (AGL):	(nearest foot)				
<p><i>* For aeronautical study of a crane or construction equipment the maximum height should be listed above as the Structure Height (AGL). Additionally, provide the minimum operating height to avoid delays if impacts are identified that require negotiation to a reduced height. If the Structure Height and minimum operating height are the same enter the same value in both fields.</i></p>					
Requested Marking/Lighting:	Red lights and paint				
Recommended Marking/Lighting:	White Paint/Synchronized Red Lights				
Current Marking/Lighting:	N/A Proposed Structure				
Other :	<input type="text"/>				
Nearest City:	New Kirk				
Nearest State:	Oklahoma				
Description of Location:	14 Miles North of New Kirk				
Description of Proposal:	80 WTG Project for electric production				
Structure Summary					
Structure Type:	Wind Turbine *legacy*				
Structure Type:	<input type="text" value="WIND_TURBINE"/> Wind Turbine				
Structure Name:	72				
FDC NOTAM:					
NOTAM Number:					
FCC Number:					
Prior ASN:					
Proposed Frequency Bands					
	Low Freq	High Freq	Freq Unit	ERP	ERP Unit





Notice of Proposed Construction or Alteration - Off Airport

[Add a New Case \(Off Airport\) - Desk Reference Guide V_2018.2.1](#)

[Add a New Case \(Off Airport\) for Wind Turbines - Met Towers \(with WT Farm\) - WT-Barge Crane - Desk Reference Guide V_2018.2.1](#)

Project Name: PNEWI-000610357-19

Sponsor: PNE USA

Details for Case : 73

[Show Project Summary](#)

Case Status											
ASN:	2019-WTW-4475-OE										
Status:	Determined										
7460-2 Forms:	<p>01/13/2021</p> <p>7460-2 (PART 1) required at least 10 days prior to start of construction.</p> <p>Add Supplemental Notice (7460-2)</p>										
Public Comments:	None										
Date Accepted:	04/22/2019										
Date Determined:	08/18/2019										
Letters:	<p>03/24/2021 EXT</p> <p>08/18/2019 DNH</p> <p>06/24/2019 NPH</p>										
Documents:	<p>None</p> <p>Project Documents:</p> <p>04/22/2019 Chilocco - FAA Fi...</p> <p>04/22/2019 Chilocco - FAA F...</p> <p>04/18/2019 Chilocco - FAA Fi...</p>										
Construction / Alteration Information											
Notice Of:											
Duration:	Permanent										
if Temporary :	Months: Days:										
Work Schedule - Start:	01/01/2020										
Work Schedule - End:	01/01/2021										
<p><i>*For temporary cranes-Does the permanent structure require separate notice to the FAA? To find out, use the Notice Criteria Tool. If separate notice is required, please ensure it is filed. If it is not filed, please state the reason in the Description of Proposal.</i></p> <p>State Filing:</p>											
Structure Details											
Latitude:	36° 57' 35.41" N										
Longitude:	97° 2' 11.52" W										
Horizontal Datum:	NAD83										
Site Elevation (SE):	1155 (nearest foot) PASSED										
Structure Height (AGL):	599 (nearest foot)										
Current Height (AGL):	(nearest foot)										
<p><i>* For notice of alteration or existing provide the current AGL height of the existing structure. Include details in the Description of Proposal</i></p>											
Minimum Operating Height (AGL):	(nearest foot)										
<p><i>* For aeronautical study of a crane or construction equipment the maximum height should be listed above as the Structure Height (AGL). Additionally, provide the minimum operating height to avoid delays if impacts are identified that require negotiation to a reduced height. If the Structure Height and minimum operating height are the same enter the same value in both fields.</i></p>											
Requested Marking/Lighting:	Red lights and paint										
Recommended Marking/Lighting:	White Paint/Synchronized Red Lights										
Current Marking/Lighting:	N/A Proposed Structure										
Other :	<input type="text"/>										
Nearest City:	New Kirk										
Nearest State:	Oklahoma										
Description of Location:	14 Miles North of New Kirk										
Description of Proposal:	80 WTG Project for electric production										
Structure Summary											
Structure Type:	Wind Turbine *legacy*										
Structure Type:	<input type="text" value="WIND_TURBINE"/> Wind Turbine										
Structure Name:	73										
FDC NOTAM:											
NOTAM Number:											
FCC Number:											
Prior ASN:											
Proposed Frequency Bands											
	<table border="1"> <thead> <tr> <th>Low Freq</th> <th>High Freq</th> <th>Freq Unit</th> <th>ERP</th> <th>ERP Unit</th> </tr> </thead> <tbody> <tr> <td></td> <td></td> <td></td> <td></td> <td></td> </tr> </tbody> </table>	Low Freq	High Freq	Freq Unit	ERP	ERP Unit					
Low Freq	High Freq	Freq Unit	ERP	ERP Unit							





Notice of Proposed Construction or Alteration - Off Airport

[Add a New Case \(Off Airport\) - Desk Reference Guide V_2018.2.1](#)

[Add a New Case \(Off Airport\) for Wind Turbines - Met Towers \(with WT Farm\) - WT-Barge Crane - Desk Reference Guide V_2018.2.1](#)

Project Name: PNEWI-000610357-19

Sponsor: PNE USA

Details for Case : 74

[Show Project Summary](#)

Case Status											
ASN:	2019-WTW-4476-OE										
Status:	Determined										
7460-2 Forms:	<p>01/13/2021</p> <p>7460-2 (PART 1) required at least 10 days prior to start of construction.</p> <p>Add Supplemental Notice (7460-2)</p>										
Public Comments:	None										
Date Accepted:	04/22/2019										
Date Determined:	08/18/2019										
Letters:	<p>03/24/2021 EXT</p> <p>08/18/2019 DNH</p> <p>06/24/2019 NPH</p>										
Documents:	<p>None</p> <p>Project Documents:</p> <p>04/22/2019 Chilocco - FAA Fi...</p> <p>04/22/2019 Chilocco - FAA F...</p> <p>04/18/2019 Chilocco - FAA Fi...</p>										
Construction / Alteration Information											
Notice Of:											
Duration:	Permanent										
if Temporary :	Months: Days:										
Work Schedule - Start:	01/01/2020										
Work Schedule - End:	01/01/2021										
<p><i>*For temporary cranes-Does the permanent structure require separate notice to the FAA? To find out, use the Notice Criteria Tool. If separate notice is required, please ensure it is filed. If it is not filed, please state the reason in the Description of Proposal.</i></p> <p>State Filing:</p>											
Structure Details											
Latitude:	36° 57' 26.04" N										
Longitude:	97° 1' 56.64" W										
Horizontal Datum:	NAD83										
Site Elevation (SE):	1147 (nearest foot) PASSED										
Structure Height (AGL):	599 (nearest foot)										
Current Height (AGL):	(nearest foot)										
<p><i>* For notice of alteration or existing provide the current AGL height of the existing structure. Include details in the Description of Proposal</i></p>											
Minimum Operating Height (AGL):	(nearest foot)										
<p><i>* For aeronautical study of a crane or construction equipment the maximum height should be listed above as the Structure Height (AGL). Additionally, provide the minimum operating height to avoid delays if impacts are identified that require negotiation to a reduced height. If the Structure Height and minimum operating height are the same enter the same value in both fields.</i></p>											
Requested Marking/Lighting:	Red lights and paint										
Recommended Marking/Lighting:	White Paint/Synchronized Red Lights										
Current Marking/Lighting:	N/A Proposed Structure										
Other :	<input type="text"/>										
Nearest City:	New Kirk										
Nearest State:	Oklahoma										
Description of Location:	14 Miles North of New Kirk										
Description of Proposal:	80 WTG Project for electric production										
Structure Summary											
Structure Type:	Wind Turbine *legacy*										
Structure Type:	<input type="text" value="WIND_TURBINE"/> Wind Turbine										
Structure Name:	74										
FDC NOTAM:											
NOTAM Number:											
FCC Number:											
Prior ASN:											
Proposed Frequency Bands											
	<table border="1"> <thead> <tr> <th>Low Freq</th> <th>High Freq</th> <th>Freq Unit</th> <th>ERP</th> <th>ERP Unit</th> </tr> </thead> <tbody> <tr> <td></td> <td></td> <td></td> <td></td> <td></td> </tr> </tbody> </table>	Low Freq	High Freq	Freq Unit	ERP	ERP Unit					
Low Freq	High Freq	Freq Unit	ERP	ERP Unit							





Notice of Proposed Construction or Alteration - Off Airport

[Add a New Case \(Off Airport\) - Desk Reference Guide V_2018.2.1](#)

[Add a New Case \(Off Airport\) for Wind Turbines - Met Towers \(with WT Farm\) - WT-Barge Crane - Desk Reference Guide V_2018.2.1](#)

Project Name: PNEWI-000610357-19

Sponsor: PNE USA

Details for Case : 75

[Show Project Summary](#)

Case Status											
ASN:	2019-WTW-4477-OE										
Status:	Determined										
7460-2 Forms:	<p>01/13/2021</p> <p>7460-2 (PART 1) required at least 10 days prior to start of construction.</p> <p>Add Supplemental Notice (7460-2)</p>										
Public Comments:	None										
Date Accepted:	04/22/2019										
Date Determined:	08/18/2019										
Letters:	<p>03/24/2021 EXT</p> <p>08/18/2019 DNH</p> <p>06/24/2019 NPH</p>										
Documents:	<p>None</p> <p>Project Documents:</p> <p>04/22/2019 Chilocco - FAA Fi...</p> <p>04/22/2019 Chilocco - FAA F...</p> <p>04/18/2019 Chilocco - FAA Fi...</p>										
Construction / Alteration Information											
Notice Of:											
Duration:	Permanent										
if Temporary :	Months: Days:										
Work Schedule - Start:	01/01/2020										
Work Schedule - End:	01/01/2021										
<p><i>*For temporary cranes-Does the permanent structure require separate notice to the FAA? To find out, use the Notice Criteria Tool. If separate notice is required, please ensure it is filed. If it is not filed, please state the reason in the Description of Proposal.</i></p> <p>State Filing:</p>											
Structure Details											
Latitude:	36° 58' 41.37" N										
Longitude:	97° 6' 35.09" W										
Horizontal Datum:	NAD83										
Site Elevation (SE):	1180 (nearest foot) PASSED										
Structure Height (AGL):	599 (nearest foot)										
Current Height (AGL):	(nearest foot)										
<p><i>* For notice of alteration or existing provide the current AGL height of the existing structure. Include details in the Description of Proposal</i></p>											
Minimum Operating Height (AGL):	(nearest foot)										
<p><i>* For aeronautical study of a crane or construction equipment the maximum height should be listed above as the Structure Height (AGL). Additionally, provide the minimum operating height to avoid delays if impacts are identified that require negotiation to a reduced height. If the Structure Height and minimum operating height are the same enter the same value in both fields.</i></p>											
Requested Marking/Lighting:	Red lights and paint										
Recommended Marking/Lighting:	White Paint/Synchronized Red Lights										
Current Marking/Lighting:	N/A Proposed Structure										
Other :	<input type="text"/>										
Nearest City:	New Kirk										
Nearest State:	Oklahoma										
Description of Location:	14 Miles North of New Kirk										
Description of Proposal:	80 WTG Project for electric production										
Structure Summary											
Structure Type:	Wind Turbine *legacy*										
Structure Type:	<input type="text" value="WIND_TURBINE"/> Wind Turbine										
Structure Name:	75										
FDC NOTAM:											
NOTAM Number:											
FCC Number:											
Prior ASN:											
Proposed Frequency Bands											
	<table border="1"> <thead> <tr> <th>Low Freq</th> <th>High Freq</th> <th>Freq Unit</th> <th>ERP</th> <th>ERP Unit</th> </tr> </thead> <tbody> <tr> <td></td> <td></td> <td></td> <td></td> <td></td> </tr> </tbody> </table>	Low Freq	High Freq	Freq Unit	ERP	ERP Unit					
Low Freq	High Freq	Freq Unit	ERP	ERP Unit							





Notice of Proposed Construction or Alteration - Off Airport

[Add a New Case \(Off Airport\) - Desk Reference Guide V_2018.2.1](#)

[Add a New Case \(Off Airport\) for Wind Turbines - Met Towers \(with WT Farm\) - WT-Barge Crane - Desk Reference Guide V_2018.2.1](#)

Project Name: PNEWI-000610357-19

Sponsor: PNE USA

Details for Case : 76

[Show Project Summary](#)

Case Status											
ASN:	2019-WTW-4478-OE										
Status:	Determined										
7460-2 Forms:	<p>01/13/2021</p> <p>7460-2 (PART 1) required at least 10 days prior to start of construction.</p> <p>Add Supplemental Notice (7460-2)</p>										
Public Comments:	None										
Date Accepted:	04/22/2019										
Date Determined:	08/18/2019										
Letters:	<p>03/24/2021 EXT</p> <p>08/18/2019 DNH</p> <p>06/24/2019 NPH</p>										
Documents:	<p>None</p> <p>Project Documents:</p> <p>04/22/2019 Chilocco - FAA Fi...</p> <p>04/22/2019 Chilocco - FAA F...</p> <p>04/18/2019 Chilocco - FAA Fi...</p>										
Construction / Alteration Information											
Notice Of:											
Duration:	Permanent										
if Temporary :	Months: Days:										
Work Schedule - Start:	01/01/2020										
Work Schedule - End:	01/01/2021										
<p><i>*For temporary cranes-Does the permanent structure require separate notice to the FAA? To find out, use the Notice Criteria Tool. If separate notice is required, please ensure it is filed. If it is not filed, please state the reason in the Description of Proposal.</i></p> <p>State Filing:</p>											
Structure Details											
Latitude:	36° 58' 42.78" N										
Longitude:	97° 6' 17.90" W										
Horizontal Datum:	NAD83										
Site Elevation (SE):	1179 (nearest foot) PASSED										
Structure Height (AGL):	599 (nearest foot)										
Current Height (AGL):	(nearest foot)										
<p><i>* For notice of alteration or existing provide the current AGL height of the existing structure. Include details in the Description of Proposal</i></p>											
Minimum Operating Height (AGL):	(nearest foot)										
<p><i>* For aeronautical study of a crane or construction equipment the maximum height should be listed above as the Structure Height (AGL). Additionally, provide the minimum operating height to avoid delays if impacts are identified that require negotiation to a reduced height. If the Structure Height and minimum operating height are the same enter the same value in both fields.</i></p>											
Requested Marking/Lighting:	Red lights and paint										
Recommended Marking/Lighting:	White Paint/Synchronized Red Lights										
Current Marking/Lighting:	N/A Proposed Structure										
Other :	<input type="text"/>										
Nearest City:	New Kirk										
Nearest State:	Oklahoma										
Description of Location:	14 Miles North of New Kirk										
Description of Proposal:	80 WTG Project for electric production										
Structure Summary											
Structure Type:	Wind Turbine *legacy*										
Structure Type:	<input type="text" value="WIND_TURBINE"/> Wind Turbine										
Structure Name:	76										
FDC NOTAM:											
NOTAM Number:											
FCC Number:											
Prior ASN:											
Proposed Frequency Bands											
	<table border="1"> <thead> <tr> <th>Low Freq</th> <th>High Freq</th> <th>Freq Unit</th> <th>ERP</th> <th>ERP Unit</th> </tr> </thead> <tbody> <tr> <td></td> <td></td> <td></td> <td></td> <td></td> </tr> </tbody> </table>	Low Freq	High Freq	Freq Unit	ERP	ERP Unit					
Low Freq	High Freq	Freq Unit	ERP	ERP Unit							





Notice of Proposed Construction or Alteration - Off Airport

[Add a New Case \(Off Airport\) - Desk Reference Guide V_2018.2.1](#)

[Add a New Case \(Off Airport\) for Wind Turbines - Met Towers \(with WT Farm\) - WT-Barge Crane - Desk Reference Guide V_2018.2.1](#)

Project Name: PNEWI-000610357-19

Sponsor: PNE USA

Details for Case : 77

[Show Project Summary](#)

Case Status					
ASN:	2019-WTW-4479-OE				
Status:	Determined				
7460-2 Forms:	<p>01/13/2021</p> <p>7460-2 (PART 1) required at least 10 days prior to start of construction.</p> <p>Add Supplemental Notice (7460-2)</p>				
Public Comments:	None				
Date Accepted:	04/22/2019				
Date Determined:	08/18/2019				
Letters:	<p>03/24/2021 EXT</p> <p>08/18/2019 DNH</p> <p>06/24/2019 NPH</p>				
Documents:	<p>None</p> <p>Project Documents:</p> <p>04/22/2019 Chilocco - FAA Fi...</p> <p>04/22/2019 Chilocco - FAA F...</p> <p>04/18/2019 Chilocco - FAA Fi...</p>				
Construction / Alteration Information					
Notice Of:					
Duration:	Permanent				
if Temporary :	Months: Days:				
Work Schedule - Start:	01/01/2020				
Work Schedule - End:	01/01/2021				
<p><i>*For temporary cranes-Does the permanent structure require separate notice to the FAA? To find out, use the Notice Criteria Tool. If separate notice is required, please ensure it is filed. If it is not filed, please state the reason in the Description of Proposal.</i></p> <p>State Filing:</p>					
Structure Details					
Latitude:	36° 58' 42.94" N				
Longitude:	97° 5' 57.23" W				
Horizontal Datum:	NAD83				
Site Elevation (SE):	1168 (nearest foot) PASSED				
Structure Height (AGL):	599 (nearest foot)				
Current Height (AGL):	(nearest foot)				
<p><i>* For notice of alteration or existing provide the current AGL height of the existing structure. Include details in the Description of Proposal</i></p>					
Minimum Operating Height (AGL):	(nearest foot)				
<p><i>* For aeronautical study of a crane or construction equipment the maximum height should be listed above as the Structure Height (AGL). Additionally, provide the minimum operating height to avoid delays if impacts are identified that require negotiation to a reduced height. If the Structure Height and minimum operating height are the same enter the same value in both fields.</i></p>					
Requested Marking/Lighting:	Red lights and paint				
Recommended Marking/Lighting:	White Paint/Synchronized Red Lights				
Current Marking/Lighting:	N/A Proposed Structure				
Other :	<input type="text"/>				
Nearest City:	New Kirk				
Nearest State:	Oklahoma				
Description of Location:	14 Miles North of New Kirk				
Description of Proposal:	80 WTG Project for electric production				
Structure Summary					
Structure Type:	Wind Turbine *legacy*				
Structure Type:	<input type="text" value="WIND_TURBINE"/> Wind Turbine				
Structure Name:	77				
FDC NOTAM:					
NOTAM Number:					
FCC Number:					
Prior ASN:					
Proposed Frequency Bands					
	Low Freq	High Freq	Freq Unit	ERP	ERP Unit





Notice of Proposed Construction or Alteration - Off Airport

[Add a New Case \(Off Airport\) - Desk Reference Guide V_2018.2.1](#)

[Add a New Case \(Off Airport\) for Wind Turbines - Met Towers \(with WT Farm\) - WT-Barge Crane - Desk Reference Guide V_2018.2.1](#)

Project Name: PNEWI-000610357-19

Sponsor: PNE USA

Details for Case : 78

[Show Project Summary](#)

Case Status	
ASN:	2019-WTW-4480-OE
Status:	Determined
7460-2 Forms:	<p>01/13/2021</p> <p>7460-2 (PART 1) required at least 10 days prior to start of construction.</p> <p>Add Supplemental Notice (7460-2)</p>
Public Comments:	None
Date Accepted:	04/22/2019
Date Determined:	08/18/2019
Letters:	<p>03/24/2021 EXT</p> <p>08/18/2019 DNH</p> <p>06/24/2019 NPH</p>
Documents:	<p>None</p> <p>Project Documents:</p> <p>04/22/2019 Chilocco - FAA Fi...</p> <p>04/22/2019 Chilocco - FAA F...</p> <p>04/18/2019 Chilocco - FAA Fi...</p>

Construction / Alteration Information	
Notice Of:	
Duration:	Permanent
if Temporary :	Months: Days:
Work Schedule - Start:	01/01/2020
Work Schedule - End:	01/01/2021
<p><i>*For temporary cranes-Does the permanent structure require separate notice to the FAA? To find out, use the Notice Criteria Tool. If separate notice is required, please ensure it is filed. If it is not filed, please state the reason in the Description of Proposal.</i></p> <p>State Filing:</p>	

Structure Summary	
Structure Type:	Wind Turbine *legacy*
Structure Type:	<input type="text" value="WIND_TURBINE"/> Wind Turbine
Structure Name:	78
FDC NOTAM:	
NOTAM Number:	
FCC Number:	
Prior ASN:	

Structure Details	
Latitude:	36° 58' 28.16" N
Longitude:	97° 4' 53.14" W
Horizontal Datum:	NAD83
Site Elevation (SE):	1174 (nearest foot) PASSED
Structure Height (AGL):	599 (nearest foot)
Current Height (AGL):	(nearest foot)
<p><i>* For notice of alteration or existing provide the current AGL height of the existing structure. Include details in the Description of Proposal</i></p>	
Minimum Operating Height (AGL):	(nearest foot)
<p><i>* For aeronautical study of a crane or construction equipment the maximum height should be listed above as the Structure Height (AGL). Additionally, provide the minimum operating height to avoid delays if impacts are identified that require negotiation to a reduced height. If the Structure Height and minimum operating height are the same enter the same value in both fields.</i></p>	
Requested Marking/Lighting:	Red lights and paint
Recommended Marking/Lighting:	White Paint/Synchronized Red Lights
Current Marking/Lighting:	N/A Proposed Structure
Other :	<input type="text"/>
Nearest City:	New Kirk
Nearest State:	Oklahoma
Description of Location:	14 Miles North of New Kirk
Description of Proposal:	80 WTG Project for electric production

Proposed Frequency Bands				
Low Freq	High Freq	Freq Unit	ERP	ERP Unit





Notice of Proposed Construction or Alteration - Off Airport

[Add a New Case \(Off Airport\) - Desk Reference Guide V_2018.2.1](#)

[Add a New Case \(Off Airport\) for Wind Turbines - Met Towers \(with WT Farm\) - WT-Barge Crane - Desk Reference Guide V_2018.2.1](#)

Project Name: PNEWI-000610357-19

Sponsor: PNE USA

Details for Case : 79

[Show Project Summary](#)

Case Status	
ASN:	2019-WTW-4481-OE
Status:	Determined
7460-2 Forms:	<p>01/13/2021</p> <p>7460-2 (PART 1) required at least 10 days prior to start of construction.</p> <p>Add Supplemental Notice (7460-2)</p>
Public Comments:	None
Date Accepted:	04/22/2019
Date Determined:	08/18/2019
Letters:	<p>03/24/2021 EXT</p> <p>08/18/2019 DNH</p> <p>06/24/2019 NPH</p>
Documents:	<p>None</p> <p>Project Documents:</p> <p>04/22/2019 Chilocco - FAA Fi...</p> <p>04/22/2019 Chilocco - FAA F...</p> <p>04/18/2019 Chilocco - FAA Fi...</p>

Construction / Alteration Information	
Notice Of:	
Duration:	Permanent
if Temporary :	Months: Days:
Work Schedule - Start:	01/01/2020
Work Schedule - End:	01/01/2021
<p><i>*For temporary cranes-Does the permanent structure require separate notice to the FAA? To find out, use the Notice Criteria Tool. If separate notice is required, please ensure it is filed. If it is not filed, please state the reason in the Description of Proposal.</i></p> <p>State Filing:</p>	

Structure Summary	
Structure Type:	Wind Turbine *legacy*
Structure Type:	<input type="text" value="WIND_TURBINE"/> Wind Turbine
Structure Name:	79
FDC NOTAM:	
NOTAM Number:	
FCC Number:	
Prior ASN:	

Structure Details	
Latitude:	36° 58' 35.09" N
Longitude:	97° 5' 15.03" W
Horizontal Datum:	NAD83
Site Elevation (SE):	1171 (nearest foot) PASSED
Structure Height (AGL):	599 (nearest foot)
Current Height (AGL):	(nearest foot)
<p><i>* For notice of alteration or existing provide the current AGL height of the existing structure. Include details in the Description of Proposal</i></p>	
Minimum Operating Height (AGL):	(nearest foot)
<p><i>* For aeronautical study of a crane or construction equipment the maximum height should be listed above as the Structure Height (AGL). Additionally, provide the minimum operating height to avoid delays if impacts are identified that require negotiation to a reduced height. If the Structure Height and minimum operating height are the same enter the same value in both fields.</i></p>	
Requested Marking/Lighting:	Red lights and paint
Recommended Marking/Lighting:	White Paint/Synchronized Red Lights
Current Marking/Lighting:	N/A Proposed Structure
Other :	<input type="text"/>
Nearest City:	New Kirk
Nearest State:	Oklahoma
Description of Location:	14 Miles North of New Kirk
Description of Proposal:	80 WTG Project for electric production

Proposed Frequency Bands				
Low Freq	High Freq	Freq Unit	ERP	ERP Unit





Notice of Proposed Construction or Alteration - Off Airport

[Add a New Case \(Off Airport\) - Desk Reference Guide V_2018.2.1](#)

[Add a New Case \(Off Airport\) for Wind Turbines - Met Towers \(with WT Farm\) - WT-Barge Crane - Desk Reference Guide V_2018.2.1](#)

Project Name: PNEWI-000610357-19

Sponsor: PNE USA

Details for Case : 80

[Show Project Summary](#)

Case Status	
ASN:	2019-WTW-4482-OE
Status:	Determined
7460-2 Forms:	<p>01/13/2021</p> <p>7460-2 (PART 1) required at least 10 days prior to start of construction.</p> <p>Add Supplemental Notice (7460-2)</p>
Public Comments:	None
Date Accepted:	04/22/2019
Date Determined:	08/18/2019
Letters:	<p>03/24/2021 EXT</p> <p>08/18/2019 DNH</p> <p>06/24/2019 NPH</p>
Documents:	<p>None</p> <p>Project Documents:</p> <p>04/22/2019 Chilocco - FAA Fi...</p> <p>04/22/2019 Chilocco - FAA F...</p> <p>04/18/2019 Chilocco - FAA Fi...</p>

Construction / Alteration Information	
Notice Of:	
Duration:	Permanent
if Temporary :	Months: Days:
Work Schedule - Start:	01/01/2020
Work Schedule - End:	01/01/2021
<p><i>*For temporary cranes-Does the permanent structure require separate notice to the FAA? To find out, use the Notice Criteria Tool. If separate notice is required, please ensure it is filed. If it is not filed, please state the reason in the Description of Proposal.</i></p> <p>State Filing:</p>	


Structure Summary	
Structure Type:	Wind Turbine *legacy*
Structure Type:	<input type="text" value="WIND_TURBINE"/> Wind Turbine
Structure Name:	80
FDC NOTAM:	
NOTAM Number:	
FCC Number:	
Prior ASN:	



Structure Details	
Latitude:	36° 58' 29.83" N
Longitude:	97° 5' 32.06" W
Horizontal Datum:	NAD83
Site Elevation (SE):	1173 (nearest foot) PASSED
Structure Height (AGL):	599 (nearest foot)
Current Height (AGL):	(nearest foot)
<p><i>* For notice of alteration or existing provide the current AGL height of the existing structure. Include details in the Description of Proposal</i></p>	
Minimum Operating Height (AGL):	(nearest foot)
<p><i>* For aeronautical study of a crane or construction equipment the maximum height should be listed above as the Structure Height (AGL). Additionally, provide the minimum operating height to avoid delays if impacts are identified that require negotiation to a reduced height. If the Structure Height and minimum operating height are the same enter the same value in both fields.</i></p>	
Requested Marking/Lighting:	Red lights and paint
Recommended Marking/Lighting:	White Paint/Synchronized Red Lights
Current Marking/Lighting:	N/A Proposed Structure
Other :	<input type="text"/>
Nearest City:	New Kirk
Nearest State:	Oklahoma
Description of Location:	14 Miles North of New Kirk
Description of Proposal:	80 WTG Project for electric production


Proposed Frequency Bands				
Low Freq	High Freq	Freq Unit	ERP	ERP Unit

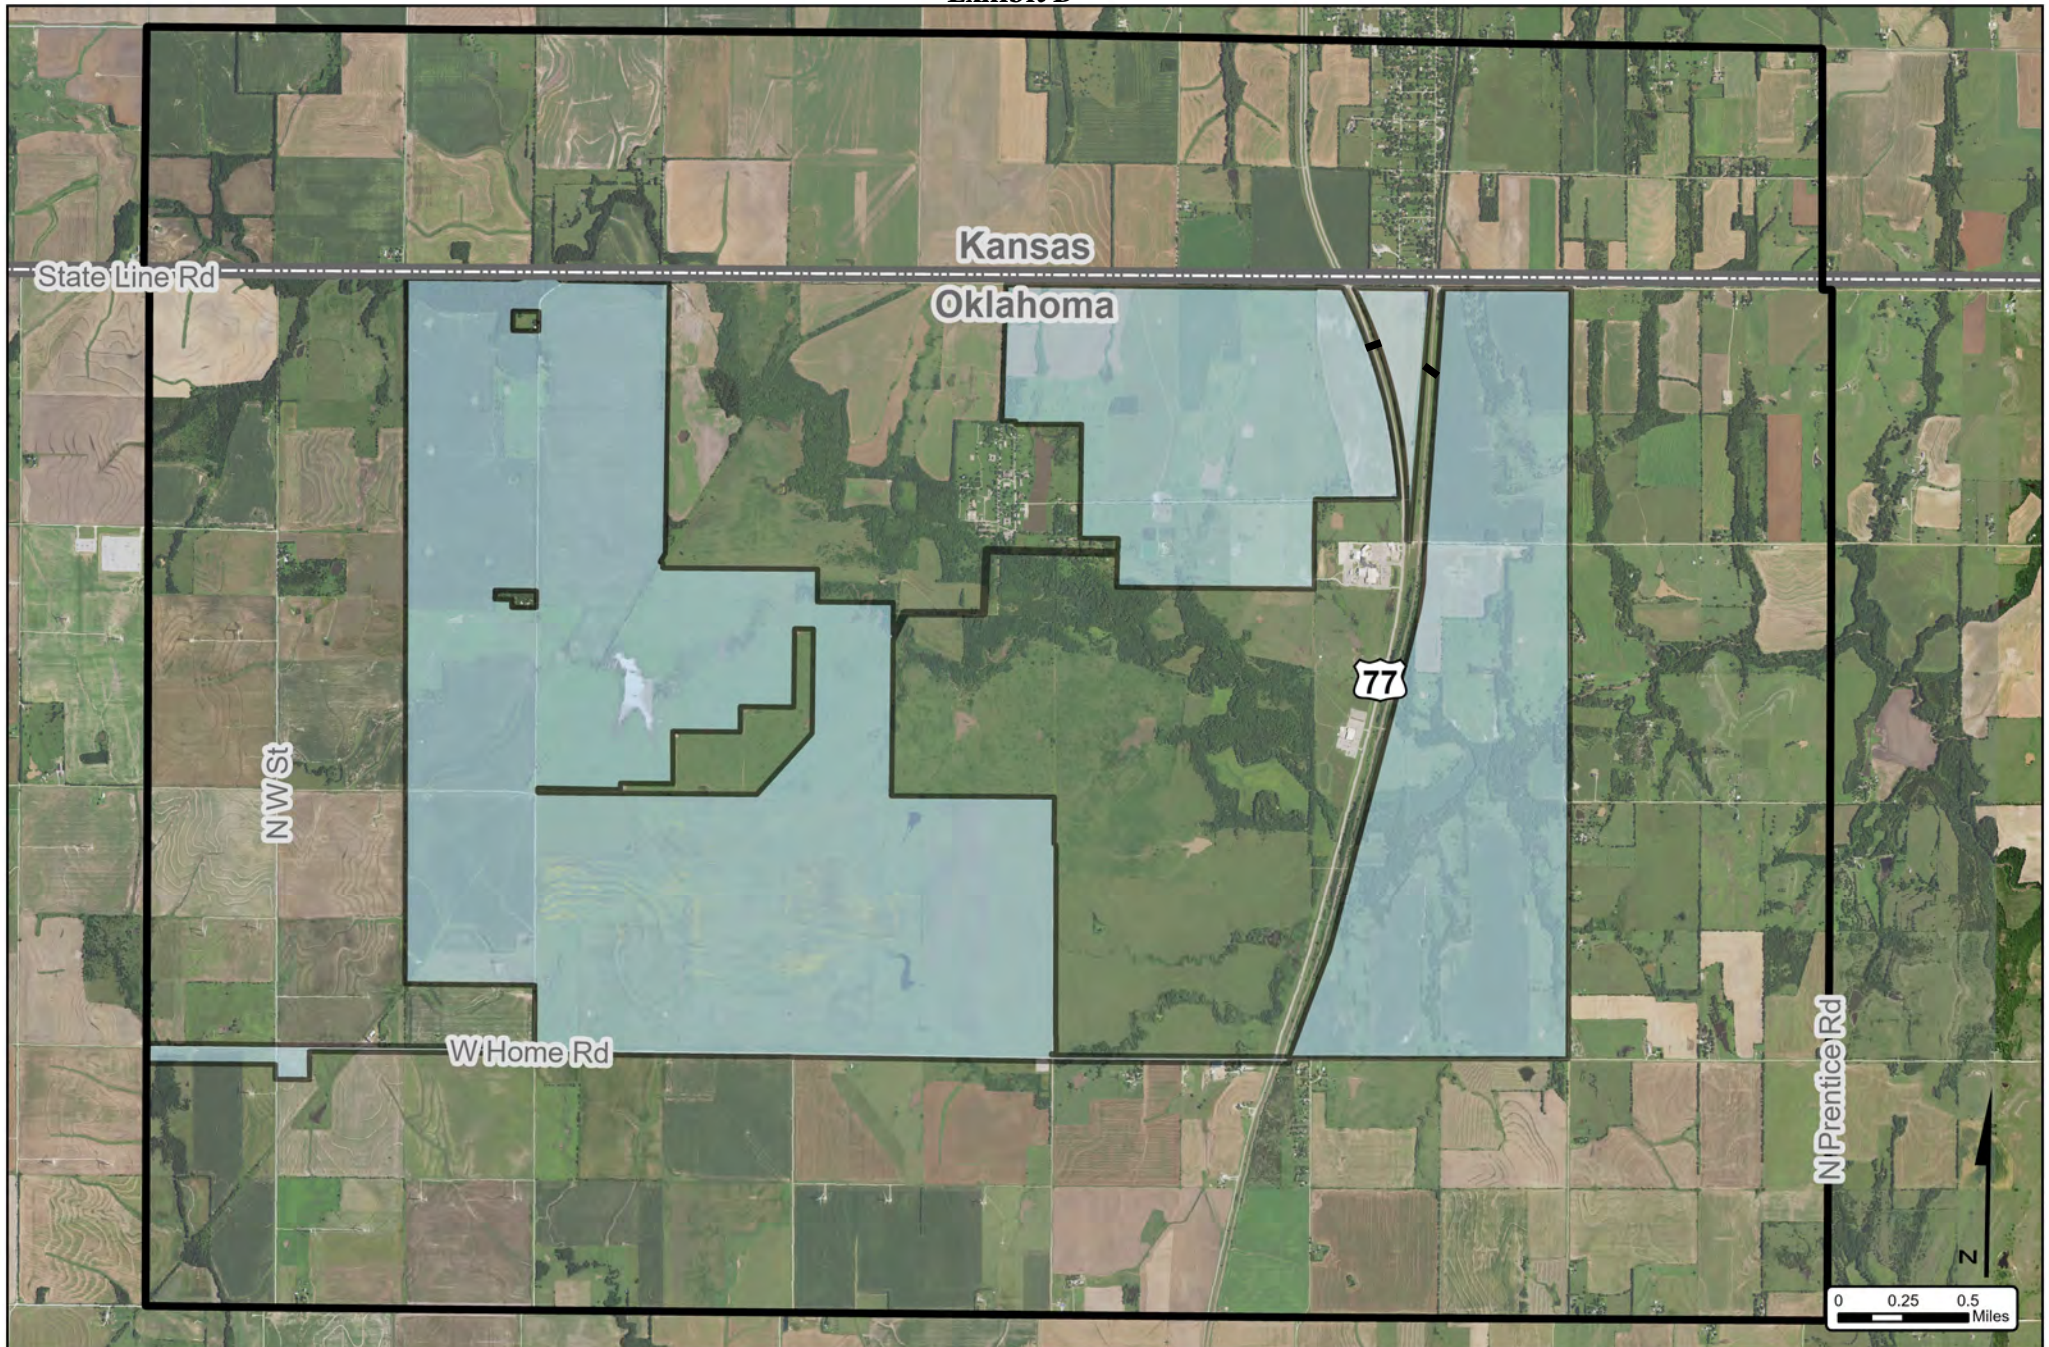

Exhibit B



-  Project Site
-  Project Boundary



PNE
pure new energy

Project:	Chilocco Wind Farm
GIS File:	Project Boundary Map
Location:	Kay County, Oklahoma